



Weekly mean water temperature and salinity as measured at Cotuit Bay during 2014.

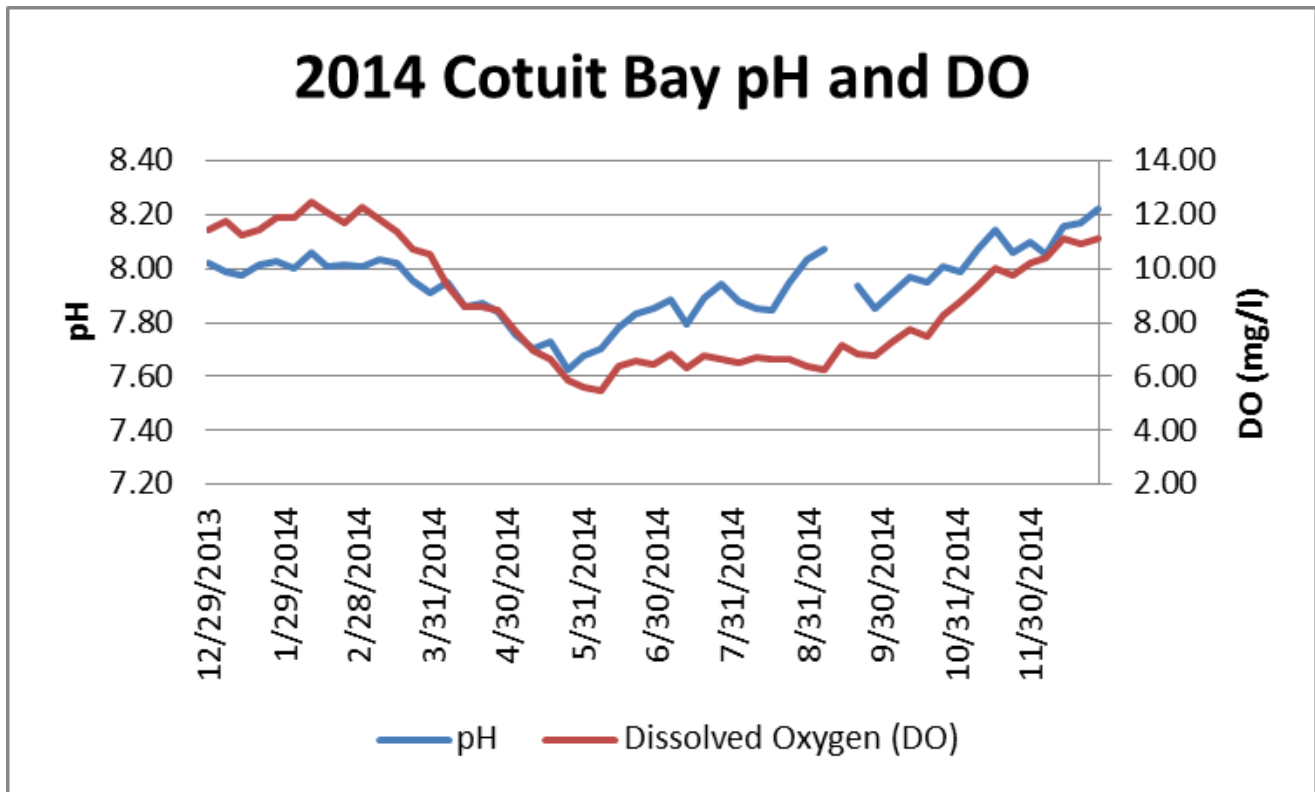

Weekly mean pH and dissolved oxygen as measured at Cotuit Bay during 2014.

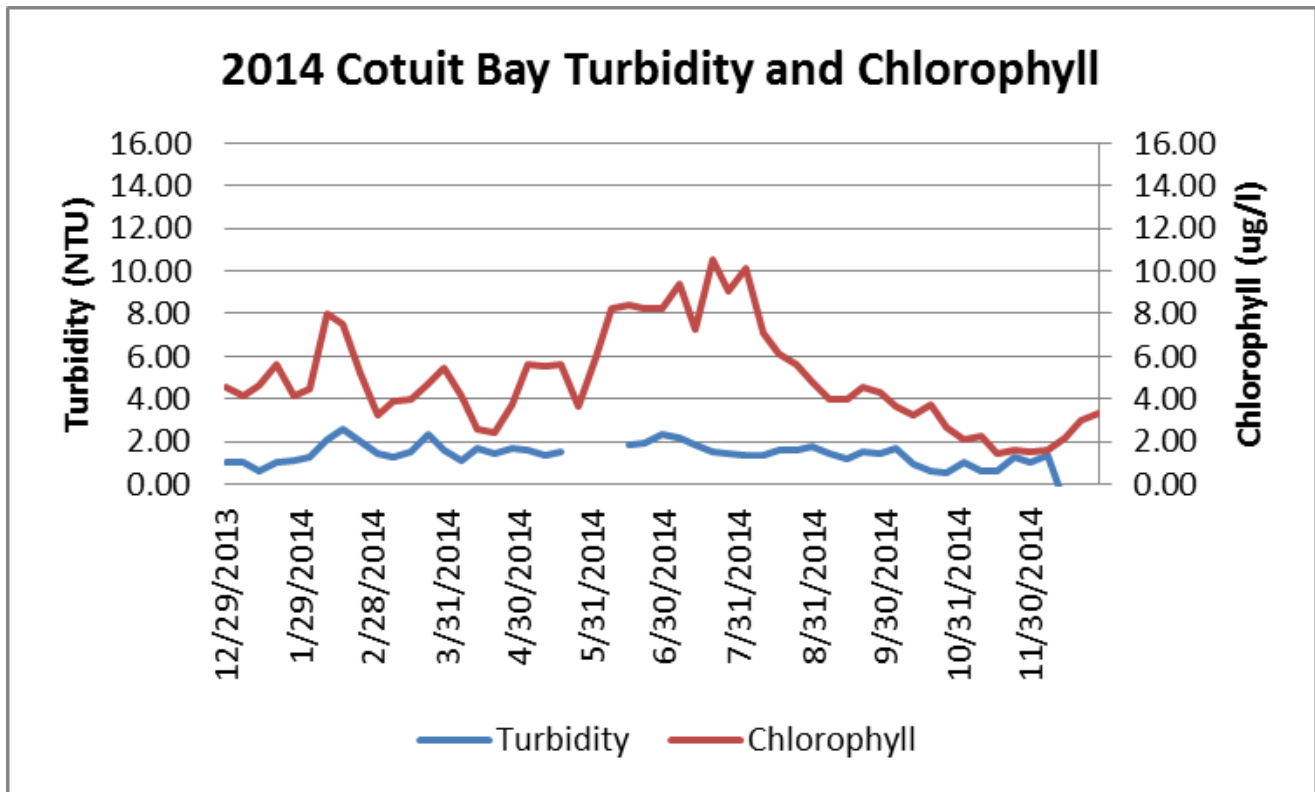

Weekly mean turbidity and chlorophyll as measured at Cotuit Bay during 2014.