

RTN 4-26179

Barnstable County Fire & Rescue Training
Academy
Barnstable, MA
February 2022

IMMEDIATE RESPONSE ACTION STATUS &
REMEDIAL MONITORING REPORT NO. 62



701 George Washington Hwy
Lincoln, Rhode Island 02865
401.333.2382
www.BETA-Inc.com

Barnstable County Fire & Rescue Training Academy

RTN 4-26179
Barnstable, MA

IMMEDIATE RESPONSE ACTION STATUS & REMEDIAL MONITORING REPORT NO. 62

Prepared by: BETA GROUP, INC.
Prepared for: Barnstable County

February 2022

TABLE OF CONTENTS

1.0 INTRODUCTION	1
2.0 GENERAL DISPOSAL SITE INFORMATION.....	1
2.1 PROPERTY AND SITE DESCRIPTION.....	1
2.2 LATITUDE AND LONGITUDE / UNIVERSAL TRANSVERSE MERCATOR'S	3
2.3 ENVIRONMENTAL SETTING AND SENSITIVE RECEPTORS.....	7
2.4 MASSDEP METHOD 1 CATEGORIES	3
2.4.1 GROUND WATER CATEGORY	3
2.4.2 SOIL CATEGORY	3
3.0 DISPOSAL SITE HISTORY AND OVERVIEW	4
3.1 RELEASE HISTORY AND DESCRIPTION - RTN 4-26179 (PFAS RELEASE).....	4
3.2 GROUNDWATER PUMP AND TREAT SYSTEMS	6
3.3 PHASE I INITIAL SITE INVESTIGATION AND TIER CLASSIFICATION.....	7
3.4 FLINTROCK POND ASSESSMENTS	7
3.5 SAMPLING AND ANALYSIS FOR PFAS.....	8
3.6 PUBLIC INVOLVEMENT	9
3.7 PUBLIC COMMENT DRAFT PHASE II COMPREHENSIVE SITE ASSESSMENT SCOPE OF WORK	9
4.0 HISTORICALLY AND RECENTLY COMPLETED IRA ACTIVITIES.....	9
4.1 CONTINUING OPERATION & MAINTENANCE OF GWTS	10
4.2 CURRENT OPERATION & MAINTENANCE OF GWPT SYSTEMS	11
4.2.1 REMEDIAL MONITORING REPORT – GWPTS #1	12
4.2.2 REMEDIAL MONITORING REPORT – GWPTS #2	13
4.2.3 REMEDIAL MONITORING REPORT SUMMARY	14
4.3 QUARTERLY GROUNDWATER MONITORING	15
4.3.1 MAY 2021 SITE-WIDE QUARTERLY GROUNDWATER SAMPLING AND ANALYSIS.....	15
4.3.2 SITE-WIDE GROUNDWATER GAUGING AND ELEVATION SURVEY	17
5.0 SITE WIDE CAPPING AND SELECT BUILDING DEMOLITION	18
6.0 IRA EVALUATION.....	18
6.1 ASSESSMENT FOR SUBSTANTIAL RELEASE MIGRATION (SRM)	18
6.2 IDENTIFICATION OF CRITICAL EXPOSURE PATHWAYS (CEP).....	18
6.3 IMMINENT HAZARD (IH) EVALUATION	18
6.4 ASSESSMENT OF NEED FOR IMMEDIATE RESPONSE ACTIONS (IRA).....	19
7.0 PUBLIC NOTIFICATIONS.....	19

LIST OF TABLES

Table 1A – Summary of Groundwater Pump and Treatment System PFAS Analytical Data – System #1	Appended
Table 1B – Summary of Groundwater Pump and Treatment System PFAS Analytical Data – System #2.....	Appended
Table 2A – Summary of Groundwater Pump and Treatment System Operating and Maintenance Data – System #1.....	Appended
Table 2B – Summary of Groundwater Pump and Treatment System Operating and Maintenance Data – System #2.....	Appended
Table 3 – Groundwater Elevation and Gauging Data 2018-2020.....	Appended
Table 4A – Summary of Current Groundwater PFAS Analytical Data.....	Appended
Table 4B – Summary of Historic Groundwater PFAS Analytical Data.....	Appended

LIST OF FIGURES

Figure 1 - Site Location Map (USGS Topographic Quadrangle)
Figure 2 - Site Plan Detail - FTA Facility
Figure 3 - Site Plan
Figure 4 – Phase I Site Assessment Map
Figure 5 – GWPTS #1 PFAS Concentrations - 2015-2022
Figure 6 - ΣFAS Concentrations in PFW-1 from June 2018-January 2022
Figure 7 - ΣFAS Concentrations in OW-8A from June 2018-January 2022
Figure 8 - ΣFAS Concentrations in MW-12 and MW-22 from June 2018-January 2022
Figure 9A - ΣFAS Concentrations in PC-6A from June 2018-January 2022
Figure 9B - ΣFAS Concentrations in PC-11 from June 2018-January 2022
Figure 9C - ΣFAS Concentrations in PC-28 from June 2018-January 2022
Figure 9D - ΣFAS Concentrations in PC-30 from June 2018-January 2022
Figure 10 – Groundwater Plume Map – January 2022
Figure 11– Groundwater Contour Map – January 2022

LIST OF APPENDICES

APPENDIX A - BWSC TRANSMITTAL FORM 105, 105A, 105B
APPENDIX B – LABORATORY REPORTS/CERTIFICATES OF ANALYSIS
APPENDIX C – PUBLIC NOTIFICATIONS

1.0 INTRODUCTION

BETA Group Inc. (BETA) has prepared this Immediate Response Action (IRA) Status and Remedial Monitoring Report (RMR) No. 62 that addresses a release of hazardous materials related to fire-fighting foams and attributed to the former Barnstable County Fire and Rescue Training facility located at 155 South Flint Rock Road in Barnstable, Massachusetts (the FTA or facility). This document has been prepared on behalf of Barnstable County. It is being submitted to the Massachusetts Department of Environmental Protection (MassDEP) – Bureau of Waste Site Cleanup (BWSC) in response to the detection of elevated concentrations of per- and polyfluoroalkyl substances (PFAS), including perfluorooctane sulfonate (PFOS) and perfluorooctanoic acid (PFOA), in soil and groundwater at the facility and in adjacent areas, in particular to the east, southeast of the facility. This report provides monthly IRA status reporting on the groundwater pumping and treatment systems at the Site for the January 2022 reporting period. In addition, this status report describes the activities and results of the Site-wide groundwater monitoring conducted in January 2022.

This (IRA) Status and Remedial Monitoring Report (RMR) No. 62 is being submitted to MassDEP as an attachment to the BWSC 105 Immediate Response Action (IRA) and BWSC 105A and 105B IRA Remedial Monitoring Report Transmittal Forms. Completed copies of these forms prior to electronic signature are included in Appendix A.

As current owners of the FTA, Barnstable County, as represented by the Barnstable County Commissioners, have been named as the Potentially Responsible Party (PRP) for this release. The contact person for the Disposal Site and release is:

Steve Tebo, Asset and Infrastructure Manager
Barnstable County
3195 Main Street
Barnstable, MA 02630

Telephone: 508-375-6643
Email: stebo@barnstablecounty.org

BETA is performing MCP Response Actions on behalf of the Barnstable County Commissioners. The Licensed Site Professional (LSP) overseeing Response Actions for this release is:

Roger Thibault, P.E., LSP No. 1443
BETA Group Inc.
701 George Washington Highway

Telephone: 401-333-2382
Email: rthibault@beta-inc.com

2.0 GENERAL DISPOSAL SITE INFORMATION

2.1 PROPERTY AND SITE DESCRIPTION

The former Barnstable County Fire and Rescue Training FTA (FTA or facility) is located on South Flint Rock Road in the Town of Barnstable. It appears on the United States Geological Survey (USGS) Topographic Quadrangle – Hyannis, Massachusetts -Figure 1 – Site Location map, prepared from a portion of the referenced USGS Topographic Quadrangle map. The Site is currently zoned for industrial use.

For the purposes of this and future MCP submittals, the property on which the FTA is located will be referred to as the FTA or facility. FTA or facility will also refer to the structures, land and former functions of the FTA.

In accordance with the MCP definitions, where contamination attributable to the PFAS releases associated with firefighting foams and training on the FTA have come to be located will be referred to as the Disposal Site or Site.

Following the completion of the capping and select demolition project in November 2021, the 6.2 acre FTA is improved by one primary building: an auxiliary fire station and training building (with two classrooms, administrative offices, and two apparatus bays), two Quonset hut sheds used for storage of County equipment. Refer to Figure 2. The former fire training apparatus has been demolished and/or removed from the Site. The FTA is secured by chain link fencing and a locked gate. The FTA is listed on the Town of Barnstable Assessor's on-line records as Map 313, Lot 007. The current owner-of-record is the County of Barnstable, who acquired the facility from the Town of Barnstable in 1983 by deed recorded June 3, 1983, Barnstable Registry of Deeds, Book 3759, Page 39. Utilities servicing the FTA include municipal water, an underground septic system, aboveground electricity and telecommunications.

The FTA was first constructed on land donated to the Town of Barnstable by the Cobb Trust in 1955. The FTA had been used for public safety training since the 1950's. The FTA was formerly used for public safety training by fire departments and fire districts from throughout Barnstable County, fire departments outside of Barnstable County, and other public and private institutions. Live fire training using firefighting foams, including aqueous film forming foams (AFFF), was conducted at the FTA for decades by fire districts and departments that used their own foam brought to the FTA in the apparatus of the organization participating in the training. Foam training exercises at the FTA ceased in 2009 according to FTA officials. Water training activities ceased in June 2019.

Land surrounding the FTA is primarily undeveloped, wooded land within a public water supply protection area. Flintrock Pond occupies approximately 6 acres directly to the west of the FTA. Several public water supply wells and their related facilities are located to the east, southeast, and west of the FTA.

At this time, the preliminary MCP Disposal Site (the Site) associated with RTN 4-26179 is considered to comprise approximately the majority of the FTA, the westerly adjacent Flintrock Pond, and a large woodland area to the southeast of the FTA, approaching Mary Dunn Pond.

The southeastern portion of the Site includes land owned by the Town of Barnstable, which is crossed by two electric power transmission lines running presumably within easements. Private industrial properties and related structures are located approximately 500 to 1,000 feet south of the Site. The Barnstable Municipal Airport is located to the west (runway 15 – 33) and south of the Site and the FTA.

The nearest residential properties are located approximately ¼ mile to the north of the Site. Based on 2010 U.S. Census data, the residential population located within a ½ mile radius of the Site is estimated to be less than 150 people. There are no known Institutions located within 500 feet of the Site. The municipal well pumping facilities referenced above (not part of the FTA) are not staffed full-time.

2.2 LATITUDE AND LONGITUDE / UNIVERSAL TRANSVERSE MERCATOR'S

The coordinates for the Site are shown below. For simplicity, these coordinates are for the southerly end of the FTA.

<u>Latitude/Longitude</u>	Latitude: 41° 40' 41.53"N Longitude: 70° 17' 7.82"E
<u>UTM Coordinates</u>	Easting: 393,002 Northing: 4,614,847

2.3 MASSDEP METHOD 1 CATEGORIES

2.3.1 GROUND WATER CATEGORY

As noted, the Site is located within a Zone II Public Water Supply Protection Area and a Medium-Yield Sole Source Aquifer.

Therefore, MCP Method 1 Ground Water Category 1 (GW-1) applies to the Site. Groundwater at the Site is also categorized as Method 1 GW-2 because groundwater has been measured at depths less than 15 feet below grade and an occupied building is located within the FTA facility.

All ground waters within the Commonwealth are considered a potential source of discharge to surface waters and shall be categorized, at a minimum, as Method 1 GW-3. Therefore, the applicable Method 1 Ground Water Categories for the Site are GW-1, GW-2 and GW-3.

2.3.2 SOIL CATEGORY

Soil categorization is based upon the type of human receptor and three potential exposure criteria: frequency of use, intensity of use, and accessibility of soil. The FTA portion of the Site is occupied by a former fire and rescue training facility. Based on the nature of the facility, children are assumed to be "not present." Adults who work at the site as staff members are assumed to be present at "high frequency." Impacted soils have been identified beneath unpaved areas at depths ranging from approximately less than 3 to 15 feet below the ground surface. Therefore, impacted soils at the FTA are considered "potentially accessible."

Only groundwater impacts at significant depths below the ground surface have been identified at the remainder of the Site (outside of the FTA), which consists of undeveloped, industrially zoned land, a portion of a utility easement, and three unmanned public water supply well stations.

Intensity of use in regard to soil disturbance in the release area for adults at the Site is considered "high" because the area of impact at the FTA could potentially be disturbed during Site activities. However, former on-Site training activities were of relatively short duration with potential high intensity use. Current Site maintenance-related activities are similar in terms of duration and potential intensity. Therefore, for current Site uses, soils at the Site are categorized as Soil Category S-2. The applicable Soil Categories for current Site uses have been identified as S-2/GW-1, S-2/GW-2 and S-2/GW-3.

The applicable Soil Categories for unrestricted future Site uses are S-1/GW-1, S-1/GW-2 and S-1/GW-3.

3.0 DISPOSAL SITE HISTORY AND OVERVIEW

The Site has historically been the subject of four MassDEP RTNs: 4-190, 4-11707, 4-20021, and 4-26179. This IRA Plan Modification is being submitted for RTN 4-26179 only. The original RTN, 4-190, is being managed separately; closure has been achieved for the remaining two RTNs.

3.1 RELEASE HISTORY AND DESCRIPTION - RTN 4-26179 (PFAS RELEASE)

In May 2012, USEPA issued their final rule “Revisions to the Unregulated Contaminant Monitoring Rule (UCMR3) for Public Water Systems,” which was a national sampling mandate for “emerging contaminants” in public water supplies. The required sampling list included several PFAS compounds, including but not limited to PFOS and PFOA. In November 2013, samples were collected from Mary Dunn supply wells MD-1, MD-2 and MD-3 and analyzed for PFAS.

At the time of the testing, the US EPA Provisional Health Advisory (HA) was 0.20 micrograms per liter (µg/L) for PFOS. Analytical results revealed evidence of PFOS contamination in all three wells sampled. MD-1 and MD-2 were temporarily removed from service. MD-3 was apparently not in use at that time. A treatment system that utilizes granular activated carbon (GAC) was later implemented for MD-1 and MD-2 [July 2015] by the Hyannis Water Department. In 2016, GAC treatment was also implemented for MD-3. [See below].

In November 2013, Barnstable County personnel also collected soil and groundwater samples from the FTA property, located approximately 1,000 feet west of the Mary Dunn wells, and submitted them for laboratory analysis of PFAS. Groundwater analytical results revealed that FTA groundwater was impacted by PFOS and MassDEP was subsequently notified.

PFOS was also detected in soil at the FTA and in surface water and sediment within the adjacent Flintrock Pond. As summarized in the Notice of Responsibility (NOR) issued by MassDEP on August 4, 2016 (see below), based on the detected PFAS concentrations in soil and groundwater at the FTA and the inferred groundwater flow direction being to the southeast (toward the Mary Dunn wells), MassDEP determined that the releases of PFAS from the use of AFFF at the FTA is a source of PFAS detected in the Mary Dunn wells.

As a voluntary measure, Barnstable County refurbished the former perchlorate pump and treat system located at the FTA to help remediate and contain the PFOS apparently migrating from the facility. The groundwater pumping and treatment system (GWPTS) was re-started using granular activated carbon (GAC) in the former perchlorate treatment vessels for treatment in July 2015. The system utilizes a groundwater recovery well, PRW-4, located approximately 800 feet southeast of the FTA. The groundwater treatment system (GWTS) itself is located in a structure on the FTA grounds.

In August 2015, Barnstable County funded a more detailed hydrogeological assessment, continued implementation of a groundwater pump and treat system to capture PFOS upgradient of the Mary Dunn wells, and additional assessment and immediate response actions. The Cape Cod Commission evaluated subsurface soil and groundwater conditions at the FTA facility as part of the IRA assessment activities. The soil results indicated a broad area of PFOS contamination throughout the subsurface. The highest PFOS concentrations were detected near the southwestern corner of the FTA, a location subsequently referred to as the hot spot.

Groundwater analytical results from the 2015 assessment revealed PFOS contamination ranging from less than 0.070 µg/L (the current US EPA HA) to over 4.0 µg/L. The groundwater samples were collected from monitoring wells across the area between the FTA and the Mary Dunn wells. Like the soil results, the highest PFOS concentrations were detected near the southwestern corner of the FTA.

In May 2016, US EPA revised/lowered its HA for PFAS from 0.20 µg/L of PFOS and PFOA to 0.070 µg/L for either compound or the total of the two. EPA noted that the HA was for drinking water exposures only. In response to the lowered HA PFAS concentrations, on August 4, 2016, MassDEP issued a Notice of Responsibility (NOR) to Barnstable County and required submittal of an Immediate Response Action (IRA) Plan no later than September 15, 2016. MassDEP requested that the Site owner evaluate potential Imminent Hazards relative to downgradient public and private water supply wells.

MassDEP indicated that this evaluation should include identification of all nearby public and private water supply wells, review of any existing analytical data for those wells, and sampling and analysis of any nearby wells that have not been sampled for PFAS.

MassDEP also stated that the IRA Plan should include measures to prevent, eliminate, and/or abate any hazards associated with the consumption of drinking water impacted by PFAS above the HA level of 0.070 ug/L.

MassDEP also required, as part of the IRA, activities to reduce the mass of PFAS at the FTA and the concentrations of PFAS in groundwater migrating from the FTA facility, such as excavating the soil hot spot and expanding the existing groundwater treatment system to decrease the mass of PFAS in groundwater.

On September 27, 2016, on behalf of Barnstable County, the Cape Cod Commission submitted an IRA Plan to MassDEP to address the PFOS/PFOA impacts. The IRA Plan included an evaluation of imminent hazards to downgradient public and private water supplies, specific plans for a Hot Spot removal action, and plans for an interim expansion of the existing groundwater pump and treatment system.

The proposed IRA to address the soil Hot Spot was to excavate up to 200 cubic yards from a 400 square foot area for off-Site disposal. The Hot Spot soil was removed in January 2017, reducing the primary source of PFOS contamination leaching into groundwater. However, post-removal grading and settling of the backfill in the Hot Spot area left it prone to infiltration of runoff from the southern portion of the FTA.

Between December 2016 and February 2018, the Cape Cod Commission submitted 15 IRA Status and Remedial Monitoring Reports (RMRs) to MassDEP for the PFAS release. The RMRs addressed the FTA GWPTS, which recovers and treats approximately 20,000 to 50,000 gallons per day (gpd) of groundwater from well PRW-4. The Site groundwater pump and treat system is working to reduce PFAS concentrations in the aquifer before it reaches the Mary Dunn municipal wells and treatment systems. Refer to Section 3.2 for further information regarding the on-Site GWPTS.

The Mary Dunn wells are equipped with GAC treatment systems to remove PFAS. The Mary Dunn wells as well as the GAC treatment systems are operated by SUEZ North America under contract with the HWSD. The GAC treatment of the Mary Dunn wells is actively preventing a potential Imminent Hazard to the Hyannis community by removing the PFAS compounds from the water supply. A Settlement Agreement between the Town of Barnstable and Barnstable County requires the County to fund a portion of the costs associated with operating the Mary Dunn wells treatment systems as well as a portion of the capital costs to install the GAC systems. Timely exchange of pumping and performance data related to the treatment of the Mary Dunn well water supplies to verify effectiveness of the IRA is noted in the Settlement Agreement between the parties.

On behalf of Barnstable County, BETA has submitted IRA Status reports and RMRs since March 2018. IRA Status and RMR reports have been submitted monthly since December 13, 2016. As detailed in recent IRA Status and RMR reports, including this report, groundwater monitoring data for locations across the Disposal Site confirm that elevated PFAS concentrations are still present in Site groundwater.

Analytical data from select monitoring wells indicate that PFAS concentrations in groundwater sampled in the former Hot Spot area have significantly decreased (following the Phase 1 stormwater improvements repair of the cap under the June 28, 2018 IRA Plan Modification); PFAS concentrations remain stable in groundwater sampled from wells east of the FTA; and PFAS concentrations remain elevated in groundwater sampled from within the area southeast of the FTA between the facility and the Mary Dunn wells. See Section 4.3 for the most recent (July 2021) groundwater monitoring data.

3.2 GROUNDWATER PUMP AND TREAT SYSTEMS

Response actions to address the early 1990s petroleum releases and the later detection of perchlorate included extensive subsurface assessment including installation of a significant network of monitoring wells.

In addition, to help remediate and control migration from the petroleum and perchlorate releases, in 1998 and 2007, respectively, response actions included the installation, upgrade, and/or renovation of a GWPTS at the Site. In July 2015 the decommissioned GWTS, formerly used to treat for perchlorate, was renovated and re-started to help remediate and contain the PFAS migration from the FTA; see below. The operational GWPTS was later noted in the NOR issued by MassDEP in August 2016 as part of the on-going IRAs. The NOR also requested that Barnstable County install additional recovery wells or increase the groundwater recovery rate to increase PFAS removal; see discussion of GWTS# 2 below. The approximate locations of key components of the GWPTS that are located on the FTA are shown on Figure 2 – Site Plan Detail. The location of the operating recovery well, PRW-4, and the approximate route of the force mains (two, 2-inch polyethylene pipes) are shown on Figure 3 – Site Plan.

GWTS # 1

In July 2015, the primary influent/recovery well pump installed in recovery well PRW-4 was repaired, a new variable frequency drive (VFD) unit pump was installed in the treatment system, and all accompanying electrical components were evaluated and repaired. The system was restarted in July 2015 upon the installation of 1500 pounds (lbs.) of aqueous phase GAC (Filtrisorb 400 virgin GAC) into each of the two, existing Siemens treatment vessels. The “capture zone” of PRW-4 was reportedly estimated to be 200 ft. at 40 gallons per minute (gpm). Groundwater is pumped from recovery well PRW-4, through two, 2-inch dia. HDPE, eight-hundred-foot force mains to the treatment building on the FTA; see Figures 2 and 3.

The groundwater is discharged to an equalization tank, then filtered through a 5–10-micron size bag filter, and pumped through the two (in series) GAC vessels. The treated groundwater is discharged by gravity to several large recharge chambers in a north-central location of the FTA, upgradient of the recovery well and approximately cross-gradient of the highest levels of PFAS contamination detected at the FTA property. See Fig. 2 for the location of the recharge basins. As appropriate to prevent breakthrough of the PFAS₆ compounds, the GAC is periodically changed out.

GWTS # 2

As noted, the NOR also requested that Barnstable County increase the groundwater recovery and treatment rate to increase PFAS removal from the aquifer. In November 2019, a second, supplemental treatment system was installed, designated as GWTS#2, to treat water from the existing recovery well and better use its extraction capacity. One of the two force mains was re-piped and connected via hose and hard piping to GWTS#2. The system is contained in a mobile structure (former shipping container) and is designed to treat PFAS-impacted groundwater (via adsorption technology with liquid phase granular activated carbon) at a target flow rate of approximately 30 gpm.

Since the inception of treatment for PFAS in 2015, the spent GAC is collected by the supplier, Calgon Carbon Corp., during the changeout procedure and transported to their facility for standard thermal regeneration or destruction. As noted above, the FTA GWPTS uses virgin GAC supplied by Calgon.

Currently, Groundwater Treatment Technologies, LLC (GWTT) is contracted by Barnstable County to provide O&M of the GWTS, including but not limited to bag filter checks and replacements, VFD pump monitoring, carbon vessel backwashing, and GAC replacement oversight.

Additionally, BETA collects monthly samples for PFAS from both systems to check their treatment performance (See section 4.1).

3.3 PHASE I INITIAL SITE INVESTIGATION AND TIER CLASSIFICATION

In May 2018, a Phase I Initial Site Investigation (ISI) Report and Tier Classification Submittal was submitted to MassDEP by BETA (formerly Nover-Armstrong Associates) on behalf of Barnstable County in response to the discovery of concentrations of PFAS compounds in soil and groundwater exceeding applicable USEPA Health Advisory (HA) levels. The Phase I ISI confirmed that the primary contaminant of concern is PFOS and, to a lesser extent, PFOA.

Based on the compiled Phase I Initial Site Investigation data, BETA opined in the Phase I report that continuation of the IRA activities and additional assessment and, potentially, additional remedial Response Actions are warranted at the Disposal Site.

A Phase II Comprehensive Site Assessment Conceptual Scope of Work (SOW) was submitted with the Phase I ISI outlining the scope, nature of investigation, and sample programs proposed to characterize the risk of harm posed to health, safety, public welfare, and the environment (for regulatory closure). The Phase II SOW proposed additional remedial and/or response actions such as continued monitoring of the Site groundwater conditions, potential soil removal or modifications to the existing groundwater treatment system to be implemented in the near future. At a later date, MassDEP indicated that a formal Phase II Comprehensive Site Assessment SOW was required in addition to the Conceptual SOW.

A Tier Classification was submitted to MassDEP concurrently with the Phase I Report. Based on the need to continue remedial actions as IRAs under the current IRA Plan, and on the continuing need to abate a potential Imminent Hazard condition related to impacts to public water supplies, the RTN 4-26179 release was classified as Tier I.

3.4 ENVIRONMENTAL SETTING AND SENSITIVE RECEPTORS

BETA's review of the Massachusetts GIS Priority Resources (21E) mapping (Figure 4) revealed that the Site is located within a Zone II Public Water Supply Protection Area and a Medium-Yield Sole Source Aquifer. The FTA is situated to the west and most likely upgradient of the Mary Dunn public water supply wells 1, 2, and 3 under pumping conditions. Mary Dunn Wells 1, 2, and 3, owned by the Town of Barnstable through the Hyannis Water Supply Division (HWSD) of the Barnstable Department of Public Works (DPW), are located within the preliminary Disposal Site boundary due to the detections of PFAS in the groundwater at those wells. There are no known private potable water wells located within 500 feet of the Site.

Mary Dunn Well 3 (MD-3), which is the nearest public water supply well to the facility, has been documented to pump at an average rate of 380 to 450 gallons per minute (gpm). Mary Dunn Wells 1 and 2 (MD-1 and MD-2) are located approximately 1600 feet and 1800 feet, respectively, southwest of the FTA. These wells have been reported to have been pumped at rates of 400 gpm, each.

Airport Well 1, also owned by HWSD, is located further to the southeast of the Site, south of Mary Dunn Pond. Two other public water supply wells, identified as Barnstable Fire District (BFD) wells BFD-2 and BFD-5, are located to the west and most likely upgradient of the Site. The BFD wells are not operated by or part of the Hyannis Water System.

According to the USGS Topographic Quadrangle – Hyannis, Massachusetts, elevations at the Site are approximately 30 to 50 feet above mean sea level (MSL). Topography of the Site can be categorized as generally flat with slight to moderate slopes downward to the west and southeast, toward Flintrock Pond and Mary Dunn Pond, respectively.

The nearest surface water bodies to the Site are Flintrock Pond and an unnamed Pond; Flintrock Pond is located west adjacent to the FTA and the unnamed Pond is located northeast adjacent to the FTA (as depicted in Figures 2 and 3). A portion of Flintrock Pond is located within the preliminary MCP Disposal Site Boundary based on the detection of PFAS in sediment and surface water. There are no streams or wetlands located at the Site.

3.5 FLINTROCK POND ASSESSMENTS

Per the Order of Conditions: Special Conditions of Approval (SE3-5606), Item 17, the Town of Barnstable Conservation Commission required “new testing results for PFAS in Flintrock Pond.” From November 2019 to October 2020, BETA has conducted surface water and sediment sampling at Flintrock Pond.

Elevated concentrations of the total summed of the five PFAs chemicals (PFOS, PFOA, PFNA, PFHxS, and PFHpA) were documented in the pond sediments and surface water; however, no MassDEP or US EPA regulatory standards or guidelines for sediment and surface water are available for comparison. Later compilations of the PFAS data includes the sixth PFAS compound regulated under the MCP, Perfluorodecanoic Acid (PFDA).

Concentrations of PFAS documented within Pond sediments are dominated by the PFOS and PFHxS compounds and increase with distance from the Pond’s bank. Refer to the previously completed IRA Status Reports submitted to MassDEP for complete information on the assessment to date of Flintrock Pond.

Future Assessment

In response to Commission input and to meet MCP requirements, a comprehensive assessment program for the pond is under development to be implemented during the Phase II CSA. Barnstable County and BETA, in conjunction with Barnstable County dredging department, will install/construct cable crossings of the pond with a means to move a small float or a boat to cross the pond, while systematically obtaining sediment samples from relatively consistent and reproducible locations throughout the Pond. The planned sediment sampling will support the pond’s ecological risk assessment per the requirements of 310 CMR 40.0830 and at 40.0995. The additional sampling, especially spatially, will also support the overall conceptual site model as part of Phase II Site assessment and the selection and implementation of a remedial alternative for the Disposal Site. The proposed program is presented in the recently submitted Public Comment Draft Phase II Comprehensive Site Assessment SOW; see Section 3.8.

3.6 SAMPLING AND ANALYSIS FOR PFAS

Following the collection of aqueous and/or soil samples for the analysis of PFAS compounds, BETA submits all samples to Bureau Veritas Laboratories (BV Labs) (formerly Maxxam Analytical) for the analysis of PFAS via USEPA Method 537 modified.

BV Labs is an accredited laboratory located in Mississauga, Ontario that has performed the PFAS analyses for all samples collected from the Disposal Site since the assessment for PFAS impacts began. BV Labs reports the concentrations of 23 PFAS compounds from aqueous and soil samples with laboratory detection limits as low as 2.0 ng/L (0.002 µg/L). However, for the purposes of achieving the low laboratory detection limits to compare against the MCP GW-1 Standard of 20 ng/L for the monthly performance samples collected at the treatment systems, BV Labs is only able to report 21 PFAS compounds; two of the fluorotelomers are not reported.

Upon receipt of a laboratory report, BETA reviews the concentration data as well as the laboratory case narrative and quality assurance report to ensure no bias is present. BETA summarizes and tabulates the analytical results of six PFAS compounds (PFOS, PFOA, PFNA, PFHxS, PFHpA, and PFDA) based on the MassDEP MCP PFAS risk standards (December 2019). BETA presents the tabulated data and includes the laboratory analytical reports (or Certificates of Analysis) for that reporting period in the monthly IRA Status and RMR reports; the summary data tables, and laboratory analytical reports are included as attachments to these reports.

3.7 PUBLIC INVOLVEMENT

In January 2019, a petition from a group of residents of Barnstable and Hyannis, MA was received, requesting that the Site be designated a Public Involvement Plan (PIP) Site. In response to the request from the local petitioners, Barnstable County designated the Site as a PIP site and began PIP activities in accordance with 310 CMR 40.01404. Notification of the Site Designation and the initial public meeting was provided to all petitioners and the Town of Barnstable officials in writing in February 2019.

On May 2, 2019, a public meeting was held, and a Draft Public Involvement Plan (PIP) was prepared, presented, and distributed. Public comments (as they relate to the response actions implemented for the release of PFAS at the Site and are in accordance with 310 CMR 40.01404) were incorporated into the final Plan, which was finalized on June 27, 2019. See Section 3.8 for information on recent public involvement activities related to the Draft Phase II Comprehensive Site Assessment (CSA) Scope of Work.

3.8 PUBLIC COMMENT DRAFT PHASE II COMPREHENSIVE SITE ASSESSMENT SCOPE OF WORK

As noted in 3.3, MassDEP indicated that a formal Phase II Comprehensive Site Assessment (CSA) SOW was required for the RTN 4-26179 PFAS Release Site. On July 16, 2021, a Public Comment Draft Phase II Comprehensive Site Assessment (CSA) Scope of Work was submitted via eDEP and was made available for public comment on July 20, 2021. The Draft Phase II CSA SOW document described the robust assessment activities proposed to meet the Phase II objectives stated in the MCP at 310 CMR 40.0833. A Public Information Meeting was held virtually on August 18, 2021. Per Section 4.23 of the Final PIP, public comments were accepted on the Draft Phase II CSA SOW until August 26, 2021. Several sets of public comment were received. The significantly revised and expanded Phase II CSA SOW is being finalized at this time. Public comments are being addressed and will be incorporated into the final Phase II CSA as appropriate and feasible.

4.0 HISTORICALLY AND RECENTLY COMPLETED IRA ACTIVITIES

Since the submittal of the IRA Plan in September 2016, remedial response actions and assessment activities have continued to address the PFAS impacts at the Site.

Most notably, the Barnstable County and the Cape Cod Commission implemented response actions to refurbish and re-start a decommissioned groundwater pump and treatment system at the Site in 2015.

Details regarding the refurbishment and initial operation of this pump and treatment system were included in the September 2016 IRA Plan. Following the mobilization and start-up of a second groundwater treatment system in November 2019, the refurbished system has been referred to as GWTS #1 or the primary system in MCP filings.

Barnstable County and the Cape Cod Commission oversaw the excavation of 200 cubic yards of PFAS impacted soils from the former “Hot Spot” area (a 400 square foot area) for off-Site disposal in January 2017. Details regarding the Hot Spot soil removal were included in the January 2017 IRA Status Report.

From December 2018 through February 2019, Barnstable County implemented the regrading and temporary capping of the southwest corner of the FTA, including the former Hot Spot area, with related stormwater controls, termed the Phase I Stormwater Management Improvements/IRA Plan Modification. Additional details regarding the Phase I Stormwater Management Improvements were included in the February 2019 Reporting Period IRA Status No. 27 Report.

In November 2019, the County procured (rented) and started a second treatment system, GWTS #2, in an effort to increase the treatment capacity of groundwater from PRW-4. As a result, groundwater conveyed from PRW-4 was split and re-piped to both GWTS #1 and GWTS #2. Therefore, although there are two treatment systems, they both treat water from one source, recovery well PRW-4. Collectively, the recovery well and the two treatment systems are referred to as the groundwater pump and treatment system (GWPTS).

The following is a summary of the additional continuing and recently completed IRA response actions at the Site. Additional details regarding these IRA response actions can be found in previous IRA Status submittals.

4.1 CONTINUING OPERATION & MAINTENANCE OF GWTS

Cape Cod Commission oversaw and documented the GWPTS performance on behalf of Barnstable County from July 2015 through February 2018. The Cape Cod Commission also conducted groundwater monitoring and oversaw operation and maintenance of the recovery well, PRW-4.

Monthly performance monitoring samples have been collected since GWTS #1 startup in July 2015, from the influent (PRW-4), midpoint, and effluent sample locations. Since November 2019, performance samples have been collected monthly from both GWTS # 1 and GWTS #2.

Periodic monitoring of the system is required to maintain operation of the VFD and recovery well pump including carbon exchanges, regular backwashing of the carbon vessels, force mains cleanouts, and replacement of the recovery well pumps. This work is currently performed by a wastewater treatment system operator, Groundwater Treatment and Technology (GWTT), under contract to the County. Since November 2019, GWTT maintains and operates both GWTS#1 and GWTS#2 systems.

IRA activities related to the operation and maintenance of the GWPTS conducted during earlier reporting periods have been described in detail in previously completed IRA Status Reports submitted to MassDEP. Refer to those submittals for complete information. The previously submitted documents are available in MassDEP Sites Database; refer to the follow link to access these reports.

<https://eeaonline.eea.state.ma.us/portal#!/wastesite/4-0026179>.

On behalf of Barnstable County, BETA has submitted the IRA monthly remedial monitoring reports and status reports summarizing pump and treat system operations for the respective reporting period since March 2018. These submittals have presented a running, summary data table for the PFAS analytical data including the monthly system samples and the respective laboratory analytical report. As noted

previously, the laboratory reports for monthly GWTS performance monitoring provide the results for 21 PFAS compounds in order to allow for lower laboratory reporting limits.

Health Advisories and Regulatory Standards Used for Comparison

During the initial two years of the GWPTS operation (July 2016 through June 2018), the USEPA revised Health Advisory (HA) of 0.070 µg/L for two PFAS chemicals, Perfluorooctanoic acid (PFOA) and Perfluorooctanesulfonic acid (PFOS), was used for comparison to the analytical results of GWPTS performance samples. The HA (revised downward to 0.070 µg/L in July 2016) applied to each compound individually or for the total concentration of the two (PFOS and PFOA). Subsequently, MassDEP adopted the USEPA HA. The USEPA considers its HA to still be in effect. However, for MCP purposes it has been superseded by MassDEP guidelines and regulatory actions.

On June 11, 2018, MassDEP's Office of Research and Standards (ORS) issued an updated ORS Guideline/HA that applied to the individual concentrations, or the total summed of five PFAS chemicals: PFOS, PFOA, Perfluorononanoic Acid (PFNA), Perfluorohexanesulfonic Acid (PFHxS), and Perfluoroheptanoic Acid (PFHpA). From June 11, 2018, until December 2019, individual concentrations of any of these five compounds or the total concentrations of all were compared to the MassDEP ORS HA of 0.070 µg/L.

On April 19, 2019, MassDEP released the Public Comment Draft of proposed revisions to the MCP, which included proposed Method 1 groundwater risk standards for the five PFAS compounds, plus an additional PFAS compound, Perfluorodecanoic Acid (PFDA). A Method 1 GW-1 risk standard of 0.020 µg/L was proposed for the individual concentrations of any of these six compounds or the total concentrations of all six. In December 2019, MassDEP published final MCP Method 1 risk standards for the PFAS6 compounds with an effective implementation date of December 27, 2019. From May 2019 through the current reporting period, tabulated treatment system analytical results have been compared to the six regulated PFAS compounds. The final MCP PFAS risk standards for groundwater include the 6 PFAS compounds of concern (PFAS6) listed above and the 0.020 µg/L¹ which is the GW-1 numerical risk standard for each compound or for the total of the PFAS6. These MCP risk standards are included in all relevant tables in the monthly and quarterly monitoring reports.

Except where noted (due to older data), total PFAS concentrations reported and discussed in this report are the sum of concentrations of the PFAS6 compounds included in the final MCP risk standards of December 27, 2019.

4.2 CURRENT OPERATION & MAINTENANCE OF GWPT SYSTEM

During the January 2022 reporting period, the primary treatment system (GWTS #1) and secondary system (GWTS #2) were in operation for approximately 29 days. On January 29, 2022, due to inclement winter weather, the Site lost power and subsequently the systems shutdown. Power to the systems was restored on February 1, 2022. On January 25, 2022, BETA collected performance samples from both GWTS #1 and GWTS #2 systems prior to the system shutdown and both were in operation at the time of sample collection.

¹ Concentrations of PFAS are presented in the data tables of this report in nanograms per liter (ng/L), also referred to as parts per trillion (ppt) and are reported by the laboratory in those units. However the published MCP Method GW-1 numerical risk standards for PFAS compounds (PFOS, PFOA, PFNA, PFHpA, PFHxS, and PFDA) are in presented in or micrograms per liter (µg/L), also referred to as parts per billion (ppb). In the relevant sections of this report, results are shown in both units.

4.2.1 REMEDIAL MONITORING REPORT – GWTS #1

GWTS # 1 System Monitoring Results

As noted, system samples were collected on January 25, 2022, from the Influent (PRW-4), Midpoint and Effluent ports and were submitted to Bureau Veritas Laboratories (formerly Maxxam Analytics) of Mississauga, Ontario (Bureau Veritas) for the laboratory analysis of Total PFAS via USEPA Method 537 M. For the analysis of the treatment system performance samples, Bureau Veritas uses a low-level detection variant of the US EPA 537M to achieve the lowest method detection limits (MDLs) and reportable detection limits (RDLs) to allow for comparison to the MCP Method 1 GW-1 risk standards. This method provides RDLs in the range of 2 to 4 ng/L and MDLs below 1 ng/L for the list of PFAS analytes reported by the laboratory. Bureau Veritas reports the results for 21 PFAS compounds, including two (2) PFAS precursor fluorotelomers. Details are presented in the laboratory report.

Refer to the attached Table 1A, for a summary of the GWTS #1 PFAS analytical data. The complete laboratory report is attached in Appendix B.

Recovery well PRW-4 is the source of the Influent groundwater. The total sum of the six Massachusetts regulated PFAS (PFAS6) concentrations in the Influent (PRW-4) sample was 795.5 ng/L (0.796 µg/L), well above the GW-1 risk standards. However, the total PFAS6 concentrations in the Influent has continued in a downward trend since November 2020. Five of the six regulated PFAS compounds were detected at concentrations exceeding the MCP GW-1 risk standard (0.020 µg/l); PFDA was detected at a concentration below the MCP GW-1 standard. Based on the splitting of flow from PRW-4 to both groundwater treatment systems, the Influent analytical results apply to GWTS #2, as well as GWTS #1.

The PFAS6 compounds were detected at concentrations above the laboratory reporting limits in the January 2022 Midpoint; three of the PFAS6 compounds, PFOS, PFHxS, and PFHpA, were detected at concentrations above the GW-1 risk standard. The sum of the PFAS6 compounds (from this Midpoint sample) was 351 ng/L, well above the GW-1 risk standard and indicating PFAS breakthrough of GAC vessel #1.

The PFAS6 compounds were not detected in the Effluent sample above the laboratory reporting limits, which were sufficiently low to allow for comparison to the GW-1 risk standard. Furthermore, the remaining 15 PFAS compounds reported in the full laboratory report were below the laboratory's method detection limits (MDLs) in the Effluent sample; the MDLs ranged from ___ to ___ ng/l. Refer to the Table 1A and the complete laboratory report in Appendix B for the concentrations of the remaining unregulated PFAS compounds as well as the laboratory RDLs and MDLs.

GWTS #1 Operational Details

The attached Table 2A presents the GWTS #1 performance data. As presented on Table 2A, the system was off from January 29 to January 31 (For the January 2022 reporting period) due to loss of power from inclement weather on January 29, 2022. Therefore, the system was operational for approximately 29 days during the January 2022 reporting period.

The combined estimated, instantaneous Influent flow rates (for both systems) ranged from approximately 53.6 gpm to 45.1 gpm (the approximate average instantaneous flow rate for both systems)). Due to the method used to estimate the instantaneous influent flow rate (timing of rise of groundwater in the GWTS #1 Equalization Tank with both force mains discharging to it), the estimated influent flow rates noted above and on Table 2A (shown in the Combined Instantaneous Estimated Flow Rate column) apply to both systems, combined.

Therefore, during the normal mode of operation, with the flow from each force main flowing to only one system, it is assumed that roughly 50% of the instantaneous influent rates stated above actually flows to GWTS #1 for treatment. Those values are shown on Table 2A in the Estimated Instantaneous Flow Rate column.

As noted, the average Estimated Instantaneous Influent Flow Rate for GWTS #1 alone was approximately 24.6 gpm. The Instantaneous Influent Flow Rates are indicative of the output of PRW-4 and conveyance capacity of the influent force mains from the well to the treatment systems.

For the January 2022 reporting period, the overall (average) system flow rate and gallons of groundwater treated are based on the Effluent flow meter/totalizer readings reported for the system. On this basis, approximately 0.403 million gallons of groundwater were treated during this January 2022 reporting period, at an average effluent flow rate of 9.7 gpm. Based on the approximate 0.403 million gallons treated and total influent concentration of 795.5 ng/L (January 2022 sample results), approximately 0.0012 kilograms of PFAS were estimated to have been removed from the groundwater by GWTS #1 during this reporting period.

The average Effluent flow rates for the reporting period are low compared to typical months; the lower flow rates reflect the reduced effluent pumping rate set at the main transfer pump in response to the leaking of treated water from the above-ground (exterior) cleanout on the Effluent gravity drain. The leaking observed indicated potential pipe damage and back up of flow in the drain. In response, the O&M contractor (GWTT) in consultation with BETA and the County reduced the speed of the transfer pump, thus reducing the treatment system flow rate.

After significant scheduling delays due to a work backlog, a pipe cleaning/jetting contractor was able to visit the Site on January 25, 2022. The contractor conveyed a camera through the effluent piping and determined that there was no visible damage or blockage within the piping. The contractor noted some slight settling along approximately 57 feet of the piping located north of the GWTS#1 building. Although backup was observed within the clean out drainage piping, it did not overflow. As a result, the County, BETA, and GWTT agreed to increase the instantaneous effluent flow rate at GWTS#1 up to approximately 40 gpm on January 25, 2022. GWTT will continue to monitor the system's effluent drainage piping in the event overflow begins again and to determine the cause of the backup or build-up of backpressure.

4.2.2 REMEDIAL MONITORING REPORT – GWPTS #2

GWTS # 2 Monitoring Results

As previously mentioned, BETA collected performance samples from GWTS #2 system on January 25. Samples collected from the Influent (PRW-4), Midpoint, and Effluent ports were submitted to Bureau Veritas for the laboratory analysis of Total PFAS via USEPA Method 537 M. As noted above, recovery well PRW-4 is the source of the Influent groundwater to both groundwater treatment systems. Therefore, the Influent analytical results apply to GWTS #2, as well as GWTS #1.

The attached Table 1B, summarizes the GWTS #2 PFAS analytical data. The complete laboratory report is attached in Appendix B.

As previously mentioned, the tabulated treatment system analytical results from GWTS #2 are reported and compared to the PFAS6 compounds and their respective MCP Method 1 GW-1 Standards. The total sum of the six PFAS concentrations in the Influent sample was 795.5 ng/L (0.796 µg/L), well above the GW-1 risk standards. Five of the six regulated PFAS compounds were detected at concentrations exceeding the new MCP GW-1 risk standard (0.020 µg/l or 20 ng/L).

The PFAS6 compounds were detected at concentrations above the laboratory reporting limits in this January 2022 Midpoint sample; four of the PFAS6 compounds, PFOS, PFOA, PFHxS, and PFHpA, were detected at concentrations above the GW-1 risk standard. The sum of the PFAS6 compounds (from this Midpoint sample) was 718.6 ng/L, well above the GW-1 risk standard and indicating PFAS breakthrough of carbon in vessel #1.

The PFAS6 compounds were detected in the Effluent sample above the laboratory reporting limits and well above the applicable GW-1 risk standards (740.8 ng/L), thus indicating that full breakthrough of the carbon had occurred within the system. Upon receipt of these results, BETA informed the system operator to shut down GWTS#2 until a carbon change can be achieved. The results were not received until after the January 2022 reporting period; the shutdown will be discussed in the next status and RMR report for the system. These results are summarized in Table 1B and a copy of the laboratory report is in Appendix B.

GWTS #2 Operational Details

The attached Table 2B summarizes the GWTS #2 performance details. The system was off from January 29 to January 31 (For the January 2022 reporting period) due to loss of power from inclement weather on January 29, 2022. Therefore, the system was operational for approximately 29 days during the January 2022 reporting period.

As described in previous sections, during the normal mode of operation, with the flow from each force main flowing to only one system, it is assumed that roughly 50% of the instantaneous influent rates discussed above for GWTS #1 actually flows to GWTS #2 for treatment. Based on that assumption, for the January 2022 reporting period, the calculated average estimated instantaneous flow rate for GWTS #2 was approximately 24.6 gpm. As noted in the GWTS #1 performance review above, during this reporting period, the instantaneous influent flow rates (total to both systems) remained fairly consistent.

The overall (average) system flow rate and gallons of groundwater treated were based on the Effluent Flow Rate/net totalizer readings reported for the system by the GWTT; approximately 0.379 million gallons of groundwater were estimated to be treated during this reporting period for November 2021, at an approximate Average Effluent Flow Rate of 9.1 gpm. Effluent flow rates and gallons of groundwater treated are considerably lower than expected in comparison to the increase in influent flow rates. As discussed in 4.2.2, the treatment/flow rate of GWTS #1 had to be turned down significantly in response to leaking and backup in the effluent drain. This resulted in GWTS #1 not able to meet the demand of the increased influent flow rates from the pump at PRW-4 (after rehabilitation in November 2021). As a result, the high-level alarm in the GWTS #1 EQ tank is triggered more frequently. This alarm shuts off the pump at PRW-4 that conveys groundwater to both GWTS#1 and GWTS#2. The pump remains off until GWTS #1 can drawdown the volume retained in the EQ tank. During the reporting period, this drawdown took longer than in other periods because of the intentionally reduced treatment rate. This mismatch between influent and effluent flow rates in GWTS #1 and the control system setup also resulted in a significant reduction in influent to and average treatment rate (Effluent Rate) through GWTS #2.

Based on 0.379 million gallons treated, approximately 0.0011 kilograms of PFAS were estimated to have been removed from the groundwater during this reporting period.

4.2.3 REMEDIAL MONITORING REPORT SUMMARY

During the January 2022 reporting period, the two treatment systems, GWTS #1 and GWTS #2, were in operation for all or portions of at least 29 days. The overall (average) system flow rate and gallons of groundwater treated are based on the available Effluent flow totalizer readings for both systems.

For the reporting period from January 1 to January 31, 2022, both systems treated an approximate combined 0.78 million gallons of groundwater from the downgradient recovery well PRW-4 at an average, total (of the two systems) effluent flow rate of 18.73 gpm.

Based on 0.78 million gallons treated, approximately 0.002 kilograms of PFAS were estimated to have been removed from the groundwater during this January 2022 reporting period.

Figure 5 depicts the concentration trends observed in groundwater at the extraction well PRW-4, as measured as the Influent to the groundwater treatment systems. In addition, the Midpoint concentrations for GWTS #1 are graphed. Due to the nature of the laboratory data reported since 2015, this graph depicts the total of the PFOS and PFOA compounds only. Following a spike in concentrations in mid-2019, PFOS and PFOA concentrations have generally decreased or remained relatively stable at PRW-4. The detected concentrations remain elevated relative to the GW-1 risk standards.

4.3 QUARTERLY GROUNDWATER MONITORING

Groundwater monitoring activities related to the documented PFAS Release on Site have been ongoing since November 2013. BETA, formerly Nover-Armstrong Associates, was contracted by Barnstable County to provide LSP and environmental services in April 2018 and has conducted groundwater monitoring activities since June 2018.

In November 2018, BETA proposed a long-term monitoring sampling plan for Site-wide groundwater monitoring on a quarterly and annual basis. Following discussion, MassDEP approved of the sampling plan that included sampling of twelve (12) wells during three quarterly sampling events and sampling an additional eight (8) wells (for a total of twenty (20) during the annual sampling round.

A copy of the plan can be found in previous IRA Status report submittals, including IRA Status Report and RMR No. 35 for the October 2019 reporting period. Additional monitoring points are added to either the quarterly or annual sampling round, as warranted to meet specific objectives or provide additional coverage.

BETA has conducted quarterly groundwater assessments since January 2019 under the approved program. The January 2019 event was selected as the original annual monitoring program for 2019 utilizing the selected 20 monitoring wells. In order to support the design of the proposed groundwater recovery expansion (an IRA Plan Modification), it was decided to move the annual monitoring round up to October 2019, and to add several wells to the sampling program. Since that time, the expanded annual list of monitoring wells has been sampled in October or November.

4.3.1 JANUARY 2022 SITE-WIDE QUARTERLY GROUNDWATER SAMPLING AND ANALYSIS

From January 25 to 26, 2022, BETA conducted a quarterly groundwater monitoring event based on the MassDEP approved sampling plan. A total of 13 monitoring wells were sampled for the laboratory analysis of total PFAS by EPA Method 537 Modified. On those dates the following monitoring wells were sampled: HSW-6, PFW-1, PFW-5, OW-8A, PC-1, PC-6A, PC-11, PC-16d, PC-28, PC-30, PC-38, MW-12S, and MW-22. Figure 2 and Figure 3 depict sampling locations.

Monitoring wells located within the immediate vicinity of the FTA property were gauged prior to sampling. Groundwater gauging data and groundwater elevation data are included in Table 3, appended.

Monitoring wells HSW-6, PFW-1, PFW-5, OW-8A, are located on the FTA property; HSW-6 is located within the former Hot Spot remediation area and PFW-1 is located downgradient of the former Hot Spot remediation area. PFW-5 and OW-8a are located cross-gradient of the Hot Spot area on the FTA property. Monitoring well PC-38 is located approximately 750 feet southeast of the FTA property.

The downgradient monitoring wells (MW-12S, MW-22, PC-1, PC-11, and PC-6A), located between the FTA and the recovery well (PRW-4), were selected based on previous results to evaluate current conditions within the main PFAS plume.

Monitoring wells PC-16d, PC-28, PC-30, are located in the probable downgradient direction from recovery well PRW-4.

The PFAS analytical data for the most recent January 2022 sampling round are included in Table 4A. A copy of the laboratory report/certificate of analysis for the (January 2022) sampling event is included in Appendix B. The laboratory report in Appendix B presents all analytical results for all reported PFAS compounds, including laboratory detection and reporting limits. As previously discussed, effective December 27, 2019, MCP groundwater risk standards for 6 PFAS compounds, (PFOS, PFOA, PFHpA, PFNA, PFHxS, and PFDA) apply to the Site with a GW-1 risk standard of 20 ng/l for the total and/or any single compound. These risk standards are included on Table 4A and Table 4B.

Individual concentrations of (one or more) regulated PFAS6 compounds and Total Concentrations of the PFAS6 detected in the samples from the January 2022 sampling event were above the MCP GW-1 risk standards, except at PC-38. As noted, the results for the additional 17, unregulated PFAS compounds reported by the laboratory are included in the attached laboratory report (Appendix B).

Table 4A and 4B summarizes the sampling dates and PFAS6 concentrations detected during all sampling events at the Site. All previous laboratory reports were included with previously submitted status reports. Overall, PFAS concentrations detected in groundwater during the January 2022 quarterly round of groundwater assessment are similar to historic ranges. Although the total PFAS6 concentrations documented in groundwater are significantly above the current, applicable MCP Method 1 risk standards, concentrations have trended towards a significant decrease in some areas of the Site since PFAS assessment activities started in 2015, especially in the Hot Spot/ Phase 1 cap area. To date, assessment at the Site has revealed PFAS contamination within shallow soils and the immediate vadose zone. Exceptions to the general trend are discussed below.

BETA's review of the January 2022 groundwater data compared to historic sampling events indicate that concentrations of PFAS documented in groundwater within the Disposal Site are primarily decreasing or relatively stable; however, there are some exceptions.

Figures 6 through 9, attached and discussed below, are graphical presentations of total (sum of) PFAS6 concentrations for selected monitoring wells in representative locations across the Disposal Site. It should be noted that the graphs depict discrete periodic sampling events at varying intervals from initial sampling in April 2015 and at quarterly intervals (typically) since January 2019. In addition, due to the range of PFAS concentrations, the graphs have different scales on the vertical axes for PFAS concentrations.

Figure 6 depicts the concentration trends observed in groundwater at monitoring well PFW-1. Since the implementation of the Phase I stormwater improvements during the winter of 2018/2019, which included installing an impermeable cap over the former Hot Spot removal area and adjacent areas and diverting stormwater, PFAS concentrations have generally decreased significantly through mid-to late-2019 and have since remained relatively steady at elevated levels relative to the GW-1 risk standards. A slight increase in concentrations was observed from the July 2021 sampling event to this January 2022 sampling event. This fluctuation appears to be within the range established since July 2020. The recent fluctuation may be due to building demolition and the preparation for the cap in August through October 2021. The former live fire training buildings were demolished in relatively close proximity to PFW-1 and all facility equipment and apparatus were removed from the area that PFW-1 is located in. During construction the area was regraded for the installation of hot mixed asphalt pavement.

Figure 7 depicts the significantly downward trend of PFAS6 concentrations observed in groundwater monitoring well OW-8A, through the October 2020 quarterly sampling event; since October 2020 concentration trends have varied. A noticeable increase in PFAS6 concentrations from the October 2020 to the January 2021 sampling event was observed; subsequently, PFAS6 concentrations in OW-8A were detected at least 700 ppt less than concentrations observed from January 2021 to July 2021. A significant spike in PFAS6 concentrations was detected in the November 3, 2021 sample. Although the cause of these fluctuations is not known, it is BETA's opinion that variable precipitation amounts may be influencing the concentration shifts. Lower concentration amounts may be attributed to lower-than-average precipitation rates. The concentration spikes observed in the November 2021 event may be attributed to significantly increased precipitation that fell from September to October 2021 (before paving was completed) or possibly to disruption related to Site demolition and capping. The PFAS6 concentrations in the January 2022 sample decreased significantly to within the previously observed range, which may be attributed to the completion of the cap in early November 2021.

PFAS concentrations documented in wells MW-12 and MW-22, which are located between the FTA and recovery well PRW-4, have continued to exhibit relatively stable concentration trends. These trends are depicted in Figure 8.

PFAS concentrations documented in wells located farther southeast and downgradient of the FTA, specifically PC-6A, PC-11, PC-28, PC-16D, and PC-30, have long term variable trends. Figures 9A, 9B, 9C and 9D depict PFAS concentration trends in PC-6A, PC-11, PC-28, and PC-30 respectively.

PC-6A (Fig 9A) shows variable concentrations; however, concentrations observed since the spring of 2019 have been relatively stable with a relative decreasing trend.

As depicted on Figure 9B, groundwater concentrations at PC-11 have been relatively stable since the significantly decreasing after October 2020.

Groundwater concentrations at PC-28 are depicted on Figure 9C; concentrations were significantly higher in October 2020 and January 2021 than previously detected. Since July 2021, detected PFAS6 concentrations have been trending around 1,000 ng/l. However, PFAS6 concentrations were significantly lower in the November 2021 sample.

As shown on Figure 9D, since February 2020, PFAS6 concentrations at PC-30 have exhibited an overall decreasing trend.

Monitoring well PC-38, the furthest south-southeast location sampled during this quarterly monitoring event, did not exhibit PFAS6 concentrations above the laboratory reporting limits. Groundwater sampled from PC-38 since April 2017 has only had a few detectable concentrations of PFAS6 documented.

Utilizing the total sum of the six regulated PFAS compounds, concentration data were interpolated to depict an approximate concentration plume map based on the January 2022 monitoring results. Figure 10 depicts the concentration plume for the January 2022 monitoring results; the highest concentrations within the PFAS contaminant plume appear to be concentrated south and east and within approximately 200 feet of the FTA and in the vicinity of PRW-4. The lowest concentrations (below the Method 1 GW-1 standards) are on the outer northeastern and southeastern edges of the plume.

4.3.2 SITE-WIDE GROUNDWATER GAUGING AND ELEVATION SURVEY

BETA gauged depth to groundwater in the monitoring wells located on and within 100 feet of the FTA and in selected monitoring wells east and southeast of the FTA on January 25, 2022. Table 3 presents a tabulated summary of the seasonal groundwater elevation data (from 2018-2022) for selected monitoring points across the Disposal Site.

Groundwater flow has historically been inferred to be to the south-southeasterly from the former FTA. Refer to Figure 11 for a depiction of the calculated groundwater elevation contours from the January 2022 gauging event. This 2022 data indicate a continuation of the historic pattern near the FTA but a more easterly flow pattern away from the facility. The gauging results indicate moderate influence from the operating recovery well, PRW-4. Groundwater elevations near and across the power line easement exhibit an erratic pattern; the cause or causes of this pattern are unknown.

5.0 SITE WIDE CAPPING AND SELECT BUILDING DEMOLITION

In response to a directive from MassDEP, an IRA Plan Modification was finalized in December 2019 and design plans for Sitewide capping were submitted for approval to the Town of Barnstable via a Notice of Intent in February 2020. Final design approval and an Order of Conditions was obtained in November 2020 and January 2021 respectively. IRA Plan Modification No. 3 was also finalized in June 2021 to include selected building demolition into the project. The County received bids for the project in April 2021. The capping project was awarded in July 2021.

Construction began in August 2021 and was substantially completed in October 2021. The former live fire training buildings and other fire training props and features were demolished and removed from Site. Approximately 650 tons of PFAS contaminated demolition debris and materials associated with these structures were transported to and disposed of at the US Ecology / Wayne Disposal, Inc. disposal facility in Belleville, MI in September 2021. Approximately 59,000 square feet (SF) of unpaved portions of the FTA were capped with 3.5-inches of hot mix asphalt pavement following installation of a stormwater management system and regrading of the facility. Additional details, photographic documentation of the completed cap, and waste disposal documentation were provided in IRA Status Report No. 60 for the November 2021 reporting period.

6.0 IRA EVALUATION

In accordance with the MCP, this section presents evaluations of potential IRA conditions at the Site.

6.1 ASSESSMENT FOR SUBSTANTIAL RELEASE MIGRATION (SRM)

Due to the documentation that PFAS has most likely migrated more than 200 feet downgradient and has been detected in a public water supply well and surface water body, the Site meets the criteria for a Condition of Substantial Release Migration (SRM), as defined by 310 CMR 40.0006.

6.2 IDENTIFICATION OF CRITICAL EXPOSURE PATHWAYS (CEP)

No Critical Exposure Pathways, as defined by 310 CMR 40.0006, currently exist at the Disposal Site.

6.3 IMMINENT HAZARD (IH) EVALUATION

Based on the concentrations of PFOS exceeding the USEPA HA level in the Mary Dunn wells in 2013, the Cape Cod Commission identified the presence of an Imminent Hazard (IH) condition pursuant to 310 CMR 40.0321(2)(c).

The GAC treatment of the Mary Dunn Wells has been assumed to be actively preventing a potential Imminent Hazard to the Hyannis community by removing the PFAS compounds from the water supply.

The Mary Dunn wells are monitored on a regular basis by the Hyannis Water Department to ensure that exposure to humans is less than the USEPA HA, the MassDEP Drinking Water Standards effective on December 27, 2019 and the finalized MassDEP MCL (MMCL) standard. MassDEP finalized the MMCLs for PFAS in January 2021; the final MCL for PFAS in drinking water is 20 ng/l and applies to the 6 regulated PFAS compounds.

6.4 ASSESSMENT OF NEED FOR IMMEDIATE RESPONSE ACTIONS (IRA)

The operation of the on-Site groundwater pumping and treatment system to reduce PFAS concentrations downgradient of the FTA will continue as an IRA. Continuation of assessment IRAs is warranted; specifically, periodic monitoring of groundwater at the Site and monitoring the PFAS treatment of the output of the Hyannis Water District/Town of Barnstable operated Mary Dunn Wells.

However, Site-wide assessment will also be proceeding under the Phase II Comprehensive Site Assessment (CSA) Scope of Work (SOW); the SOW was submitted for public comment. The County and BETA are in the process of finalizing the Phase II CSA SOW. Additional technologies to treat / remove PFAS from soil and groundwater at the FTA will be evaluated as part of the MCP Phase III evaluation of remedial alternatives.

In addition, planned expansion of groundwater extraction and treatment, as mandated by MassDEP, was described conceptually in the final December 2019 IRA Plan Modification. The final design and implementation of that component of the IRA Plan Modification is being re-evaluated in terms of feasibility of implementation as an IRA and potential overlap and duplication with MCP Phase III and Phase IV (remedy implementation) work to be conducted immediately following the completion of the Phase II CSA.

7.0 PUBLIC NOTIFICATIONS

Copies of public notification letters regarding the proposed IRA activities sent to officials of the Town of Barnstable in accordance with MCP 310 CMR 40.1403(3) (a) requirements are included as Appendix C. Per the Final PIP, email and written notifications regarding the submittal of this IRA Plan Modification to MassDEP and the availability of the Plan at the Site repository will be sent to those listed on the PIP Mailing List.

As previously mentioned, MassDEP communicated to the County and BETA that based on the current project status, monthly submissions of IRA status and remedial monitoring reports (RMR) would no longer be required. Upon further discussion with MassDEP, it was established that a six-month submittal schedule for IRA Status and RMR reports will be acceptable. This IRA Status RMR-No. 62 for the January 2022 reporting period will be the first report submission within this new schedule.

However, quarterly updates regarding clean up and remediation activities of the PFAS release at the Site will be provided to the public, more specifically those listed on the Public Involvement mailing list. These updates will be in the form of written notices and/or public meetings.

Written correspondence will be sent to those listed on the PI Mailing List notifying them of the submission of this IRA Status report and availability of this report for review.

TABLES

Table 1A - Summary of Groundwater Pump and Treatment System Total PFAs Analytical Data - GWTS #1
Barnstable County Fire and Rescue Training Academy
155 Flint Rock Road, Barnstable, MA
RTN 4-26179

SAMPLE ID	INFLUENT (PRW-4)							MIDPOINT							EFFLUENT						
USEPA Method 537.2	PFOS (ng/L)	PFOA (ng/L)	PFNA (ng/L)	PFHxS (ng/L)	PFHpA (ng/L)	PFDA (ng/L)		PFOS (ng/L)	PFOA (ng/L)	PFNA (ng/L)	PFHxS (ng/L)	PFHpA (ng/L)	PFDA (ng/L)		PFOS (ng/L)	PFOA (ng/L)	PFNA (ng/L)	PFHxS (ng/L)	PFHpA (ng/L)	PFDA (ng/L)	
MCP Method 1 GW-1 Standard ³	20 ng/L							20 ng/L							20 ng/L						
SAMPLE DATE																					
4/1/2015	760	60	-- ^A	-- ^A	-- ^A	-- ^A	--	--	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	--	--	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
7/17/2015	5600	460	-- ^A	-- ^A	-- ^A	-- ^A	--	--	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	--	--	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
8/4/2015	5900	550	-- ^A	-- ^A	-- ^A	-- ^A	--	--	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	--	--	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
9/30/2015	17000	840	-- ^A	-- ^A	-- ^A	-- ^A	--	--	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	--	--	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
10/15/2015	9900	560	-- ^A	-- ^A	-- ^A	-- ^A	BRL (<9.4)	BRL (<5.3)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	9.4	BRL (<5.8)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
11/12/2015	9000	BRL (<2000)	-- ^A	-- ^A	-- ^A	-- ^A	BRL (<3.3)	--	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	--	--	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
1/6/2016	7600	260	-- ^A	-- ^A	-- ^A	-- ^A	120	75	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	--	--	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
1/21/2016	5200	160	-- ^A	-- ^A	-- ^A	-- ^A	270	16	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	--	--	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
2/3/2016	3500	140	-- ^A	-- ^A	-- ^A	-- ^A	540	26	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	--	--	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
2/17/2016	4500	140	-- ^A	-- ^A	-- ^A	-- ^A	520	24	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	--	--	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
3/8/2016	3700	140	-- ^A	-- ^A	-- ^A	-- ^A	420	19	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	BRL (<3.3)	BRL (<5.3)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
3/23/2016	5000	150	-- ^A	-- ^A	-- ^A	-- ^A	650	39	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	BRL (<3.3)	BRL (<5.3)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
4/14/2016	4800	140	-- ^A	-- ^A	-- ^A	-- ^A	610	26	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	BRL (<3.3)	BRL (<5.3)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
4/28/2016	6300	BRL (<200)	-- ^A	-- ^A	-- ^A	-- ^A	--	--	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	BRL (<20)	BRL (<20)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
5/12/2016	6800	BRL (<200)	-- ^A	-- ^A	-- ^A	-- ^A	--	--	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	BRL (<20)	BRL (<20)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
5/25/2016	6900	BRL (<210)	-- ^A	-- ^A	-- ^A	-- ^A	--	--	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	BRL (<3.3)	BRL (<5.3)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
6/16/2016	7800	160	-- ^A	-- ^A	-- ^A	-- ^A	--	--	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	BRL (<3.3)	BRL (<5.3)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
7/6/2016	7600	270	-- ^A	-- ^A	-- ^A	-- ^A	--	--	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	10	BRL (<5.3)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
8/11/2016	13000	160	-- ^A	-- ^A	-- ^A	-- ^A	1600	54	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	BRL (<3.3)	BRL (<5.3)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
Carbon change conducted after sample collection on 08/11/16.																					
8/18/2016	9500	210	-- ^A	-- ^A	-- ^A	-- ^A	BRL (<3.3)	BRL (<5.3)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	BRL (<3.3)	BRL (<5.3)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
9/8/2016	9500	190	-- ^A	-- ^A	-- ^A	-- ^A	8.5	5.3	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	BRL (<3.3)	BRL (<5.3)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
9/8/2016	9500	190	-- ^A	-- ^A	-- ^A	-- ^A	8.5	5.3	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	BRL (<3.3)	BRL (<5.3)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
10/6/2016	17000	250	-- ^A	-- ^A	-- ^A	-- ^A	110	8.3	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	BRL (<3.3)	BRL (<5.3)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
10/20/2016	7200	130	-- ^A	-- ^A	-- ^A	-- ^A	1000	BRL (<5.3)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	BRL (<3.3)	BRL (<5.3)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
11/3/2016	7900	110	-- ^A	-- ^A	-- ^A	-- ^A	13.8	BRL (<5.3)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	BRL (<3.3)	BRL (<5.3)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
11/17/2016	5400	99	-- ^A	-- ^A	-- ^A	-- ^A	1200	NA	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	17	NA	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
12/1/2016	5300	100	-- ^A	-- ^A	-- ^A	-- ^A	400	14	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	--	--	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
12/14/2016	5700	95	-- ^A	-- ^A	-- ^A	-- ^A	82	BRL (<5.3)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	8.1	BRL (<5.3)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
1/4/2017	4900	95	-- ^A	-- ^A	-- ^A	-- ^A	360	15	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	BRL (<3.3)	BRL (<5.3)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
2/16/2017	2800	88	-- ^A	-- ^A	-- ^A	-- ^A	1000	39	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	25	BRL (<5.3)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
3/1/2017	3700	120	-- ^A	-- ^A	-- ^A	-- ^A	1400	47	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	150	6.5	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
3/23/2017	3800	87	-- ^A	-- ^A	-- ^A	-- ^A	2000	71	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	160	9.5	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
5/3/2017	2400	86	-- ^A	-- ^A	-- ^A	-- ^A	--	--	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	BRL (<2.6)	BRL (<4.6)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
Carbon change conducted on 04/13/17.																					
4/19/2017	3200	110	-- ^A	-- ^A	-- ^A	-- ^A	160	BRL (<4.6)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	BRL (<2.6)	BRL (<4.6)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
5/18/2017	3000	110	-- ^A	-- ^A	-- ^A	-- ^A	570	32	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	BRL (<2.6)	BRL (<4.6)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
6/1/2017	3200	110	-- ^A	-- ^A	-- ^A	-- ^A	730	33	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	4.1	BRL (<4.6)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
6/27/2017	2600	99	-- ^A	-- ^A	-- ^A	-- ^A	--	--	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	210	15	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
7/18/2017	3500	97	-- ^A	-- ^A	-- ^A	-- ^A	2300	72	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	49	25	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
Carbon change conducted on 8/09/17																					
8/16/2017	3000	110	-- ^A	-- ^A	-- ^A	-- ^A	BRL (<2.3)	BRL (<4.1)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	BRL (<2.3)	BRL (<4.1)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
8/28/2017	2900	100	-- ^A	-- ^A	-- ^A	-- ^A	27	BRL (<20)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	--	--	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
10/2/2017	3200	85	-- ^A	-- ^A	-- ^A	-- ^A	510	25	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	BRL (<2.6)	BRL (<4.6)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
10/12/2017	4500	110	-- ^A	-- ^A	-- ^A	-- ^A	960	29	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	BRL (<2.6)	BRL (<4.6)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
11/9/2017	2400	77	-- ^A	-- ^A	-- ^A	-- ^A	--	--	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	BRL (<6.0)	BRL (<3.3)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
11/20/2017	2000	64	-- ^A	-- ^A	-- ^A	-- ^A	520	15	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	BRL (<6.0)	BRL (<3.3)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
12/7/2017	1600	64	-- ^A	-- ^A	-- ^A	-- ^A	780	34	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	11	BRL (<3.3)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
2/5/2018	2100	27	-- ^A	-- ^A	-- ^A	-- ^A	390	13	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	BRL (<6.0)	BRL (<3.3)	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A	
2/14/2018	2100	30	-- ^A	-- ^A	-- ^A	-- ^A	850	27	-- ^A	-- ^A	-- ^A	-- ^A	-- ^A								

Table 2A - Summary of Groundwater Pump and Treatment System Operating and Maintenance Data - System No. 1 (GWTS #1)
Barnstable County Fire and Rescue Training Academy
155 First Rock Road Barnstable, MA
01914-26178

Date	Operator	System Operating on Arrival	Influent Bag Filter Differential Pressure (psi) *		Pre-Filter Changeout Differential Pressure (psi)		Post-Filter Changeout Differential Pressure (psi)		6" Influent Tank Fill Rate (min)		Influent		Day System Operating		Instant Effluent Flow Rate (GPM)		Instantaneous Effluent Flow Rate (GPM)		Totalizer (Gal)		Net Gallons Treated		Average Effluent Flow Rate (GPM)		Estimated Total PFAs Removal (kg)		System Operating on Departure	System Sampled	Comments		
			Pre	Post	Gauge P1	Gauge P2	Gauge P1	Gauge P2			Combined Instantaneous Estimated Influent Flow Rate (GPM)	Estimated Instantaneous Influent Flow Rate (GPM)			Instant Effluent Flow Rate (GPM)	Instantaneous Effluent Flow Rate (GPM)															
4/9/2018	CE	No	75	NA	NA	NA	75	NA	NA	NA	NA	0	--	--	--	--	--	--	--	--	--	--	--	--	0.001	Yes	Yes	Conducted system pressure checks after restart.			
4/16/2018	CE	Yes	NA	74	NA	NA	77	74	2.07	59.3	NA	1	--	--	--	--	--	--	--	--	--	--	--	--	0.001	Yes	No	Changed 3 bag filters (5 um) and conducted system pressure checks.			
4/17/2018	CE	Yes	76	NA	NA	NA	76	NA	2.78	44.0	NA	2	--	--	--	--	--	--	--	--	--	--	--	--	0.001	Yes	No	Carbon vessels were backwashed individually from 1313 to 1427.			
4/19/2018	CE	Yes	NA	NA	NA	NA	75	75	2.78	44.0	NA	3	--	--	--	--	--	--	--	--	--	--	--	--	0.002	Yes	No	Transfer pump is draining down influent/holding tank faster than PWW-4 well is filling tank. No bag filter changes.			
4/19/2018	CE	Yes	88	74	NA	NA	75	74	2.80	43.8	NA	4	--	--	--	--	--	--	--	--	--	--	--	--	0.003	Yes	Yes	Changed 3 bag filters (5 um) and conducted system pressure checks.			
4/19/2018	CE	Yes	86	74	NA	NA	74	74	2.83	43.2	NA	7	--	--	--	--	--	--	--	--	--	--	--	--	0.005	Yes	No	Transfer pump is maintaining breakdown and flow through system ahead of the PWW-4 well pump, no bag changes.			
4/19/2018	CE	Yes	83	74	NA	NA	75	NA	--	NA	NA	10	--	--	--	--	--	--	--	--	--	--	--	--	NA	Yes	No	Transfer pump is maintaining breakdown and flow through system ahead of the PWW-4 well pump. No bag changes.			
4/20/2018	CE	Yes	89	75	NA	NA	75	75	3.07	39.9	NA	11	--	--	--	--	--	--	--	--	--	--	--	--	0.007	Yes	No	Changed 3 bag filters (5 um) and conducted system pressure checks.			
4/22/2018	CE	Yes	92	76	NA	NA	77	76	3.18	38.5	NA	14	--	--	--	--	--	--	--	--	--	--	--	--	0.009	Yes	No	Panel PWW-4 restarted at 14:55. Transfer pump maintaining flow ahead of PWW-4 well pump. Both carbon vessels backwashed. Changed 3 bag filters (5 um).			
4/24/2018	CE	Yes	74	NA	NA	NA	76	NR	3.18	38.5	NA	15	--	--	--	--	--	--	--	--	--	--	--	--	0.009	Yes	No	No bag change, conducted system pressure checks.			
4/25/2018	CE	Yes	79	NA	NA	NA	76	--	3.26	37.3	NA	16	--	--	--	--	--	--	--	--	--	--	--	--	0.009	Yes	No	PWW-4 well pump are on and operating. Transfer pump is maintaining flow ahead of the PWW-4 well pump.			
4/26/2018	CE	Yes	83	NA	NA	NA	76	--	3.37	36.4	NA	17	--	--	--	--	--	--	--	--	--	--	--	--	0.010	Yes	No	Pressure differential of 4 psi, no bag filter change. Transfer pump is maintaining flow ahead of the PWW-4 well pump.			
4/27/2018	CE	Yes	84	73	NA	NA	75	75	3.42	35.8	NA	18	--	--	--	--	--	--	--	--	--	--	--	--	0.010	Yes	No	Changed 3 bag filters (5 um) and conducted system pressure checks.			
4/28/2018	CE	Yes	87	73	NA	NA	75	75	3.53	34.7	NA	21.00	--	--	--	--	--	--	--	--	--	--	--	--	0.012	Yes	No	Changed 3 bag filters (5 um) and conducted system pressure checks.			
Totals: April 2018											43.8	NA	21.00												0.014						
5/1/2018	CS	Yes	83	--	NA	NA	75	--	3.83	32.0	NA	0.00	--	--	--	--	--	--	--	--	--	--	--	--	0.0000	Yes	No	Adjusted (increased) VFD of transfer pump from 25 psi to 40 psi to maintain drawdown ahead of PWW-4 well pump. No bag change. 3" drawdown ~1.41 mps.			
5/2/2018	CS	Yes	NA	75	NA	NA	80	75	3.43	33.7	NA	1.00	--	--	--	--	--	--	--	--	--	--	--	--	0.0006	Yes	No	switch relay stuck in on position. PWW-4 shut off at 07:33 and restarted at 08:26 with float switch working properly. Adjusted transfer pump rate back to 35 psi.			
5/4/2018	BS	Yes	110	73	NA	NA	73	75	3.65	33.6	NA	3.00	--	--	--	--	--	--	--	--	--	--	--	--	0.0017	Yes	No	Changed 3 bag filters (10 um) and conducted system pressure checks.			
5/7/2018	BS	Yes	110	73	NA	NA	74	74	3.7	33.1	NA	6.00	--	--	--	--	--	--	--	--	--	--	--	--	0.0034	Yes	No	Changed 3 bag filters (5 um) and conducted system pressure checks.			
Totals: May 2018											33.3	NA	9.00												0.004						
6/5/2018	CEMM	No	--	--	NR	NR	NR	NR	--	--	NA	0	--	--	--	--	--	--	--	--	--	--	--	--	0	--	--	--	Carbon Change out, filled vessels with water and let to sit for ~24 hours, changed 3 bag filters (5 um).		
6/6/2018	CE	No	--	--	NR	NR	NR	NR	3.45	35.5	NA	1	--	--	--	--	--	--	--	--	--	--	--	--	0.001	No	No	--	Pump float not operating correctly, low float turns pump off and when low float is in water again, transfer pump starts. System remained off.		
6/7/2018	CE	Yes	62	52	NR	NR	NR	NR	3.18	38.5	NA	2	--	--	--	--	--	--	--	--	--	--	--	--	0.001	Yes	No	--	Electrician on site in morning to correct float error, system operating normally.		
6/11/2018	CE	Yes	56	61	NR	NR	NR	NR	3.43	33.7	NA	6	--	--	--	--	--	--	--	--	--	--	--	--	0.003	Yes	No	--	No bag change, conducted system pressure checks.		
6/13/2018	CE	Yes	64	64	NR	NR	NR	NR	3.68	33.3	NA	7	--	--	--	--	--	--	--	--	--	--	--	--	0.004	Yes	No	--	No bag change, conducted system pressure checks.		
6/12/2018	CE	Yes	56	63	NR	NR	NR	NR	3.48	33.3	NA	7	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	No bag change, conducted system pressure checks.		
6/13/2018	CE	Yes	58	54	NR	NR	NR	NR	3.46	35.4	NA	8	--	--	--	--	--	--	--	--	--	--	--	--	0.005	Yes	No	--	Changed 3 bag filters.		
6/13/2018	MM	Yes	--	--	NR	NR	NR	NR	--	--	NA	8	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	Yes	Did not collect system data, only collected samples from Influent, Midpoint, and Effluent sample ports/locations.	
6/16/2018	CE	Yes	77	60	NR	NR	NR	NR	--	--	NA	11	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	No	Changed 3 bag filters.	
6/16/2018	CE	Yes	66	66	NR	NR	NR	NR	--	--	NA	14	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	No	Panel PWW-4 restarted at 15:45.	
6/20/2018	CS	Yes	92	65	NR	NR	NR	NR	--	--	NA	14	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	No	Transfer pump is maintaining flow ahead of the PWW-4 well pump.	
6/20/2018	CE	Yes	72	60	NR	NR	NR	NR	3.73	32.8	NA	15	--	--	--	--	--	--	--	--	--	--	--	--	--	0.008	Yes	No	--	No bag change, conducted system pressure checks.	
6/21/2018	CE	Yes	79	60	NR	NR	NR	NR	--	--	NA	16	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	No	No bag change, conducted system pressure checks. Worked by phone with Bob Simmonds on Control panel for transfer pump, pump will not change speed.	
6/22/2018	CE	Yes	67	67	NR	NR	NR	NR	3.72	32.9	NA	17	--	--	--	--	--	--	--	--	--	--	--	--	--	0.009	Yes	No	--	Changed 3 bag filters, conducted system pressure checks.	
6/25/2018	CE	Yes	81	68	NR	NR	NR	NR	3.77	32.5	NA	20	--	--	--	--	--	--	--	--	--	--	--	--	--	0.011	Yes	No	--	Changed 3 bag filters, conducted system pressure checks.	
6/27/2018	CE	Yes	79	68	NR	NR	NR	NR	3.75	32.6	NA	22	--	--	--	--	--	--	--	--	--	--	--	--	--	0.012	Yes	No	--	Changed 3 bag filters, conducted system pressure checks.	
6/28/2018	CE	Yes	78	68	NR	NR	NR	NR	3.68	33.3	NA	24	--	--	--	--	--	--	--	--	--	--	--	--	--	0.014	Yes	No	--	Changed 3 bag filters, conducted system pressure checks.	
Totals: June 2018											33.9	NA	24												0.013						
7/2/2018	CE	Yes	83	69	NR	NR	NR	NR	3.95	31.0	NA	2	--	--	--	--	--	--	--	--	--	--	--	--	--	0.001	Yes	No	--	Changed 3 bag filters, conducted system pressure checks.	
7/5/2018	CE	No	--	--	NR	NR	NR	NR	--	--	NA	5	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	No	No power supplied to the recovery well.	
7/6/2018	CE	Yes	86	69	NR	NR	NR	NR	3.87	31.7	NA	5	--	--	--	--	--	--	--	--	--	--	--	--	--	0.003	Yes	No	--	Changed 3 bag filters, conducted system pressure checks.	
7/6/2018	CS	Yes	89	72	NR	NR	NR	NR	3.77	32.5	NA	8	--	--	--	--	--	--	--	--	--	--	--	--	--	0.004	Yes	No	--	Changed 3 bag filters, conducted system pressure checks.	
7/11/2018	CE	Yes	88	72	NR	NR	NR	NR	3.85	31.8	NA	10	--	--	--	--	--	--	--	--	--	--	--	--	--	0.005	Yes	No	--	Changed 3 bag filters, conducted system pressure checks.	
7/13/2018	CE	Yes	89	72	NR	NR	NR	NR	4.06	30.0	NA	12	--	--	--	--	--	--	--	--	--	--	--	--	--	0.006	Yes	Yes	--	Changed 3 bag filters, conducted system pressure checks.	
7/16/2018	CE	Yes	98	70	NR	NR	NR	NR	3.97	30.9	NA	15	--	--	--	--	--	--	--	--	--	--	--	--	--	0.007	Yes	No	--	Changed 3 bag filters, conducted system pressure checks.	
7/18/2018	CE	No	--	--	NR	NR	NR	NR	--	--	NA	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	No	No power supplied to the recovery well. Contact relay at recovery well pumped out.	
7/19/2018	CS	Yes	90	72	NR	NR	NR	NR	4.03	30.4	NA	17	--	--	--	--	--	--	--	--	--	--	--	--	--	0.008	Yes	No	--	Electrician replaced the control valve recovery well operating again. Changed 3 bag filters and collected system pressure checks.	
7/26/2018	CE	Yes	87	72	NR	NR	NR	NR	--	--	NA	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	Yes	No	Changed 3 bag filters, conducted system pressure checks. Backwashed carbon vessels.
7/28/2018	CE	Yes	84	72	NR	NR	NR	NR	4.47	27.4	NA	21	--	--	--	--	--	--	--	--	--	--	--	--	--	0.009	Yes	No	--	Changed 3 bag filters, conducted system pressure checks.	
7/25/2018	CE	Yes	84	72	NR	NR	NR	NR	--	--	NA	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	Yes	No	Collected system pressure checks.
7/26/2018	CE	Yes	85	72	NR	NR	NR	NR	--	--	NA	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	Yes	No	Collected system pressure checks.
7/27/2018	CE	Yes	88	72	NR	NR	NR	NR	4.8	25.5	NA	25	--	--	--	--	--	--	--	--	--	--	--	--	--	0.010	Yes	No	--	Changed 3 bag filters, conducted system pressure checks.	
7/30/2018	CE	Yes	91	71	NR	NR	NR	NR	4.95	24.7	NA	28	--	--	--	--	--	--	--	--	--	--	--	--	--	0.011	Yes	No	--	Changed 3 bag filters, conducted system pressure checks.	
Totals: July 2018											29.6	NA	28												0.015						
8/2/2018	CE	Yes	89	70					5.17	23.7		2	--	--	--	--	--	--	--	--	--	--	--	--	--	0.001	Yes	No	--	Changed 3 bag filters, conducted system pressure checks.	
8/6/2018	CE	Yes	NA	72					5.22	23.5		6	--	--	--	--	--	--	--	--	--	--	--	--	--	0.002	Yes	No	--	Changed 3 bag filters, conducted system pressure checks.	
8/10/2018	CE	Yes	90	72					4.32	28.9		8	--	--	--	--	--	--	--	--	--	--	--	--	--	0.003	Yes	No	--	Changed 3 bag filters, conducted system pressure checks.	

Table 2A - Summary of Groundwater Pump and Treatment System Operating and Maintenance Data - System No. 1 (GWTS #1)
Barnstable County Fire and Rescue Training Academy
155 First Rock Road, Barnstable, MA
87N 4 26 17S

Date	Operator	System Operating on Arrival	Influent Bag Filter Differential Pressure (psi) *		Pre-Filter Changeout Differential Pressure (psi)		Post-Filter Changeout Differential Pressure (psi)		4" Influent Tank Fill Rate (min)	INFLUENT		EFFLUENT				Estimated Total PFAs Removal (kg)	System Operating on Departure	System Sampled	Comments		
			Pre	Post	Gauge P1	Gauge P2	Gauge P1	Gauge P2		Combined Instantaneous Estimated Influent Flow Rate (GPM)	Estimated Instantaneous Influent Flow Rate (GPM)	Instant Effluent Flow Rate (GPM)†	Instantaneous Effluent Flow Rate (GPM)†	Totalizer (Gal)	Net Gallons Treated					Average Effluent Flow Rate (GPM)†	
10/1/2018	CE	No	78	57	NR	NR	NR	NR	5.83	21.0	NA	1	--	--	--	--	0.000	Yes	No	System restarted after scheduled shutdown for carbon exchange. Changed 3 bag filters, conducted system pressure checks.	
10/5/2018	CE	Yes	64	58	NR	NR	NR	NR	6.35	19.3	NA	5	--	--	--	--	0.003	Yes	No	Changed 3 bag filters, conducted system pressure checks.	
10/6/2018	CE	Yes	56	57	NR	NR	NR	NR	6.95	17.6	NA	10	--	--	--	--	0.003	Yes	No	Changed 3 bag filters, conducted system pressure checks.	
10/12/2018	CE	Yes	60	55	NR	NR	NR	NR	--	--	NA	12	--	--	--	--	--	Yes	No	No bag change necessary.	
10/15/2018	CE	Yes	70	60	NR	NR	NR	NR	6.9	17.8	NA	15	--	--	--	--	0.005	Yes	No	Changed 3 bag filters, conducted system pressure checks. Replaced filter basket.	
10/19/2018	CE	Yes	71	60	NR	NR	NR	NR	7.12	17.2	NA	19	--	--	--	--	0.006	Yes	No	Changed 3 bag filters, conducted system pressure checks.	
10/23/2018	CE	Yes	76	63	NR	NR	NR	NR	7.73	15.8	NA	23	--	--	--	--	0.007	Yes	No	Changed 3 bag filters, conducted system pressure checks. Replaced holding basket in filter vessel.	
10/26/2018	CE	Yes	72	64	NR	NR	NR	NR	8.83	13.9	NA	26	--	--	--	--	0.007	Yes	No	Changed 3 bag filters, conducted system pressure checks.	
10/30/2018	CE	Yes	80	65	NR	NR	NR	NR	7.52	16.3	NA	30	--	--	--	--	0.009	Yes	Yes	Changed 3 bag filters, conducted system pressure checks. Replaced bagholder (basket) in filter vessel.	
Totals - October 2018										17.6	NA	31					0.011				
11/2/2018	CE	Yes	71	62	NR	NR	NR	NR	7.86	15.6	NA	2	--	--	--	--	0.001	Yes	No	Changed 3 bag filters, conducted system pressure checks.	
11/6/2018	CE	Yes	71	62	NR	NR	NR	NR	--	--	NA	6	--	--	--	--	--	No	No	Changed 3 bag filters, conducted system pressure checks. System shutdown at 10:00 for force main declogging and flush.	
11/8/2018	CE	Yes	65	45	NR	NR	NR	NR	5.25	23.3	NA	6	--	--	--	--	0.004	Yes	No	Changed 3 bag filters, conducted system pressure checks.	
11/9/2018	CE	Yes	55	44	NR	NR	NR	NR	5.2	23.6	NA	7	--	--	--	--	0.004	Yes	No	Changed 3 bag filters, conducted system pressure checks.	
11/13/2018	CE	Yes	51	47	NR	NR	NR	NR	5.03	24.4	NA	10	--	--	--	--	0.007	Yes	No	Conducted system pressure checks.	
11/13/2018	CE	Yes	52	47	NR	NR	NR	NR	4.88	25.1	NA	11	--	--	--	--	0.007	Yes	No	Conducted system pressure checks.	
11/14/2018	CE	Yes	54	47	NR	NR	NR	NR	4.92	24.9	NA	12	--	--	--	--	0.008	Yes	No	Conducted system pressure checks.	
11/15/2018	CE	Yes	55	47	NR	NR	NR	NR	--	--	NA	13	--	--	--	--	--	Yes	No	Conducted system pressure checks.	
11/16/2018	CE	Yes	54	50	NR	NR	NR	NR	4.63	26.5	NA	14	--	--	--	--	0.010	Yes	Yes	Changed 3 bag filters, conducted system pressure checks.	
11/21/2018	CE	Yes	63	53	NR	NR	NR	NR	5.98	24.1	NA	19	--	--	--	--	0.012	Yes	No	Changed 3 bag filters, conducted system pressure checks.	
11/27/2018	CE	Yes	69	55	NR	NR	NR	NR	5.75	21.2	NA	25	--	--	--	--	0.014	Yes	No	Changed 3 bag filters, conducted system pressure checks.	
11/28/2018	CE	Yes	77	58	NR	NR	NR	NR	5.85	20.9	NA	28	--	--	--	--	0.016	Yes	No	Changed 3 bag filters, conducted system pressure checks.	
Totals - November 2018										23.0	NA	36					0.012				
12/3/2018	CE	Yes	63	62	NR	NR	NR	NR	5.33	23.0	NA	3	--	--	--	--	0.001	Yes	No	Changed 3 bag filters, conducted system pressure checks.	
12/7/2018	CE	Yes	83	67	NR	NR	NR	NR	5.58	22.0	NA	7	--	--	--	--	0.002	Yes	No	Changed 3 bag filters, conducted system pressure checks.	
12/11/2018	CE	Yes	75	65	NR	NR	NR	NR	5.8	21.1	NA	11	--	--	--	--	0.003	Yes	No	Changed 3 bag filters, conducted system pressure checks.	
12/14/2018	CE	Yes	70	63	NR	NR	NR	NR	5.4	22.7	NA	14	--	--	--	--	0.004	Yes	Yes	Changed 3 bag filters, conducted system pressure checks.	
12/18/2018	CE	Yes	70	65	NR	NR	NR	NR	6.72	18.2	NA	18	--	--	--	--	0.004	Yes	No	Changed 3 bag filters, conducted system pressure checks.	
12/21/2018	CE	Yes	70	67	NR	NR	NR	NR	6.7	18.3	NA	21	--	--	--	--	0.005	Yes	No	Changed 3 bag filters, conducted system pressure checks.	
12/26/2018	CE	Yes	78	71	NR	NR	NR	NR	7.38	16.6	NA	26	--	--	--	--	0.006	Yes	No	Changed 3 bag filters, conducted system pressure checks.	
12/28/2018	CE	Yes	82	76	NR	NR	NR	NR	7.35	16.7	NA	28	--	--	--	--	0.006	Yes	No	Changed 3 bag filters, conducted system pressure checks.	
12/31/2018	CE	Yes	82	71	NR	NR	NR	NR	7.38	16.6	NA	31	--	--	--	--	0.007	Yes	No	Changed 3 bag filters, conducted system pressure checks.	
Totals - December 2018										19.5	NA	31					0.008				
1/4/2019	RPT	Yes	72	72	NR	NR	NR	NR	6.5	18.8	NA	4	--	--	--	--	0.001	Yes	No	Changed 3 bag filters, conducted system pressure checks. observed hole in pre-filter basket.	
1/7/2019	PCB	Yes	80	71	NR	NR	NR	NR	6.2	19.8	NA	7	--	--	--	--	0.002	Yes	No	Change 3 bag filters, conducted system pressure checks.	
1/16/2019	RPT	Yes	75	76	NR	NR	NR	NR	7.03	17.6	NA	10	--	--	--	--	0.003	Yes	No	Conducted system pressure checks.	
1/11/2019	MDM	Yes	79	71	NR	NR	NR	NR	7.62	16.1	NA	11	--	--	--	--	0.003	Yes	Yes	Change 3 bag filters, conducted system pressure checks.	
1/14/2019	PCB	Yes	76	71	NR	NR	NR	NR	--	--	NA	14	--	--	--	--	--	Yes	No	Conducted system pressure checks.	
1/15/2019	PCB	Yes	80	71	NR	NR	NR	NR	--	--	NA	15	--	--	--	--	--	Yes	No	Change 3 bag filters, conducted system pressure checks.	
1/18/2019	PCB	Yes	76	71	NR	NR	NR	NR	6.65	14.2	NA	18	--	--	--	--	0.004	Yes	No	Change 3 bag filters, conducted system pressure checks.	
1/21/2019	SCT	Yes	80	71	NR	NR	NR	NR	6.15	15.6	NA	21	--	--	--	--	0.005	Yes	No	Change 3 bag filters, conducted system pressure checks.	
1/24/2019	SCT	Yes	85	69	NR	NR	NR	NR	9.1	13.5	NA	24	--	--	--	--	0.005	Yes	No	Change 3 bag filters, conducted system pressure checks.	
1/27/2019	SCT	Yes	85	68	NR	NR	NR	NR	8.25	14.8	NA	27	--	--	--	--	0.007	Yes	No	Change 3 bag filters, conducted system pressure checks.	
1/30/2019	PCB	Yes	86	71	NR	NR	NR	NR	9	13.6	NA	30	--	--	--	--	0.007	Yes	No	Change 3 bag filters, conducted system pressure checks.	
1/31/2019	PCB	Yes	83	71	NR	NR	NR	NR	--	--	NA	31	--	--	--	--	--	Yes	No	Change 3 bag filters, conducted system pressure checks.	
Totals - January 2019										14.8	NA	35					0.008				
2/4/2019	RPT	Yes	--	--	NR	NR	NR	NR	--	--	NA	--	--	--	--	--	--	--	No	No	Carbon Change out, filled vessels with water and let to sit for ~24 hours, changed 3 bag filters (5 um).
2/5/2019	RPT	No	52	35	NR	NR	NR	NR	7.33	16.7	NA	4	--	--	222.7	--	--	0.002	Yes	No	System restarted after scheduled shutdown for carbon exchange. Changed bag filters and conducted system pressure checks.
2/11/2019	PCB	Yes	61	45	NR	NR	NR	NR	11.58	10.6	NA	10	--	--	--	--	--	--	Yes	No	Changed 3 bag filters, conducted system pressure checks.
2/13/2019	ST	Yes	55	43	NR	NR	NR	NR	8.12	15.1	NA	12	--	--	--	--	--	--	Yes	No	Changed 3 bag filters, conducted system checks.
2/15/2019	MDM	Yes	--	--	NR	NR	NR	NR	7.5	16.3	NA	14	--	--	--	--	--	0.007	Yes	Yes	Sampled system and collected system pressure checks.
2/22/2019	ST	Yes	--	--	NR	NR	NR	NR	10.75	11.4	NA	21	--	--	--	--	--	0.007	Yes	No	Changed 3 bag filters, conducted system pressure checks.
2/25/2019	MDM	Yes	25	15	NR	NR	NR	NR	7.5	16.3	NA	23	--	--	--	--	--	0.007	Yes	No	Changed 3 bag filters, repaired filter basket, adjusted and braced the speed drive on the transfer/discharge pump.
Totals - February 2019										14.4	NA	26			132.7			0.011	Yes	No	System shutdown at 09:33 for the replacement of the submersible pump at PRW-4 and restarted at 14:04.
3/1/2019	ST	Yes	43	40	NR	NR	NR	NR	7.55	16.2	NA	1	--	--	76.6	--	--	0.001	Yes	No	Conducted system pressure checks.
3/2/2019	ST	Yes	45	46	NR	NR	NR	NR	--	--	NA	3	--	--	--	--	--	--	Yes	No	Conducted system pressure checks, changed bag filters, installed/replaced filter baskets with new stainless steel filter baskets.
3/5/2019	PCB	Yes	46	40	NR	NR	NR	NR	--	--	NA	5	--	--	--	--	--	--	Yes	No	Conducted system pressure checks.
3/7/2019	PCB/ST	Yes	50	40	NR	NR	NR	NR	8.16	15.0	NA	7	--	--	--	--	--	0.004	Yes	No	Conducted system pressure checks and changed bag filters.
3/9/2019	ST	Yes	44	41	NR	NR	NR	NR	7.75	15.8	NA	9	--	--	--	--	--	0.005	Yes	No	Changed bag filters.
3/11/2019	ST	Yes	58	50	NR	NR	NR	NR	7.92	15.5	NA	11	--	--	68.1	--	--	0.006	Yes	Yes	Changed bag filters.
3/13/2019	ST	Yes	65	50	NR	NR	NR	NR	6.66	26.5	NA	13	--	--	--	--	--	--	Yes	No	Revised new speed on transfer pump, adjusted VFD to increase pump speed to 58 Hz. Changed 3 bag filters twice.
3/14/2019	ST	Yes	75	50	NR	NR	NR	NR	5.16	23.7	NA	14	--	--	--	--	--	0.012	Yes	No	Conducted system pressure checks and collected samples from EO tank for analysis at County lab for disposal criteria.
3/16/2019	PCB	No	62	40	NR	NR	NR	NR	--	--	NA	15	--	--	--	--	--	--	Yes	No	Pump at PRW-4 shut off upon arrival to system, contact relay failure, possibly due to power surge from thunderstorm. Restarted system after contact relay was replaced.
3/22/2019	ST	Yes	28	20	NR	NR	NR	NR	2.38	51.5	NA	21	--	--	51.5	--	--	0.038	Yes	No	Revised VFD drive for effluent transfer pump inside system shed.
3/23/2019	ST	Yes	23	20	NR	NR	NR	NR	--	--	NA	22	--	--	--	--	--	--	No	No	Changed bag filters before system shutdown. System shutdown due to slow flow rate from transfer pump as a result of accumulating iron sediments in EO tank from slow influent flow rate as a result of a leaking VFD-4 well pump.
3/26/2019	RPT/ST	No	--	--	NR	NR	NR	NR	--	--	NA	23	--	--	--	--	--	--	Yes	No	Removed/pumped out the contents of the influent equalization (EQ) tank, repaired the system's pump electrical components, adjusted VFD on transfer pump, installed unions on influent piping manifold, replaced bag filters at discharge into the EO tank, and restarted the system at 1645.
Totals - March 2019										29.3	NA	26			63.2			0.022			

Table 2A - Summary of Groundwater Pump and Treatment System Operating and Maintenance Data - System No. 1 (GWTS #1)
Barnstable County Fire and Rescue Training Academy
155 First Rock Road, Barnstable, MA
87N 4 26 W79

Date	Operator	System Operating on Arrival	Influent Bag Filter Differential Pressure (psi)		Pre-Filter Changeout Differential Pressure (psi)		Post-Filter Changeout Differential Pressure (psi)		Influent		Effluent		Days System Operating	Instant Effluent Flow Rate (GPM)	Instantaneous Effluent Flow Rate (GPM)	Totalizer (Gal)	Net Gallons Treated	Average Effluent Flow Rate (GPM)	Estimated Total PFA Removal (kg)	System Operating on Departure	System Sampled	Comments
			Pre	Post	Gauge P1	Gauge P2	Gauge P1	Gauge P2	6" Influent Tank Fill Rate (GPM)	Combined Instantaneous Influent Flow Rate (GPM)	Estimated Instantaneous Influent Flow Rate (GPM)											
4/1/2019	ST	Yes	--	--	40	26	40	39	2.25	54.4	NA	1	--	--	--	--	--	0.002	Yes	No	Conducted system pressure checks and changed bag filters.	
4/3/2019	ST	Yes	--	--	40	39	--	--	--	NA	3	--	--	--	--	--	--	--	Yes	No	Conducted system pressure checks.	
4/6/2019	ST	Yes	--	--	50	41	50	50	2.23	54.9	NA	6	--	--	--	--	--	0.014	Yes	No	Conducted system pressure checks and changed bag filters.	
4/6/2019	GWTT	Yes	--	--	40	50	--	--	1.6	76.6	NA	9	--	--	18.85	--	--	0.029	Yes	Yes	Conducted system pressure checks, backwashed the primary carbon vessel for ~30 minutes, inspected the transfer pump and removed excess iron oxide sedimentation from the sited piping.	
4/16/2019	ST	Yes	--	--	50	15	23	25	--	--	NA	10	--	--	--	--	--	--	Yes	No	Conducted system pressure checks and changed bag filters.	
4/17/2019	ST	Yes	--	--	40	35	35	35	--	--	NA	11	--	--	--	--	--	--	Yes	No	Conducted system pressure checks and changed bag filters.	
4/17/2019	GWTT	Yes	--	--	50	40	44	46	3	40.8	NA	12	--	--	--	--	--	0.020	Yes	No	Conducted system pressure checks and changed bag filters.	
4/19/2019	GWTT	Yes	--	--	55	45	55	55	4.08	30.0	NA	15	--	--	--	--	--	0.019	Yes	No	Conducted system pressure checks and changed bag filters.	
4/19/2019	GWTT	Yes	--	--	58	55	35	40	2.5	49.0	NA	19	--	--	--	--	--	0.039	Yes	No	Conducted system pressure checks and changed bag filters.	
4/23/2019	GWTT	Yes	--	--	46	47	50	55	4.00	30.8	NA	23	--	--	33.4	--	--	0.029	Yes	No	Conducted system pressure checks and changed bag filters.	
4/26/2019	GWTT	Yes	--	--	58	50	55	60	--	--	NA	26	--	--	20.3	--	--	--	Yes	No	Conducted system pressure checks and changed bag filters, conducted general housekeeping duties.	
4/30/2019	GWTT	No	--	--	--	--	--	--	--	--	NA	29	--	--	--	--	--	--	--	Yes	No	System off on arrival due to contact relay failure for transfer pump operation; system restarted at 16:29 after contact relay was replaced.
Totals: April 2019			--	--	--	--	--	--	--	48.3	NA	28	--	--	24.2	--	--	0.068	--	--	--	
5/9/2019	GWTT	Yes	--	--	55	35	45	50	2.18	56.2	NA	3	--	--	32.93	--	--	0.003	Yes	No	Conducted system pressure checks and changed bag filters.	
5/7/2019	GWTT	Yes	--	--	58	38	50	55	2.05	59.8	NA	7	--	--	31.57	--	--	0.007	Yes	No	Conducted system pressure checks and changed bag filters.	
5/10/2019	GWTT	No	--	--	--	--	--	--	--	--	NA	--	--	--	--	--	--	--	--	--	No	System down as a result of failed VFD for transfer pump operation, changed bag filters.
5/17/2019	GWTT	No	--	--	55	38	--	--	--	--	NA	10	--	--	--	--	--	--	--	Yes	No	Installed new VFD drive, system shutdown due to power surge from thunderstorm. Electrician added 15 minute electrical control delay at the control panel in the system shed, resulting a 15 minute delay before the pump at PWW-4 powers on at the "High Level" float switch.
5/21/2019	MDM	No	--	--	57	30	57	60	1.83	66.9	NA	14	--	--	33.38	--	--	0.016	Yes	Yes	Power surge from major ground voltage at electrical substation "fried" the electrical delay at control panel in system shed. Electrician bypassed delay to allow system restart at 11:15. Electrician will change coil at PWW-4 panel to lower voltage at later date. Conducted system pressure checks and changed bag filters.	
5/24/2019	GWTT	Yes	--	--	58	35	58	60	2.083	58.8	NA	17	--	--	25.36	--	--	0.017	Yes	No	Conducted system pressure checks and changed bag filters. Bypass installed to allow 15 minute delay on PWW-4 submersible pump float switch.	
5/28/2019	GWTT	Yes	--	--	56	46	66	68	2.68	46.2	NA	21	--	--	52.30	--	--	0.016	Yes	No	Conducted system pressure checks and changed bag filters twice. Backwashed both carbon vessels.	
5/31/2019	GWTT	Yes	--	--	58	34	55	60	2.17	56.5	NA	24	--	--	36.90	--	--	0.022	Yes	No	Conducted system pressure checks and changed bag filters, 3" monitoring valve on WWT-6 leaks 1/2" replaced. Installed a 2" flow meter and meter on influent discharge piping.	
Totals: May 2019			--	--	--	--	--	--	--	57.4	NA	24	--	--	35.4	--	--	0.023	--	--	--	
6/4/2019	GWTT	Yes	--	--	57	48	57	62	2.46	49.8	NA	4	--	--	20.2	--	--	0.010	Yes	No	Conducted system pressure checks and changed bag filter. Replaced in-kind flow meter previously installed on 5/31/19.	
6/7/2019	GWTT	Yes	--	--	57	45	57	62	2.43	50.4	NA	7	--	--	16.2	--	--	0.017	Yes	No	Conducted system pressure checks and changed bag filters.	
6/11/2019	GWTT	Yes	--	--	76	78	70	82	2.53	48.4	NA	11	--	--	17.3	--	--	0.026	Yes	No	Conducted system pressure checks and changed bag filters. System shutdown due to high pressure measurement on the LGAC vessels, (from iron fouling); carbon change to occur on 6/13/19.	
6/13/2019	MDM	No	--	--	--	--	--	--	--	--	NA	11	--	--	--	--	--	--	--	No	No	System off for carbon change out.
6/14/2019	GWTT	No	--	--	--	--	25	28	2.3	53.3	NA	12	--	--	167.1	--	--	0.032	Yes	No	System restarted at 13:00, adjusted flow rate via VFD to 35 Hz. GWTT recorded Effluent flow rate from drip in site glass to be 44 seconds, immediately after adjusting the VFD.	
6/18/2019	GWTT	Yes	--	--	25	10	11	15	2.23	54.9	NA	16	--	--	56.2	--	--	0.043	Yes	No	Conducted system checks, changed bag filters, adjusted VFD to 35 GPM.	
6/21/2019	GWTT	Yes	--	--	17	15	17	20	2.12	57.8	NA	19	--	--	58.6	--	--	0.054	Yes	No	Conducted system checks, changed bag filters, adjusted VFD to 38 Hz.	
6/25/2019	GWTT	Yes	--	--	20	18	20	25	2.3	53.3	NA	23	--	--	59.0	--	--	0.060	Yes	No	Conducted system checks, changed bag filters, adjusted VFD from 28 to 35 Hz.	
6/27/2019	MDM	Yes	--	--	33	21	--	--	3.2	38.3	NA	25	--	--	17.5	--	--	0.047	Yes	Yes	Conducted system checks, system VFD at 35 Hz; pressure gauges at LGAC 2 are 0 psi.	
6/28/2019	GWTT	Yes	--	--	33	22	30	35	2.4	51.0	NA	26	--	--	60.9	--	--	0.065	Yes	No	Conducted system checks, changed bag filters, VFD at 35 Hz. Effluent flow rate increased after bag filter changeout.	
Totals: June 2019			--	--	--	--	--	--	--	50.8	NA	27	--	--	62.4	--	--	0.068	--	--	--	
7/2/2019	GWTT	Yes	--	--	32	20	30	32	2.52	48.4	NA	2	NR	NR	52.6	28570	--	0.006	Yes	No	Conducted system checks, changed bag filters.	
7/5/2019	GWTT	Yes	--	--	25	23	30	35	2.53	48.4	NA	5	NR	NR	52.6	262970	222395	--	0.013	Yes	No	Conducted system checks, changed bag filters, VFD at 35 Hz. Effluent flow rate increased after bag filter changeout.
7/6/2019	GWTT	Yes	--	--	32	25	36	40	2.35	52.1	NA	9	NR	NR	58.6	313880	68710	--	0.026	Yes	No	Conducted system checks, changed bag filters, VFD at 35 Hz. Effluent flow rate increased after bag filter changeout. Primary LGAC vessel requires a backwash.
7/12/2019	GWTT	Yes	--	--	39	35	39	43	2.42	50.6	NA	12	NR	NR	55.7	407920	16240	--	0.033	Yes	No	Conducted system checks, changed bag filters, adjusted VFD to 42 Hz.
7/15/2019	GWTT	Yes	--	--	46	40	35	50	3.00	40.8	NA	15	NR	NR	55.7	587740	178650	--	0.034	Yes	No	Conducted system checks, changed bag filters, adjusted VFD from 42 Hz to 40 Hz.
7/18/2019	GWTT	Yes	--	--	45	28	55	60	2.83	43.2	NA	18	NR	NR	47.48	NR	--	0.043	Yes	No	Conducted system checks, changed bag filters, adjusted VFD from 40 Hz to 45 Hz.	
7/23/2019	GWTT	Yes	--	--	56	43	55	61	3.22	38.0	NA	23	NR	NR	25.63	717580	129840	--	0.048	Yes	No	Conducted system checks, changed bag filters, adjusted VFD from 40 Hz to 45 Hz.
7/26/2019	GWTT	Yes	--	--	56	50	56	60	--	--	NA	26	NR	NR	11.93	722700	5120	--	--	Yes	No	Conducted system checks, changed bag filters.
7/26/2019	GWTT	Yes	--	--	--	--	56	60	2.50	49.0	NA	29	NR	NR	53.3	722360	660	--	0.078	Yes	Yes	Pumped out contents of exterior totes and conducted backwash of system (6,800 gallons removed by Global). Shutdown system for ~2 hours. VFD at 23 Hz on departure.
Totals: July 2019			--	--	--	--	--	--	--	46.9	NA	31	--	--	45.1	--	--	0.079	--	--	--	
8/2/2019	GWTT	Yes	--	--	15	5	18	9	2.68	50.6	NA	2	NR	NR	19.68	723960	0	0.0	0.006	Yes	No	Conducted system checks, changed bag filters, adjusted VFD from 23 Hz to 28 Hz.
8/5/2019	GWTT	Yes	--	--	21	8	16	20	2.95	52.8	NA	5	NR	NR	49.00	726280	2320	0.5	0.014	Yes	No	Conducted system checks, changed bag filters, VFD at 28 Hz.
8/8/2019	GWTT	Yes	--	--	20	19	22	27	2.23	54.9	NA	8	NR	NR	53.50	729450	3170	0.7	0.024	Yes	No	Conducted system checks, changed bag filters, adjusted VFD to 32 Hz and 31 Hz. Viability of site glass impaired due to iron fouling, possible obstruction in site glass causing error in flow calculations.
8/13/2019	GWTT	Yes	--	--	27	23	28	30	2.17	56.5	NA	13	NR	NR	56.45	730390	8940	1.2	0.040	Yes	No	Conducted system checks, changed bag filters, adjusted VFD to 23 Hz. Obstruction in site glass seems apparent, affecting flow rate calculations.
8/16/2019	GWTT	Yes	--	--	32	26	30	35	1.94	117.8	NA	16	NR	NR	34.83	746020	5630	1.3	0.103	Yes	No	Conducted system checks, changed bag filters, adjusted VFD from 23 Hz to 28 Hz.
8/29/2019	GWTT	Yes	--	--	40	27	36	38	NR	NR	NA	26	NR	NR	757990	13670	2.4	--	--	Yes	No	Conducted system checks, changed bag filters, adjusted VFD from 38 Hz to 39 Hz. Could not calculate influent flow rate due to obstruction in site glass.
8/29/2019	GWTT	Yes	--	--	41	29	38	44	--	--	NA	33	NR	NR	50.00	760120	33730	7.6	0.063	Yes	Yes	Conducted system checks, changed bag filters, and adjusted VFD from 39 Hz to 40 Hz. Collected monthly system samples on 8/29/19.
8/27/2019	GWTT	Yes	--	--	45	35	44	49	--	--	NA	27	NR	NR	673750	83030	14.4	--	0.074	Yes	No	Conducted system checks, changed bag filters, adjusted VFD from 40 Hz to 42 Hz.
8/30/2019	GWTT	NR	--	--	49	37	8	10	--	--	NA	30	NR	NR	49.00	910640	102790	22.8	0.081	Yes	No	Conducted system checks, changed bag filters after backwash of primary vessel.
Totals: August 2019			--	--	--	--	--	--	--	66.5	NA	37	--	--	NR	--	--	0.113	--	--	--	
9/3/2019	GWTT	Yes	--	--	18	7	10	14	NA	NA	NA	3	--	NR	1044190	67650	15.7	0.001	Yes	No	Conducted system checks, changed bag filters, "High-High Level" Alarm indicated, adjusted VFD, site glass plugged due to iron-oxide sludge build up at bottom of EQ tank, could not collect influent flow rate.	
9/6/2019	GWTT	Yes	--	--	27	14	22	25	NA	NA	NA	6	--	NR	NR	NR	NR	--	--	Yes	No	Conducted system checks, changed bag filters, "High-High Level" Alarm indicated, adjusted VFD to 35 Hz from 23 Hz.
9/10/2019	GWTT	Yes	--	--	35	18	30	35	NA	NA	NA	10	--	NR	1203690	159500	27.7	0.038	Yes	No	Conducted system checks, changed bag filters, observed approximately 20 in. of sludge in EQ Tank, and adjusted VFD to 40 Hz from 38 Hz.	
9/13/2019	GWTT	Yes	--	--	40	25	40	42	NA	NA	NA	13	--	NR	1311290	107600	24.9	0.009	Yes	No	Conducted system checks, changed bag filters, and adjusted VFD to 45 Hz.	
9/16/2019	GWTT	Yes	--	--	45	26	44	48	NA	NA	NA	16	--	NR	1419730	103880	23.8	0.011	Yes	No	Conducted system checks, changed bag filters, and adjusted VFD to 48 Hz.	
9/20/2019	GWTT	Yes	--	--	48	35	12	14	NA	NA	NA	20	--	NR	1543480	129670	22.4	0.013	Yes	No	Conducted system checks, changed bag filters, backwashed primary LGAC vessel, and adjusted VFD to 29 Hz.	
9/23/2019	GWTT	Yes	--	--	24	8	23	27	NA	NA	NA	23	--	NR	1583850	20810	4.8	0.003	Yes	No	Conducted system checks, changed bag filters, adjusted VFD from 29 Hz to 34 Hz.	
9/27/2019	GWTT	Yes	--	--	52	17	42	44	NA	NA	NA	27	--	NR	1577890	14040	2.4	0.002	Yes	No	Conducted system checks, changed bag filters, adjusted VFD from 34 Hz to 42 Hz, system samples collected on 9/26/19.	
Totals: September 2019			--	--	--	--	--	--	--	NA	NA	36	--	NR	--	607350	17.4	0.075	--	--	--	

Table 2A - Summary of Groundwater Pump and Treatment System Operating and Maintenance Data - System No. 1 (GWTS #1)
Barnstable County Fire and Rescue Training Academy
155 First Rock Road Barnstable, MA
87N 4 24 W79

Date	Operator	System Operating on Arrival	Influent Bag Filter Differential Pressure (psi)		Pre-Filter Chargeout Differential Pressure (psi)		Post-Filter Chargeout Differential Pressure (psi)		6" Influent Tank Fill Rate (min)	INFLUENT			Days System Operating	EFFLUENT					Estimated Total PFAs Removal (kg)	System Operating on Departure	System Sampled	Comments
			Pre	Post	Gauge P1	Gauge P2	Gauge P3	Gauge P3		Combined Instantaneous Influent Flow Rate (GPM)	Estimated Instantaneous Influent Flow Rate (GPM)	Instant Effluent Flow Rate (GPM)		Instantaneous Effluent Flow Rate (GPM)	Totalizer (Gal)	Net Gallons Treated	Average Effluent Flow Rate (GPM)					
10/1/2019	GWTT	Yes	--	--	50	28	18	19	NA	NA	NA	1	--	NR	1620400	--	--	--	Yes	No	Conducted system checks, changed bag filters, adjusted VFD from 42 Hz to 31 Hz. Operator noticed a loud sound on discharge pipes at LGAC #1 as well as a pressure drop across the entire system, system was instantly turned off and restarted after the VFD was adjusted. Operator assumed an obstruction (i. e. iron oxide precipitation) was in LGAC#1 restricting flow and loud sound was the obstruction being dislodged.	
10/2/2019	GWTT	Yes	--	--	--	--	--	--	NA	NA	NA	3	--	NR	1639940	19540	6.8	0.0005	Yes	No	System was shut off at 8:00 during excavation of the effluent discharge piping. The discharge piping was repaired and the system was restarted at 16:00. The bag filters were changed.	
10/7/2019	GWTT	Yes	--	--	27	14	22	20	NA	NA	NA	6	--	NR	1640550	5630	1.3	0.0002	Yes	No	Conducted system checks, changed bag filters, adjusted VFD from 31 Hz to 35 Hz.	
10/11/2019	GWTT	Yes	--	--	32	30	19	20	NA	NA	NA	10	--	NR	1683870	38120	6.7	0.0015	Yes	No	Conducted system checks, changed bag filters, adjusted VFD from 35 Hz to 32 Hz.	
10/15/2019	GWTT	Yes	--	--	29	20	27	30	NA	NA	NA	14	--	NR	1752276	71600	12.6	0.0040	Yes	No	Conducted system checks, changed bag filters, adjusted VFD from 32 Hz to 39 Hz.	
10/18/2019	GWTT	Yes	--	--	38	22	30	35	NA	NA	NA	18	--	NR	1882270	112000	18.4	0.0062	Yes	No	Conducted system checks, changed bag filters, adjusted VFD from 39 Hz to 33 Hz.	
10/22/2019	GWTT	Yes	--	--	34	13	31	35	NA	NA	NA	21	--	NR	1946590	79230	18.4	0.0090	Yes	No	Conducted system checks, changed bag filters, adjusted VFD from 35 Hz to 43 Hz.	
10/25/2019	GWTT	Yes	--	--	44	34	35	42	NA	NA	NA	24	--	NR	2041780	97190	22.5	0.0126	Yes	No	Conducted system checks, changed bag filters, adjusted VFD from 43 Hz to 49 Hz.	
10/28/2019	GWTT	Yes	--	--	44	34	35	42	5.38	22.8	NA	27	--	NR	2122880	80100	18.5	0.0117	Yes	No	Conducted system checks, changed bag filters, Global Cycle on site to vacuum pump out the contents from the EQ tank, bag filter unit. Toes containing water from GAC vessel backwashers. The VFD was adjusted from 40 Hz to 24 Hz. Pressure gauge at P5 was replaced. System sampled on 10/30/19.	
Totals - October 2019 ⁽¹⁾										NA ⁽¹⁾	NA	30	NA ⁽¹⁾		503880	11.7	0.008					
11/1/2019	GWTT	Yes	--	--	15	2	19	19	5.00	24.5	NA	1	NR	53.26	2126340	4160	2.9	--	Yes	No	Conducted system checks, changed bag filters, and adjusted the VFD frequency.	
11/2/2019	GWTT	Yes	--	--	26	8	21	17	4.28	23.80	NA	4	NR	66.37	2133970	3830	6.9	--	Yes	No	Conducted system checks, changed bag filters, and the VFD was adjusted from 30 Hz to 20 Hz.	
11/3/2019	GWTT	Yes	--	--	25	10	30	27	5.70	33.1	16.6	7	NR	44.0	2047122	--	--	--	Yes	No	Conducted system checks, changed bag filters, exchanged P flow meter for P2 pulse turbine flow meter/totalizer. Adjusted the VFD from 29 Hz to 34 Hz on departure.	
11/11/2019	GWTT	Yes	--	--	32	18	31	35	3.70	33.1	16.6	11	35	NR	2119390	77268	13.4	0.0037	Yes	Yes	Conducted system checks, changed bag filters, VFD left at 34 Hz. Force main influent flow was split; temporary GWTPS expansion system started. System sampled on 11/12/19.	
11/15/2019	GWTT	Yes	--	--	32	21	32	36	4.47	27.4	13.7	14	43	NR	2198928	71438	16.5	0.0058	Yes	No	Conducted system checks, changed bag filters, adjusted VFD from 34 Hz to 38 Hz on departure.	
11/18/2019	GWTT	Yes	--	--	40	30	42	46	4.43	27.4	13.8	17	37	NR	2271200	82014	19.1	0.0081	Yes	No	Conducted system checks, changed bag filters, adjusted VFD from 38 Hz to 39 Hz upon departure.	
11/22/2019	GWTT	Yes	--	--	42	27	41	45	3.50	35.0	17.5	21	33	NR	2391315	118113	20.5	0.0108	Yes	No	Conducted system checks, changed bag filters, VFD kept at 39 Hz. Cleaned sludge out of bottom of sight glass on EQ tank.	
11/25/2019	GWTT	Yes	--	--	43	32	43	46	4.90	31.4	15.3	24	42	NR	2486460	90343	23.2	0.0133	Yes	No	Conducted system checks, changed bag filters, VFD kept at 39 Hz.	
11/26/2019	GWTT	Yes	--	--	45	32	44	48	6.10	29.7	14.9	28	39	NR	2601976	115318	20.0	0.0141	Yes	No	Conducted system checks, changed bag filters.	
Totals - November 2019 ⁽¹⁾										30.1	15.0	29	NR ⁽¹⁾		598854	27.6	0.016					
12/2/2019	BETA	Yes	--	--	--	--	--	--	--	--	--	--	--	--	268058	8112	25.8	0.005	No	No	System shutdown at 10:00 for force main de-scale process.	
12/4/2019	BETA	No	--	--	--	--	52	60	6.55	26.9	13.5	2	NR	2685088	0	0.0	0.000	Yes	No	Bag filters changed prior to system restart. System (PWW 4 and system) restarted at 12:12 following the force main de-scale and purging process. Collected post-bag filter checks after system restart.		
12/6/2019	GWTT	Yes	--	--	55	25	52	58	2.17	62.0	31.0	4	50	NR	2730900	50812	17.6	0.001	Yes	No	Conducted system checks, flow into system #2 shutoff PWW 4 due to high-level alarm. Changed the bag filters, and adjusted the VFD from 44 Hz to 46 Hz.	
12/9/2019	GWTT	Yes	--	--	59	22	58	63	2.12	62.0	31.0	7	50	NR	285435.0	118235	27.4	0.002	Yes	No	Conducted system checks, changed bag filters, adjusted VFD to 48 Hz to increase the discharge effluent flow rate. GWTT communicated that carbon vessels should be backwashed since the differential pressure between P3 and P4 is 50 psi.	
12/13/2019	GWTT	Yes	--	--	64	66	45	71	1.95	62.8	31.4	11	--	48.0	3002960.0	148125	25.7	0.003	Yes	No	Conducted system checks, changed bag filters, adjusted VFD from 48 Hz to 49 Hz (49 GPM) at departure. GWTT noted the pressure on the carbon vessels was approaching their maximum limit.	
12/16/2019	GWTT	Yes	--	--	66	70	56	74	2.02	60.6	30.3	14	--	40.0	3122091.0	119831	27.7	0.004	Yes	Yes	Conducted system pressure checks, changed bag filters, adjusted the VFD from 49 Hz to 50 Hz (50 GPM). GWTT noted the pressure on the carbon vessels was approaching their maximum limit. System sampled on 12/17/19.	
12/20/2019	GWTT	Yes	--	--	45	63	41	67	NR	NR	NR	18	--	16.00	3239075.0	119884	20.3	0.004	Yes	No	Conducted system pressure checks and changed bag filters and adjusted the VFD from 40 Hz to 47 Hz. Water waste from force main discale process removed from totes off site by Global Cycle.	
12/23/2019	GWTT	Yes	--	--	NR	NR	NR	NR	NR	NR	NR	21	--	NR	--	--	--	--	No	No	System shutdown for carbon chargeout at 08:00. Spent carbon removed from both vessels and replaced with new virgin carbon.	
12/26/2019	GWTT	No	--	--	NR	11	NR	14	2.25	54.4	27.2	22	--	NR	3317372.0	78297	54.4	0.012	Yes	No	System restarted and reequilibrated at 08:00 following carbon chargeout and carbon hydration. Conducted system pressure checks, changed bag filters, adjusted the VFD to 23 Hz upon departure.	
12/30/2019	GWTT	Yes	--	--	19	11	6	13	2.42	50.4	25.3	26	--	52.00	3460145.0	142773	24.8	0.006	Yes	No	Conducted system checks and changed bag filters, VFD at 26 Hz.	
Totals - December 2019 ⁽¹⁾										54.2	27.1	27	39.0		858169	22.1	0.006					
1/2/2020	GWTT	Yes	--	--	18	8	14	15	2.37	51.8	25.9	3	--	49.00	3588009.0	127864	29.6	0.001	Yes	No	Conducted system checks and changed bag filters, and adjusted VFD.	
1/6/2020	GWTT	Yes	--	--	18	11	14	15	2.92	42.0	21.0	6	--	45.00	3692880.0	104871	24.2	0.002	Yes	No	Conducted system checks and changed bag filters, and adjusted VFD.	
1/10/2020	GWTT	Yes	--	--	21	12	17	20	3.00	40.8	20.4	10	--	46.00	3809788.0	117388	20.4	0.003	Yes	No	Conducted system checks and changed bag filters, VFD at 27 Hz.	
1/13/2020	GWTT	Yes	--	--	21	16	16	21	3.35	36.6	18.3	13	--	39.00	3899180.0	89392	20.7	0.004	Yes	No	Conducted system checks and changed bag filters.	
1/17/2020	GWTT	Yes	--	--	25	20	23	26	3.62	33.9	16.9	17	--	24.00	3992818.0	63638	16.3	0.004	Yes	Yes	Conducted system checks and changed bag filters. Adjusted VFD to 33 Hz. Flushed iron sludge/sediment out of bottom of sight glass on EQ holding tank.	
1/20/2020	GWTT	Yes	--	--	28	21	26	29	3.97	30.9	15.4	20	--	37.00	4065780.0	72962	16.9	0.005	Yes	No	Conducted system checks and changed bag filters.	
1/24/2020	GWTT	Yes	--	--	29	22	27	30	5.13	23.9	11.9	24	--	34.00	4150380.0	84400	14.7	0.005	Yes	No	Conducted system checks and changed bag filters.	
1/26/2020	GWTT	Yes	--	--	26	24	25	28	5.75	21.3	10.7	27	--	39.00	4201533.0	59573	12.9	0.005	Yes	No	Conducted system checks and changed bag filters.	
1/31/2020	GWTT	Yes	--	--	28	23	26	30	6.80	18.0	9.0	31	--	36.00	4272375.0	66627	11.6	0.005	Yes	No	Conducted system checks, changed bag filters, cleaned sight glass on EQ tank; about 4-5 inches of sludge accumulated at bottom.	
Totals - January 2020 ⁽¹⁾										89.2	36.6	39.9	38.8		812206	16.8	0.009					
2/4/2020	GWTT	Yes	--	--	28	22	26	30	6.00	15.3	7.7	4	--	36.00	4325997	125044	20.9	0.002	Yes	No	Conducted system checks and changed bag filters.	
2/7/2020	GWTT	Yes	--	--	26	25	24	28	7.90	15.5	7.8	7	--	38.00	4360208	34211	7.9	0.001	Yes	No	Conducted system checks and changed bag filters.	
2/11/2020	GWTT	Yes	--	--	26	25	26	30	11.07	11.1	5.5	11	--	43.00	4399300	39092	6.8	0.001	Yes	No	Conducted system checks and changed bag filters. Backwashed primary LGAC vessel, adjusted transfer pump from 33 Hz to 23 Hz after backwash.	
2/13/2020	GWTT	Yes	--	--	9	8	7	9	12.33	9.9	5.0	13	--	42.00	4415200	18900	6.6	0.002	Yes	Yes	Conducted system checks and changed bag filters. Adjusted transfer pump from 33 Hz to 23 Hz, recycled backwash water into GWTS #2 for treatment.	
2/18/2020	GWTT	Yes	--	--	12	6	8	9	16.63	7.4	3.7	18	--	42.00	4484815	36615	5.1	0.002	Yes	No	Conducted system checks and changed bag filters.	
2/21/2020	GWTT	Yes	--	--	10	8	9	11	22.67	5.4	2.7	21	--	40.00	4471238	16423	3.8	0.002	Yes	No	Conducted system checks and changed bag filters.	
2/24/2020	GWTT	Yes	--	--	15	5	13	15	2.45	46.2	23.1	24	--	44.00	4496425	19187	4.4	0.002	Yes	No	Conducted system checks and changed bag filters. Bag filters packed with significant iron-oxide sediments, influent flow rate into EQ tank significantly increased, slug of iron-oxide must have broke through from accumulation in the force main. Adjusted VFD from 23 Hz to 30 Hz.	
2/26/2020	GWTT	Yes	--	--	25	10	20	24	2.80	47.1	23.6	26	--	37.00	4519500	29075	10.1	0.005	Yes	No	Conducted system checks and change bag filters. Increase discharge flow through VFD from 30 Hz to 35 Hz. Pressure readings at primary LGAC vessel indicating a need for a backwash.	
2/28/2020	GWTT	Yes	--	--	29	10	13	15	3.55	48.0	24.0	28	--	52.00	4556491	34991	12.8	0.007	Yes	No	Conducted system checks and change bag filters. Conducted a backwash on primary LGAC vessel. Initial instantaneous Effluent flow rate was measured at P5 GPM after backwash. Adjusted VFD from 35 Hz to 28 Hz.	
Totals - February 2020 ⁽¹⁾										22.9	11.4	29	47.6		350738	8.4	0.004					
3/2/2020	GWTT	Yes	--	--	21	6	12	14	2.83	43.2	21.6	2	--	46.00	4665525	89034	20.6	0.001	Yes	Yes	Conducted system checks, changed bag filter, pumped water from large exterior tote through GWTS #2. System sampled on 3/3/2020.	
3/6/2020	GWTT	Yes	--	--	19	10	16	19	3.00	40.8	20.4	6	--	38.00	4723654	78129	13.6	0.002	Yes	No	Conducted system checks, changed bag filters, adjusted VFD from 26 Hz to 30 Hz.	
3/9/2020	GWTT	Yes	--	--	25	18	11	15	3.00	40.8	20.4	9	--	51.00	4785425	61771	14.3	0.003	Yes	No	Conducted system checks, changed bag filters, at departure, instantaneous effluent flow rate at S1 gpm (81 Hz).	
3/13/2020	GWTT	Yes	--	--	23	8	13	16	3.23	37.9	18.9	13	--	51.00	4898555	115130	19.6	0.005	Yes	No	Conducted system checks, changed bag filters.	
3/16/2020	GWTT	Yes	--	--	23	9	14	17	3.75	32.7	16.3	16	--	50.00	4968818	70263	16.3	0.005	Yes	No	Conducted system checks, changed bag filters.	
3/20/2020	GWTT	Yes	--	--	25	9	18	21	3.80	34.0	17.0	20	--	42.00	5052480	83862	14.5	0.006	Yes	No	Conducted system checks, changed bag filters, backwashed the primary LGAC vessel, adjusted the VFD from 30 Hz to 25 Hz, 42 GPM. Observed significant iron-oxide sedimentation accumulation in EQ tank.	
3/23/2020	GWTT	Yes	--	--	17	9	15	17	3.00	40.8	20.4	23	--	48.00	5097786	43505	10.5	0.005	Yes	No	Conducted system checks had to change the bag filters twice because the accumulated iron-oxide sediment in the EQ tank is getting pulled into the transfer pump affecting total gallons treated. Sight glass on EQ tank was flushed. Adjusted VFD from 25 Hz to 38 Hz.	
3/26/2020	GWTT	Yes	--	--	34	11	27	29	3.00	40.8	20.4	26	--	48.00	518030	45745	15.2	0.008	Yes	No	Conducted system checks, changed bag filters and increased the VFD from 35	

Table 2A - Summary of Groundwater Pump and Treatment System Operating and Maintenance Data - System No. 1 (GWTS #1)
Barnstable County Fire and Rescue Training Academy
155 First Rock Road Barnstable, MA
01914-24178

Date	Operator	System Operating on Arrival	Influent Bag Filter Differential Pressure (psi) *		Pre-Filter Changeout Differential Pressure (psi)		Post-Filter Changeout Differential Pressure (psi)		INFLUENT			EFFLUENT					Estimated Total PFAs Removal (kg) [†]	System Operating on Departure	System Sampled	Comments	
			Pre	Post	Group: P1	Group: P2	Group: P1	Group: P2	4" Influent Tank Fill Rate (in)	Combined Instantaneous Estimated Influent Flow Rate (GPM) [‡]	Estimated Instantaneous Influent Flow Rate (GPM) [‡]	Days System Operating	Instant Effluent Flow Rate (GPM) [§]	Instantaneous Effluent Flow Rate (GPM) [§]	Totalizer (Gal)	Net Gallons Treated					Average Effluent Flow Rate (GPM) [§]
4/2/2020	GWTT	Yes	--	--	34	30	31	35	2.95	41.5	36.8	2	--	51.00	536740	40545	14.1	0.000	Yes	No	Conducted system checks and changed bag filters.
4/6/2020	GWTT	Yes	--	--	33	33	31	35	3.12	39.3	19.7	6	--	50.00	539280	49540	8.6	0.001	Yes	No	Conducted system checks and changed bag filters. Transfer pump VFD at 40 Hz.
4/9/2020	GWTT	Yes	--	--	--	--	15	16	5.47	35.3	17.7	8.5	--	49.00	543345	59665	16.5	0.002	Yes	No	System shutdown for 2.4 hours at 7am for vac out of EQ tank and backwash of primary carbon vessel. Global removed 2.989 gallons of iron-oxide water mixture from EQ tank and exterior totes. Conducted system checks and changed bag filters. Adjusted VFD from 40 Hz (14 gpm) to 28 Hz (49 gpm).
4/13/2020	GWTT	Yes	--	--	16	10	11	15	3.92	31.3	15.6	12.5	--	44.00	549760	83615	14.5	0.002	Yes	No	Conducted system checks and changed bag filters.
4/16/2020	GWTT	Yes	--	--	18	15	15	19	4.52	28.4	14.2	15.5	--	35.00	552940	55580	12.9	0.003	Yes	No	Conducted system checks and changed bag filters.
4/20/2020	GWTT	Yes	--	--	19	14	19	23	5.00	24.5	12.3	19.5	--	30.00	563040	67198	11.7	0.003	Yes	No	Conducted system checks and changed bag filters. Adjusted VFD from 28 Hz to 32 Hz to allow higher pressure/flow through bag filters to help with iron-oxide sediment fouling.
4/24/2020	GWTT	Yes	--	--	26	21	26	30	6.56	23.7	11.7	23.5	--	26.00	567610	59562	16.3	0.003	Yes	No	Conducted system checks and changed bag filters. adjusted the VFD from 32 Hz to 35 Hz.
4/27/2020	GWTT	Yes	--	--	30	28	30	34	6.37	19.2	9.6	26.5	--	28.00	572332	43522	10.1	0.003	Yes	Yes	Conducted system checks and changed bag filters. System sampled on 4/28/2020.
Totals - April 2020 ^{†††}									30.4	15.2	29.5	--	39.6	--	458937	--	10.8	0.004	--	--	--
5/1/2020	GWTT	Yes	--	--	31	26	31	35	3.75	32.7	16.3	1	--	26.00	576710	33578	23.3	0.0003	Yes	No	Conducted system checks and changed bag filters.
5/5/2020	GWTT	Yes	--	--	31	20	30	35	3.40	36.0	18.0	5	--	26.00	577238	15668	2.7	0.0002	Yes	No	Conducted system checks and changed bag filters.
5/6/2020	GWTT	Yes	--	--	33	24	14	15	3.98	36.2	18.1	8	--	48.00	581402	71022	16.4	0.0015	Yes	No	Conducted system checks and changed bag filters. Backwashed primary LGAC vessel. adjusted transfer pump from 35 Hz to 30 Hz after backwash.
5/10/2020	GWTT	Yes	--	--	24	11	17	20	3.72	33.0	16.5	11	--	47.00	603710	79310	18.4	0.0024	Yes	No	Conducted system checks and changed bag filters.
5/15/2020	GWTT	Yes	--	--	27	16	24	28	4.80	25.5	16.5	15	--	35.00	603638	89928	15.6	0.0027	Yes	No	Conducted system checks and changed bag filters.
5/16/2020	GWTT	Yes	--	--	26	26	25	30	4.40	26.4	16.5	16	--	35.00	605120	62682	14.5	0.0031	Yes	No	Conducted system checks and changed bag filters. System sampled on 5/21/2020.
5/20/2020	GWTT	Yes	--	--	30	27	34	40	5.10	24.0	16.5	22	--	32.00	616187	78867	13.7	0.0035	Yes	Yes	Conducted system checks and changed bag filters. Adjusted VFD from 35 Hz to 38 Hz.
5/26/2020	GWTT	Yes	--	--	35	24	34	40	4.15	29.5	16.5	26	--	32.00	619639	42182	7.3	0.0022	Yes	No	Conducted system checks and changed bag filters.
5/29/2020	GWTT	Yes	--	--	32	36	32	37	4.15	29.5	16.5	29	--	35.00	623117	25043	5.9	0.0020	Yes	No	Conducted system checks and changed bag filters.
Totals - May 2020 ^{†††}									30.3	15.2	31	--	35.1	--	496880	--	11.2	0.0041	--	--	--
6/2/2020	GWTT	Yes	--	--	34	35	14	17	4.27	28.7	14.4	2	--	46.00	623077	9165	3.2	0.000	Yes	No	Conducted system checks and changed bag filters. Backwashed primary LGAC vessel. Transfer pump flow rate initially at 68 gpm after backwash. Adjusted VFD from 38 Hz to 30 Hz.
6/5/2020	GWTT	Yes	--	--	24	5	15	19	3.47	35.3	17.7	5	--	40.00	627600	43023	10.0	0.000	Yes	No	Conducted system checks and changed bag filters.
6/9/2020	GWTT	Yes	--	--	24	10	19	24	3.85	31.8	15.9	9	--	40.00	633435	60745	10.5	0.001	Yes	No	Conducted system checks and changed bag filters. Adjusted VFD from 30 Hz to 35 Hz.
6/12/2020	GWTT	Yes	--	--	31	16	28	32	4.12	29.6	14.9	12	--	36.00	640410	70465	16.3	0.002	Yes	No	Conducted system checks and changed bag filters.
6/16/2020	GWTT	Yes	--	--	22	24	30	35	4.47	26.3	13.1	16	--	47.00	649549	90639	15.7	0.002	Yes	No	Conducted system checks and changed bag filters. Adjusted VFD to 30 Hz and backwashed primary LGAC vessel.
6/16/2020	GWTT	Yes	--	--	22	8	14	18	5.00	24.5	12.3	19	--	43.00	650815	73366	17.0	0.003	Yes	No	Conducted system checks and changed bag filters. Adjusted VFD to 32 Hz.
6/22/2020	GWTT	Yes	--	--	24	14	19	24	5.72	21.4	10.7	22	--	36.00	663380	65565	15.2	0.003	Yes	No	Conducted system checks and changed bag filters. Adjusted VFD to 36 Hz.
6/25/2020	GWTT	Yes	--	--	24	19	22	25	5.63	21.7	10.9	25	--	40.00	669810	56430	13.1	0.003	Yes	No	Conducted system checks and changed bag filters. Adjusted VFD to 32 Hz. System samples collected on 6/24/2020.
6/26/2020	GWTT	Yes	--	--	27	18	13	15	5.15	23.8	11.9	29	--	43.00	674632	74823	12.9	0.003	Yes	No	Conducted system checks and changed bag filters twice. backwashed primary LGAC vessel. and flushed iron-oxide sediment from sight glass on EQ tank.
Totals - June 2020 ^{†††}									27.8	13.5	30	--	40.6	--	543421	--	12.6	0.0036	--	--	--
7/2/2020	GWTT	Yes	--	--	25	13	20	25	4.40	26.4	13.3	2	--	39.00	683710	72777	25.3	0.001	Yes	No	Conducted system checks and changed bag filters. Adjusted VFD from 32 Hz to 34 Hz.
7/6/2020	GWTT	Yes	--	--	36	19	36	24	4.97	24.7	12.3	6	--	36.00	691319	75559	13.1	0.001	Yes	No	Conducted system checks and changed bag filters. flushed out sight glass on the EQ tank. Adjusted VFD to 34 Hz.
7/16/2020	GWTT	Yes	--	--	24	24	22	28	4.97	24.7	12.3	10	--	39.00	694805	35436	6.2	0.001	Yes	No	Conducted system checks and changed bag filters. Adjusted VFD to 38Hz.
7/13/2020	GWTT	Yes	--	--	28	26	26	32	5.28	23.2	11.6	13	--	42.00	696929	48124	11.2	0.002	Yes	No	Conducted system checks and changed bag filters. Adjusted VFD to 38Hz.
7/14/2020	GWTT	Yes	--	--	32	33	11	15	6.63	20.3	10.2	16	--	44.00	706815	43886	10.2	0.002	Yes	No	Conducted system checks and changed bag filters and adjusted VFD to 28 Hz. Conducted a backwash of primary LGAC vessel after initial readings. Reduced the transfer pump speed to reduce carry over of the iron-oxide sedimentation from the EQ tank into the bag filters and LGAC vessels.
7/20/2020	GWTT	Yes	--	--	13	11	6	13	6.57	18.1	9.5	26	--	41.00	7091010	50195	6.7	0.002	Yes	No	Conducted system checks and changed bag filters. filters and LGAC vessels.
7/24/2020	GWTT	Yes	--	--	15	12	11	16	7.20	17.0	8.5	24	--	39.00	713921	38281	6.6	0.002	Yes	No	Conducted system checks and changed bag filters. VFD at 39 Hz.
7/27/2020	GWTT	Yes	--	--	18	8	11	15	7.50	16.3	8.2	27	--	40.00	716929	11658	2.7	0.001	Yes	Yes	Conducted system checks and changed bag filters. System sampled on 7/28/2020.
7/30/2020	GWTT	Yes	--	--	12	14	11	15	8.30	18.0	9.0	30	--	40.00	718146	20536	4.8	0.002	Yes	No	Conducted system checks and changed bag filters.
Totals - July 2020 ^{†††}									25.1	10.5	31	--	40.0	--	596632	--	6.9	0.0037	--	--	--
8/4/2020	GWTT	Yes	--	--	22	2	16	18	6.43	19.0	9.5	4	--	38.00	718115	29950	4.5	0.000	Yes	No	Conducted system checks and changed bag filters twice due to excess iron-oxide precipitate carry over from accumulation in EQ tank. Adjusted VFD to 32Hz.
8/7/2020	GWTT	Yes	--	--	27	11	22	27	6.58	19.2	9.6	7	--	31.00	722901	49676	9.4	0.001	Yes	No	Conducted system checks and changed bag filters. flushed out sight glass on the EQ tank.
8/10/2020	GWTT	Yes	--	--	27	13	24	29	6.52	18.8	9.4	10	--	25.00	728613	41522	9.8	0.001	Yes	No	Conducted system checks and changed bag filters twice due to iron-oxide accumulation in the EQ tank. tank needs to be emptied. System shutdown on 8/12/2020 for carbon changeout.
gpl																					
8/14/2020	GWTT	Yes	--	--	--	--	0	3	6.95	17.6	8.8	12	--	44.00	7307487	33834	13.2	0.001	Yes	No	Restarted system after carbon changeout. Conducted system checks and changed bag filters. Adjusted VFD to 28Hz.
8/15/2020	GWTT	Yes	--	--	18	5	9	7	1.90	17.8	8.8	15	--	36.00	736094	52637	12.2	0.002	Yes	No	Conducted system checks and changed bag filters twice.
8/20/2020	GWTT	No	--	--	17	5	8	10	7.07	17.3	8.7	18	--	36.00	740540	45376	10.5	0.002	Yes	No	Conducted system checks and changed bag filters twice. Transfer pump off on arrival due to high level alarm in EQ tank.
8/24/2020	GWTT	Yes	--	--	16	7	7	11	7.96	15.3	7.7	32	--	36.00	746749	64309	11.2	0.002	Yes	No	Conducted system checks and changed bag filters.
8/28/2020	GWTT	Yes	--	--	16	7	10	11	7.42	16.5	8.3	26	--	30.00	752570	55951	9.7	0.002	Yes	No	Conducted system checks and changed bag filters. System sampled on 8/27/2020. Iron sediment vacuum pumped out from the EQ tank on 8/27/2020.
8/31/2020	GWTT	Yes	--	--	16	7	9	13	7.47	16.0	8.0	29	--	34.00	757547	49721	11.5	0.003	Yes	No	Conducted system checks and changed bag filters.
Totals - August 2020 ^{†††}									17.5	8.7	29	--	34.7	--	413956	--	9.9	0.003	--	--	--
9/4/2020	GWTT	Yes	--	--	16	7	9	13	9.75	12.4	6.3	4	--	32.00	763205	60784	10.6	0.001	Yes	No	Conducted system checks and changed bag filters.
9/6/2020	GWTT	Yes	--	--	16	10	8	15	8.88	17.8	8.9	8	--	36.00	768606	47860	8.3	0.001	Yes	No	Conducted system checks and changed bag filters. Increased VFD to 28 Hz.
9/11/2020	GWTT	Yes	--	--	10	10	5	10	8.60	14.2	8.9	11	--	36.00	771395	29830	6.9	0.001	Yes	No	Conducted system checks and changed bag filters.
9/15/2020	GWTT	Yes	--	--	11	10	6	5	9.33	13.1	8.9	15	--	46.00	775139	37244	6.5	0.001	Yes	No	Conducted system checks and changed bag filters. Backwashed primary carbon vessel.
9/18/2020	GWTT	Yes	--	--	7	9	2	6	11.05	11.1	8.9	16	--	45.00	777921	22782	5.3	0.001	Yes	No	Conducted system checks and changed bag filters.
9/21/2020	GWTT	Yes	--	--	6	7	6	7	11.28	10.9	8.9	21	--	43.00	779640	20719	4.8	0.001	Yes	No	Conducted system checks and changed bag filters.
9/25/2020	GWTT	Yes	--	--	2	5	2	5	12.53	9.8	8.9	25	--	43.00	781800	22160	3.8	0.001	Yes	No	Conducted system checks and changed bag filters. System samples collected on September 23, 2020.
9/28/2020	GWTT	Yes	--	--	2	6	2	7	12.18	10.1	8.9	28	--	43.00	782753	10953	2.5	0.001	Yes	No	Conducted system checks and changed bag filters.
Totals - September 2020 ^{†††}									12.6	6.2	30	--	40.5	--	252352	--	5.8	0.002	--	--	--
10/2/2020	GWTT	Yes	--	--	2	5	0	5	13.63	9.6	4.5	2	--	43.00	788649	8796	3.1	0.0009	Yes	No	Conducted system checks and changed bag filters.
10/5/2020	GWTT	Yes	--	--	16	7	5	10	12.77	9.8	4.8	5	--	40.00							

Table 2A - Summary of Groundwater Pump and Treatment System Operating and Maintenance Data - System No. 1 (GWTS #1)
Barnstable County Fire and Rescue Training Academy
155 First Rock Road Barnstable, MA
01914-26178

Date	Operator	System Operating on Arrival	Influent Bag Filter Differential Pressure (psi)		Pre-Filter Changeout Differential Pressure (psi)		Post-Filter Changeout Differential Pressure (psi)		4" Influent Tank Fill Rate (min)		PRW-3/4		Days System Operating	PRW-4/5		Estimated Total PFAs Removal (kg)	System Operating on Departure	System Sampled	Comments			
			Pre	Post	Gauge P1	Gauge P2	Gauge P1	Gauge P2	Combined Instantaneous Estimated Influent Flow Rate (GPM)	Estimated Instantaneous Influent Flow Rate (GPM)	Instant Effluent Flow Rate (GPM)	Instantaneous Effluent Flow Rate (GPM)		Totalizer (Gal)	Net Gallons Treated					Average Effluent Flow Rate (GPM)		
11/2/2020	GWTT	Yes	--	--	10	12	10	13	22.87	5.4	2.7	2	--	36.00	809094	11173	2.6	0.00008	Yes	No	Conducted system checks and changed bag filters.	
11/6/2020	GWTT	Yes	--	--	8	12	8	13	24.83	4.9	2.5	6	--	36.00	8101590	8496	1.5	0.00013	Yes	No	Conducted system checks and changed bag filters.	
11/6/2020	GWTT	Yes	--	--	18	12	12	16	19.80	6.2	3.1	9	--	32.00	8121953	20363	4.7	0.00063	Yes	No	Conducted system checks and changed bag filters.	
11/13/2020	GWTT	No	--	--	--	--	--	--	--	--	--	12	--	--	8130535	8582	1.5	--	No	No	GWTT observed no influent flow coming into the EU tank. GWTT inspected the electrical components at PRW-4 and reset the power. After power reset, electrical current was at 77.6 and power tripped and shut off. GWTT operator suggest the pump has locked up or the motor has failed. GWTT shut down both systems.	
System Shutdown due to pump failure at recovery well PRW-4. pump replaced on 11/20/2020.																						
11/24/2020	GWTT	Yes	--	--	--	--	16	16	2.05	59.8	29.9	13	--	50.00	8133427	2892	2.0	0.00039	Yes	Yes	Following the replacement of the well pump at PRW-4 on 11/20/2020, GWTT restarted both systems, adjusted the transfer pump flow rate (38 Hz), changed the bag filters twice.	
11/27/2020	GWTT	Yes	--	--	15	18	14	17	1.90	64.5	32.2	16	--	55.00	8146996	13571	3.1	0.00075	Yes	No	Following the replacement of the well pump at PRW-4 on 11/20/2020, GWTT restarted both systems, adjusted the transfer pump flow rate (38 Hz), changed the bag filters twice.	
Totals - November 2020 ⁽¹⁾⁽²⁾																						
12/1/2020	GWTT	Yes	--	--	15	16	12	17	1.87	65.6	32.8	1	--	54.00	8173878	26880	4.7	0.00004	Yes	No	Conducted system checks and changed bag filters. Transfer pump off on arrival due to high level in EU tank.	
12/5/2020	GWTT	Yes	--	--	--	--	18	21	1.95	62.8	31.4	3	--	52.00	8254942	81064	26.1	0.00081	Yes	No	System shutdown briefly to vacuum out the exterior holes, both EU tanks, bag filters, and drums. Conducted system checks and changed bag filters.	
12/7/2020	GWTT	Yes	--	--	39	15	23	27	1.88	66.0	32.5	7	--	48.00	8376226	115278	20.0	0.00135	Yes	No	Conducted system checks and changed bag filters.	
12/11/2020	GWTT	Yes	--	--	37	19	6	9	1.85	66.2	33.1	11	--	51.00	8478659	108439	18.8	0.00199	Yes	No	Conducted system checks and changed bag filters. Backwashed the primary carbon vessel. Adjusted VFD from 38 Hz to 32 Hz to maintain maximum contact time through carbon vessels.	
12/15/2020	GWTT	Yes	--	--	15	9	8	10	1.95	62.8	31.4	15	--	48.00	8586950	108241	18.8	0.00271	Yes	No	Conducted system checks and changed bag filters.	
12/16/2020	GWTT	Yes	--	--	20	15	18	18	1.87	65.8	32.8	18	--	48.00	8600113	108113	24.3	0.00421	Yes	No	Conducted system checks and changed bag filters. Increased transfer pump speed from 32 Hz to 35 Hz.	
12/21/2020	GWTT	Yes	--	--	--	--	--	--	--	--	--	21	--	--	8719488	102617	23.8	0.00480	Yes	Yes	Conducted system checks and changed bag filters. Increased transfer pump speed from 32 Hz to 35 Hz.	
12/24/2020	GWTT	Yes	--	--	34	12	14	17	2.13	57.4	28.7	24	--	54.00	8883418	98726	22.9	0.00527	Yes	No	Conducted system checks and changed bag filters. Increased transfer pump speed from 35 Hz to 38 Hz.	
12/28/2020	GWTT	Yes	--	--	35	24	3	8	2.33	52.5	26.3	28	--	52.00	9036828	123418	21.4	0.00577	Yes	No	Conducted system checks and changed bag filters. Conducted backwash of the primary carbon vessel, and reduced the speed on the transfer pump from 38 Hz to 33 Hz.	
Totals - December 2020 ⁽¹⁾⁽²⁾																						
1/1/2021	GWTT	Yes	--	--	--	--	25	10	10	2.08	47.4	23.7	1	--	48.00	9199170	102342	17.8	0.00013	Yes	No	Conducted system checks and changed bag filters. Increased the speed on the transfer pump from 33 to 38 Hz.
1/4/2021	GWTT	Yes	--	--	--	--	30	20	22	2.73	44.8	22.4	4	--	48.00	9221193	102023	23.6	0.00068	Yes	No	Conducted system checks and changed bag filters. Increased the speed on the transfer pump from 38 to 40 Hz.
1/8/2021	GWTT	Yes	--	--	40	28	32	38	2.83	43.2	21.6	8	--	35.00	9346620	124427	21.6	0.00124	Yes	No	Conducted system checks and changed bag filters.	
1/11/2021	GWTT	Yes	--	--	38	30	35	38	3.58	34.2	17.1	11	--	35.00	9432908	87280	20.2	0.00159	Yes	No	Conducted system checks and changed bag filters.	
1/15/2021	GWTT	Yes	--	--	40	39	3	8	3.35	36.4	18.2	15	--	47.00	9529432	94652	16.8	0.00180	Yes	No	Conducted system checks and changed bag filters. Conducted backwash of the primary carbon vessel, reduced discharge flow.	
1/18/2021	GWTT	Yes	--	--	28	14	19	22	2.78	44.0	22.0	18	--	46.00	9607077	77625	18.0	0.00231	Yes	No	Conducted system checks, changed bag filters twice, and increased VFD on transfer pump from 40 Hz to 42 Hz.	
1/22/2021	GWTT	Yes	--	--	43	28	12	15	3.28	37.3	18.7	22	--	55.00	9703680	146603	25.5	0.00400	Yes	No	Conducted system checks, changed bag filters, and reduced the VFD on the transfer pump from 42 Hz to 40 Hz.	
1/26/2021	GWTT	Yes	--	--	31	19	21	25	3.92	31.3	15.6	25	--	49.00	9842918	89238	20.7	0.00369	Yes	No	Conducted system checks, changed bag filters.	
1/28/2021	GWTT	Yes	--	--	32	22	25	29	3.85	31.8	15.9	29	--	45.00	9952387	109469	19.0	0.00294	Yes	Yes	Conducted system checks, changed bag filters. System sampled on 1/28/2021.	
Totals - January 2021 ⁽¹⁾⁽²⁾																						
2/2/2021	GWTT	Yes	--	--	32	32	20	30	4.48	26.7	13.2	2	--	45.00	1005648	103073	17.8	0.00055	Yes	No	Conducted system checks and changed bag filters. Transfer pump VFD set to 40 Hz.	
2/5/2021	GWTT	Yes	--	--	31	27	27	31	5.30	23.1	11.6	5	--	43.00	1012249	66789	15.5	0.00118	Yes	No	Conducted system checks and changed bag filters.	
2/8/2021	GWTT	Yes	--	--	32	27	28	32	6.45	19.0	9.5	8	--	43.00	1018042	64693	15.0	0.00183	Yes	No	Conducted system checks and changed bag filters.	
2/12/2021	GWTT	Yes	--	--	34	26	29	33	6.15	19.9	10.0	12	--	41.00	10241875	74933	13.0	0.00239	Yes	No	Conducted system checks and changed bag filters.	
2/19/2021	GWTT	Yes	--	--	29	28	26	31	9.78	12.5	6.3	19	--	41.00	1036740	106385	10.5	0.00507	Yes	No	Conducted system checks and changed bag filters.	
2/22/2021	GWTT	Yes	--	--	29	28	12	16	10.80	11.3	5.7	22	--	43.00	10403311	36751	8.4	0.00282	Yes	No	Conducted system checks and changed bag filters. Backwashed primary (GAC) vessel. Adjusted VFD from 40 Hz to 32 Hz (56 gpm to 43 gpm). System sampled on 2/23/2021.	
2/26/2021	GWTT	Yes	--	--	26	12	21	25	3.03	40.4	20.2	26	--	49.00	1048138	63827	11.1	0.00441	Yes	No	Conducted system checks and changed bag filters. Backwashed primary (GAC) vessel. Adjusted VFD from 40 Hz to 32 Hz (56 gpm to 43 gpm). System sampled on 2/23/2021.	
Totals - February 2021 ⁽¹⁾⁽²⁾																						
3/1/2021	GWTT	Yes	--	--	49	25	34	42	3.08	39.7	19.9	1	--	37.00	10556720	88682	20.5	0.00017	Yes	No	Conducted system checks and changed bag filters. Transfer pump VFD set to 40 Hz.	
3/5/2021	GWTT	Yes	--	--	52	13	24	29	4.55	26.9	13.5	5	--	47.00	10591055	194835	33.8	0.00136	Yes	No	Conducted system checks and changed bag filters. Pumped backwash water through system. Reduced transfer pump VFD from 47 Hz to 40 Hz.	
3/8/2021	GWTT	Yes	--	--	34	30	24	29	4.53	27.0	13.5	8	--	37.00	10663088	112033	25.9	0.00167	Yes	No	Conducted system checks and changed bag filters.	
3/12/2021	GWTT	Yes	--	--	12	15	11	15	2.53	48.4	24.2	12	--	47.00	11010835	147242	25.6	0.00247	Yes	No	Conducted system checks and changed bag filters. Global on site to vacuum out the contents of the exterior holes, EU tank, and bag filter unit. Both carbon vessels backwashed. VFD was adjusted 37 Hz.	
3/15/2021	GWTT	Yes	--	--	23	18	18	21	3.13	39.1	19.5	15	--	44.00	11027217	61687	14.3	0.00173	Yes	No	Conducted system checks and changed bag filters.	
3/18/2021	GWTT	Yes	--	--	28	22	23	27	3.12	39.3	19.7	19	--	42.00	11148901	76184	13.2	0.00202	Yes	No	Conducted system checks and changed bag filters.	
3/22/2021	GWTT	Yes	--	--	31	23	22	22	3.40	36.0	18.0	22	--	45.00	11180701	41800	9.7	0.00171	Yes	No	Conducted system checks and changed bag filters.	
3/26/2021	GWTT	Yes	--	--	32	26	25	30	3.62	33.9	16.9	26	--	40.00	11345388	52687	9.1	0.00191	Yes	No	Conducted system checks and changed bag filters.	
3/30/2021	GWTT	Yes	--	--	33	24	26	31	3.93	31.1	15.6	30	--	40.00	11380626	57217	9.9	0.00240	Yes	No	Conducted system checks and changed bag filters. Adjusted VFD 40 Hz.	
Totals - March 2021 ⁽¹⁾⁽²⁾																						
4/2/2021	GWTT	Yes	--	--	34	24	27	32	3.87	31.7	15.8	2	--	40.00	11337760	37145	8.6	0.00008	Yes	No	Conducted system checks and changed bag filters.	
4/6/2021	GWTT	Yes	--	--	34	24	14	18	4.13	29.4	14.8	6	--	40.00	11366906	29150	5.1	0.00015	Yes	No	Conducted system checks and changed bag filters. Backwashed primary carbon vessel. Adjusted VFD on transfer pump.	
4/9/2021	GWTT	Yes	--	--	21	9	10	14	4.23	28.9	14.5	9	--	40.00	11396263	29383	6.8	0.00029	Yes	No	Conducted system checks and changed bag filters.	
4/13/2021	GWTT	Yes	--	--	27	10	18	23	4.85	25.3	12.6	13	--	35.00	11454318	58035	10.1	0.00063	Yes	No	Conducted system checks and changed bag filters. Adjusted to 36 Hz.	
4/16/2021	GWTT	Yes	--	--	22	20	18	23	5.48	22.5	11.2	15	--	36.00	11480350	28732	10.0	0.00072	Yes	No	Conducted system checks and changed bag filters.	
4/19/2021	GWTT	Yes	--	--	22	22	21	26	6.47	18.9	9.5	19	--	35.00	11527165	44115	7.7	0.00070	Yes	No	Conducted system checks and changed bag filters.	
4/23/2021	GWTT	Yes	--	--	24	24	22	27	7.58	16.2	8.1	23	--	33.00	11564888	37723	6.5	0.00073	Yes	No	Conducted system checks and changed bag filters. System sampled on 4/21/2021.	
4/27/2021	GWTT	Yes	--	--	22	22	28	25	8.85	13.8	6.9	27	--	35.00	11596382	31494	5.5	0.00071	Yes	No	Conducted system checks and changed bag filters.	
4/30/2021	GWTT	Yes	--	--	23	23	20	25	10.02	12.2	6.1	30	--	34.00	11617474	23092	4.9	0.00071	Yes	No	Conducted system checks and changed bag filters.	
Totals - April 2021 ⁽¹⁾																						

Table 2A - Summary of Groundwater Pump and Treatment System Operating and Maintenance Data - System No. 1 (GWTS #1)
Barnstable County Fire and Rescue Training Academy
155 First Rock Road, Barnstable, MA
01914-2417

Date	Operator	System Operating on Arrival	Influent Bag Filter Differential Pressure (psi)		Pre-Filter Changeout Differential Pressure (psi)		Post-Filter Changeout Differential Pressure (psi)		4" Influent Tank Fill Rate (min)		Days System Operating	Influent Flow Rate (GPM)		Effluent Flow Rate (GPM)		Totalizer (Gal)	Net Gallons Treated	Average Effluent Flow Rate (GPM)	Estimated Total PFA Removal (kg)	System Operating on Departure	System Sampled	Comments
			Pre	Post	Gauge P1	Gauge P2	Gauge P1	Gauge P2	Combined Instantaneous Estimated Influent Flow Rate (GPM)	Estimated Instantaneous Influent Flow Rate (GPM)		Instant Effluent Flow Rate (GPM)	Instantaneous Effluent Flow Rate (GPM)									
5/4/2021	GWTT	Yes	--	--	23	23	21	26	12.42	9.9	4.9	4	--	32.00	11640226	22752	4.0	0.00010	Yes	No	Conducted system checks and changed bag filters.	
5/7/2021	GWTT	Yes	--	--	21	24	21	26	14.58	8.4	4.2	7	--	33.00	1165015	14789	3.4	0.00016	Yes	No	Conducted system checks and changed bag filters.	
5/10/2021	GWTT	Yes	--	--	33	13	27	32	2.87	42.7	21.4	10	--	34.00	11679915	24900	5.8	0.00038	Yes	No	Conducted system checks and changed bag filters.	
5/14/2021	GWTT	Yes	--	--	37	23	30	37	2.80	43.8	21.9	14	--	40.00	11775222	60217	6.0	0.00056	Yes	No	Conducted system checks and changed bag filters. Adjusted VFD on transfer pump from 36 Hz to 44Hz.	
5/21/2021	GWTT	Yes	--	--	31	31	28	34	3.02	40.6	20.3	21	--	44.00	11788910	73678	7.3	0.00102	Yes	No	Conducted system checks and changed bag filters.	
5/25/2021	GWTT	Yes	--	--	34	30	29	35	3.25	37.7	18.8	25	--	45.00	11851645	62735	10.9	0.00181	Yes	No	Conducted system checks and changed bag filters.	
5/28/2021	GWTT	Yes	--	--	34	30	29	35	3.72	33.0	16.5	28	--	51.00	11907070	55425	12.8	0.00239	Yes	No	Conducted system checks and changed bag filters and backwashed primary carbon vessel.	
Totals - May 2021 ¹⁰									30.9	15.4	31	--	39.9	--	314496	7.0	0.00015					
6/4/2021	GWTT	Yes	--	--	44	15	22	27	4.62	26.5	13.3	4	--	43.00	12042629	135759	13.5	0.00025	Yes	No	Conducted system checks and changed bag filters.	
6/8/2021	GWTT	Yes	--	--	30	12	17	23	4.88	25.1	12.5	8	--	35.00	12170560	132731	23.0	0.00086	Yes	No	Conducted system checks and changed bag filters.	
6/11/2021	GWTT	Yes	--	--	22	14	20	27	4.63	26.4	13.2	11	--	39.00	12248429	72869	16.9	0.00086	Yes	No	Conducted system checks and changed bag filters.	
6/16/2021	GWTT	Yes	--	--	41	20	32	39	4.77	25.7	12.8	16	--	36.00	12351444	175884	15.3	0.00114	Yes	No	Conducted system checks and changed bag filters. Adjusted VFD on transfer pump from 36 Hz to 44Hz.	
6/21/2021	GWTT	Yes	--	--	55	26	44	50	3.63	33.7	16.9	21	--	33.00	12613872	215443	15.0	0.00146	Yes	No	Conducted system checks and changed bag filters. Adjusted VFD to 48 Hz (max setting). Highest effluent flow rate observed at 38 gpm. Build up of iron oxide sediments in EQ tank affecting life of bag filters and secondary LGAC vessel is getting fouled with iron sediment.	
6/26/2021	GWTT	Yes	--	--	62	40	50	58	3.60	34.0	17.0	25	--	32.00	12649500	105628	18.3	0.00213	Yes	No	Conducted system checks and changed bag filters twice, pumped the contents from GWTS42 EQ tank into GWTS41 to process/treat remaining water.	
6/28/2021	GWTT	Yes	--	--	61	36	58	58	3.97	30.9	15.4	28	--	31.00	12647782	74282	17.2	0.00224	Yes	No	Conducted system checks and changed bag filters.	
Totals - June 2021 ¹¹									28.9	14.5	30	--	35.6	--	912096	21.1	0.00030					
7/1/2021	GWTT	Yes	--	--	61	36	30	30	4.15	29.5	14.8	1	--	34.00	12717226	67438	15.6	0.00008	Yes	No	Conducted system checks and changed bag filters.	
7/6/2021	GWTT	Yes	--	--	62	--	18	--	--	--	--	5	--	--	12825120	113900	15.8	0.00019	No	No	Shut system down for carbon change. System left off for LGAC to hydrate.	
7/6/2021	GWTT	Yes	--	--	--	--	--	--	4.33	28.3	14.1	6	--	29.00	12826465	1520	0.4	0.00001	Yes	No	Restarted system after carbon change. Conducted system checks and changed bag filters. Increased VFD to 29Hz and split force main to GWTS42.	
7/13/2021	GWTT	Yes	--	--	12	5	4	10	4.86	24.6	12.3	10	--	36.00	12905111	78471	13.6	0.00068	Yes	No	Conducted system checks and changed bag filters.	
7/20/2021	GWTT	Yes	--	--	13	6	3	9	6.40	19.1	9.6	17	--	27.00	13015338	110227	10.9	0.00092	Yes	No	Conducted system checks and changed bag filters.	
7/26/2021	GWTT	Yes	--	--	15	7	7	12	4.63	26.4	13.2	23	--	29.00	13079718	82580	9.6	0.00109	Yes	No	Conducted system checks and changed bag filters. Increased VFD to 29 Hz.	
7/30/2021	GWTT	Yes	--	--	19	10	0	6	3.90	31.4	15.7	27	--	30.00	13114728	76810	13.3	0.00179	Yes	No	Conducted system checks and changed bag filters. Reduced discharge flow rate via VFD to 25 Hz. Backwashed primary LGAC vessel.	
Totals - July 2021 ¹²									26.0	13.0	27	--	30.2	--	530946	13.7	0.0018					
8/3/2021	GWTT	Yes	--	--	14	5	5	10	3.95	31.0	15.5	3	--	30.00	13216148	41420	7.2	0.00008	Yes	No	Conducted system checks and changed bag filters.	
8/6/2021	GWTT	Yes	--	--	21	10	11	16	4.13	29.6	14.8	6	--	30.00	13277733	61225	14.2	0.00033	Yes	No	Conducted system checks, changed bag filters, flushed sight glass on EQ tank, increased discharge flow from 29Hz to 31Hz.	
8/9/2021	GWTT	Yes	--	--	19	13	12	18	4.88	26.2	13.1	9	--	28.00	13336080	58707	13.6	0.00047	Yes	No	Conducted system checks and changed bag filters.	
8/13/2021	GWTT	Yes	--	--	18	15	13	19	5.17	23.7	11.9	13	--	26.00	13401900	65820	11.4	0.00057	Yes	No	Conducted system checks and changed bag filters.	
8/20/2021	GWTT	Yes	--	--	22	10	13	19	4.90	25.0	12.5	20	--	30.00	13476045	74145	7.4	0.00057	Yes	No	Conducted system checks and changed bag filters. Increased discharge flow rate at VFD from 31 Hz to 33 Hz.	
8/24/2021	GWTT	Yes	--	--	20	12	10	16	4.57	26.8	13.4	24	--	32.00	13493440	17395	3.0	0.00028	Yes	Yes	Conducted system checks and changed bag filters. System sampled on 08/25/21.	
8/27/2021	GWTT	Yes	--	--	24	14	15	22	4.37	28.1	14.0	27	--	28.00	13538333	34893	8.1	0.00084	Yes	No	Conducted system checks and changed bag filters.	
8/30/2021	GWTT	Yes	--	--	27	18	20	26	4.73	25.9	12.9	30	--	32.00	13602762	54429	12.6	0.00145	Yes	No	Conducted system checks and changed bag filters. Increased discharge flow rate at VFD from 31 Hz to 38 Hz.	
Totals - August 2021 ¹³									27.0	13.5	31	--	29.5	--	608034	9.1	0.0011					
9/3/2021	GWTT	Yes	--	--	35	16	6	10	5.08	24.1	12.0	3	--	34.00	13647435	64673	11.2	0.00012	Yes	No	Conducted system checks and changed bag filters. Backwashed primary LGAC vessel. Reduced discharge flow rate at VFD from 38 Hz to 30 Hz.	
9/7/2021	GWTT	Yes	--	--	19	9	9	15	4.85	25.3	12.6	7	--	27.00	13710545	63110	11.0	0.00027	Yes	No	Conducted system checks, changed bag filters. Installed a Ferro boot around bottom drain pipe on primary carbon vessel, as rusted/corroded hole was observed and small leak was occurring.	
9/10/2021	GWTT	Yes	--	--	16	12	11	16	6.20	19.8	9.9	10	--	27.00	13751310	40765	9.4	0.00033	Yes	No	Conducted system checks and changed bag filters.	
9/14/2021	GWTT	Yes	--	--	20	12	13	19	7.22	17.0	8.5	14	--	24.00	13805195	53885	9.4	0.00046	Yes	No	Conducted system checks and changed bag filters.	
9/17/2021	GWTT	Yes	--	--	22	10	18	24	5.83	21.0	10.5	17	--	23.00	13844620	39425	9.1	0.00054	Yes	No	Conducted system checks and changed bag filters. Increased discharge flow rate at VFD from 30 Hz to 34 Hz.	
9/20/2021	GWTT	Yes	--	--	28	28	26	32	5.78	21.2	10.6	20	--	26.00	13924665	57845	13.4	0.00094	Yes	Yes	Conducted system checks and changed bag filters. Increased discharge flow rate at VFD from 34 Hz to 40 Hz.	
9/24/2021	GWTT	Yes	--	--	15	21	4	10	6.93	17.7	8.8	24	--	35.00	13991678	89213	15.5	0.00130	Yes	No	Conducted system checks and changed bag filters. Backwashed primary LGAC vessels.	
9/27/2021	GWTT	Yes	--	--	16	12	11	16	7.47	16.4	8.2	27	--	30.00	14049379	57701	13.4	0.00126	Yes	No	Conducted system checks and changed bag filters.	
Totals - September 2021 ¹⁴									20.3	10.1	30	--	28.3	--	466617	10.8	0.0011					
10/1/2021	GWTT	Yes	--	--	20	18	24	16	7.90	15.5	7.8	1	--	32.00	14122165	72786	12.6	0.00005	Yes	No	Conducted system checks and changed bag filters, discharge flow rate set to 32 Hz on VFD.	
10/5/2021	GWTT	Yes	--	--	22	20	21	19	7.62	16.1	8.0	5	--	32.00	14189595	67430	11.7	0.00023	Yes	No	Conducted system checks and changed bag filters. Second basket housing with the bag filter unit fell through due to corrosion. Temporarily covered/sealed the basket to maintain system operation. Two bag filter baskets visible.	
10/8/2021	GWTT	Yes	--	--	28	31	26	32	6.65	18.4	9.2	8	--	25.00	14244366	74771	17.3	0.00055	Yes	No	Conducted system checks and changed bag filters. Increased discharge flow rate at VFD from 35 Hz to 40 Hz.	
10/12/2021	GWTT	Yes	--	--	20	22	16	23	6.45	19.0	9.5	12	--	38.00	14291440	14774	2.6	0.00012	Yes	No	Conducted system checks and changed bag filters.	
10/15/2021	GWTT	Yes	--	--	19	23	18	24	6.35	19.3	9.6	15	--	38.00	14299125	13985	3.2	0.00019	Yes	No	Conducted system checks and changed bag filters.	
10/19/2021	GWTT	Yes	--	--	22	20	3	9	6.88	17.8	8.9	19	--	38.00	14311565	18440	3.2	0.00024	Yes	No	Conducted system checks and changed bag filters. Backwashed primary LGAC vessel and decreased discharge flow rate at VFD from 40 Hz to 30 Hz.	
10/22/2021	GWTT	Yes	--	--	15	5	2	8	7.03	17.4	8.7	22	--	37.00	14361329	53564	12.4	0.00108	Yes	No	Conducted system checks and changed bag filters.	
10/26/2021	GWTT	Yes	--	--	17	9	9	14	7.22	17.0	8.5	26	--	27.00	14426430	61281	10.6	0.00110	Yes	No	Conducted system checks and changed bag filters.	
10/29/2021	GWTT	Yes	--	--	19	12	11	18	8.97	13.7	6.8	29	--	24.00	14471740	45330	10.5	0.00121	Yes	No	Conducted system checks and changed bag filters.	
Totals - October 2021 ¹⁵									17.3	8.6	31	--	31.7	--	422261	9.5	0.0012					
11/2/2021	GWTT	Yes	--	--	22	16	15	20	9.67	12.7	6.3	2	--	22.00	14523865	61125	10.6	0.00010	Yes	No	Conducted system checks and changed bag filters.	
11/5/2021	GWTT	Yes	--	--	18	16	16	21	10.17	12.0	6.0	5	--	20.00	14575718	42853	9.9	0.00022	Yes	No	Conducted system checks and changed bag filters.	
11/8/2021	GWTT	Yes	--	--	21	15	16	22	9.95	12.3	6.2	8	--	19.00	14599615	23897	5.5	0.00020	Yes	No	Conducted system checks and changed bag filters.	
11/12/2021	GWTT	Yes	--	--	18	15	14	20	10.35	11.8	5.9	12	--	21.00	14620378	29789	4.5	0.00024	Yes	No	Conducted system checks and changed bag filters.	
11/15/2021	GWTT	Yes	--	--	16	16	14	19	10.00	12.3	6.1	15	--	22.00	1463862							

Table 2A - Summary of Groundwater Pump and Treatment System Operating and Maintenance Data - System No. 1 (GWTS #1)
Barnstable County Fire and Rescue Training Academy
155 First Rock Road, Barnstable, MA
01914-24179

Date	Operator	System Operating on Arrival	Influent Bag Filter Differential Pressure (psi) *		Pre-Filter Changeout Differential Pressure (psi)		Post-Filter Changeout Differential Pressure (psi)		INFLUENT			Days System Operating	EFFLUENT					Estimated Total PFAS Removal (kg) ³	System Operating on Departure	System Sampled	Comments
			Pre	Post	Gauge P1	Gauge P2	Gauge P1	Gauge P2	6" Influent Tank Fill Rate (in/hr)	Combined Instantaneous Estimated Influent Flow Rate (GPM) ⁴	Estimated Instantaneous Influent Flow Rate (GPM) ⁴		Instant Effluent Flow Rate (GPM) ⁴	Instantaneous Effluent Flow Rate (GPM) ⁴	Totalizer (Gal)	Net Gallons Treated	Average Effluent Flow Rate (GPM) ⁴				
12/3/2021	GWTT	Yes	--	--	22	16	15	20	2.03	60.2	30.1	3	--	32.00	14802915	50165	11.6	0.00014	Yes	No	Conducted system checks and changed bag filters.
12/7/2021	GWTT	Yes	--	--	32	29	30	31	2.05	59.8	29.9	7	--	34.00	14811935	69020	12.0	0.00034	Yes	No	Conducted system checks and changed bag filters.
12/9/2021	GWTT	Yes	--	--	31	31	31	21	2.08	58.8	29.4	9	--	30.00	14905699	33164	11.7	0.00042	Yes	No	Conducted system checks and changed bag filters. Global Cycle conducted a pump out of the exterior toiles and EO tanks. 3,190 gallons were removed for offsite disposal/treatment.
12/13/2021	GWTT	Yes	--	--	41	28	20	20	2.03	60.2	30.1	13	--	42.00	15005920	100221	17.4	0.00091	Yes	No	Conducted system checks and changed bag filters. Increased the discharge flow rate from 40Hz to 44 Hz.
12/16/2021	GWTT	Yes	--	--	23	13	15	10	2.02	60.7	30.4	16	--	42.00	15080111	74191	17.2	0.00111	Yes	Yes	Conducted system checks and changed bag filters. Effluent clean out pipe is leaking.
12/20/2021	GWTT	No	--	--	18	17	18	18	2.13	57.4	28.7	17	--	46.00	15122283	42172	7.3	0.00050	No	No	System was shutdown on 12/17/2021 due to leaking exterior effluent clean out piping. Wall flood piping from RW-4 was redirected to GWTS#2. GWTT restarted the system on 12/20/2021 and inspected clean out piping. Cleanout piping appeared to have root like material at the T fitting. System off on departure. Bag filters changed and conducted system checks.
12/23/2021	GWTT	No	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	No	--	System was shutdown on 12/20/2021 due to leaking exterior effluent clean out piping.
12/28/2021	GWTT	No	--	--	9	9	6	0	2.17	56.5	28.3	18	--	46.00	15121030	47167	0.4	0.00003	Yes	No	System restarted, turned down discharge flow rate to stop/reduce overflow at effluent cleanout piping. Inspected recharge basins and observed normal operational flow rate entering. Changed bag filters and conducted system checks.
12/31/2021	GWTT	Yes	--	--	23	17	18	12	2.18	56.1	28.1	21	--	28.00	15178862	49823	11.5	0.00097	Yes	No	Conducted system checks and changed bag filters. Adjusted transfer pump WFO to 34 Hz to maintain discharge flow rate and stop leaking at effluent cleanout piping.
Totals, December 2021 ¹¹									58.7	29.4	21	--	37.5	--	424113	14.0	0.0012	--	--	--	
1/4/2022	GWTT	Yes	--	--	33	19	29	29	2.28	53.6	26.8	4	--	17.00	15201971	75108	13.0	0.00023	Yes	No	Conducted system checks and changed bag filters. High Level alarm at the EO tank triggered occasionally.
1/10/2022	GWTT	Yes	--	--	31	8	20	20	2.42	50.7	25.3	10	--	25.00	15322460	70489	8.2	0.00035	Yes	No	Conducted system checks and changed bag filters.
1/14/2022	GWTT	Yes	--	--	32	23	32	8	2.32	52.9	26.4	14	--	23.00	15389730	67310	11.7	0.00071	Yes	No	Conducted system checks and changed bag filters.
1/16/2022	GWTT	Yes	--	--	29	12	20	20	2.53	48.4	24.2	18	--	25.00	15433142	43372	7.5	0.00059	Yes	No	Conducted system checks and changed bag filters.
1/21/2022	GWTT	Yes	--	--	30	13	21	21	2.57	47.7	23.9	21	--	25.00	15474025	40883	9.5	0.00066	Yes	No	RW-4 pump on idle due to High-level alarm. Conducted system checks and changed bag filters.
1/24/2022	GWTT	Yes	--	--	26	16	21	21	2.67	45.9	23.0	24	--	26.00	15535683	61658	14.3	0.00149	Yes	Yes	Conducted system checks and changed bag filters. Increased discharge/effluent flow rate from 34 Hz to 36 Hz. System sampled on 1/25/2022
1/26/2022	GWTT	Yes	--	--	42	12	25	25	2.72	45.1	22.5	28	--	32.00	15580000	44317	7.7	0.00094	Yes	No	Conducted system checks and changed bag filters. Increased discharge/effluent flow rate from 36 Hz to 40 Hz.
1/31/2022	GWTT	No	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	No	--	Upon arrival, system was shutdown due to loss of power from snow storm on 1/29/2022. Heat was off and system was frozen. Attempts were made to drain water from the pumps, and associated piping, but everything was frozen.
Totals, January 2022 ¹²									49.2	24.6	29	--	24.7	--	403337	9.7	0.0012	--	--	--	

Notes:
1. GE Coastal Engineering, GWTT, Groundwater Treatment Technologies
2. Prior to November 2019, the instantaneous Influent (INF) and effluent (EFF) flow rates are calculated based on the cross-sectional volume per vertical foot of the Influent tank and the measured/filled filling (INF) rate or draining (EFF) of the tank. The diameter of the Influent tank is approximately 78 inches. The cross-sectional volume of the tank is approximately 33.1 cubic feet per vertical linear foot. Therefore the flow rate calculation factor is approximately 122.5 gallons per 6 inches. Since 11/7/2019 (following the replacement of the effluent totalizer, ONLY INF flow rates (from RW-4) are calculated based on an approximation. This Combined Instantaneous Influent flow rate represents the combined flow within both force main-pipes from recovery well RW-4 and since the startup of GWTS#2 on 11/11/2019, approximately 50% of the Combined Instantaneous Influent Flow Rate represents the Instantaneous Influent Flow Rate of GWTS#1.
3. Prior to November 2019 the total mass of PFAS removed is calculated based on the calculated Influent flow rate, the number of days the system has been operating and the average total Influent PFAS concentration for the month. Since November 2019, the total mass of PFAS removed is calculated based on the effluent flow rate.
4. NA or -- Not Applicable.
5. NS, Not Reported.
6. As of April 1, 2019, the system's O&M data reporting was changed to include the differential pressure readings from the bag filter unit's pressure gauges before and after the bag filters are changed/replaced, if applicable.
7. Prior to November 2019, the average effluent flow rate could not reliably be calculated/measured from September to (prior of) October due to a blockage in the site pipes on the EO tank from accumulated iron-oxide precipitates in the bottom of the tank. The iron-oxide precipitates were removed from the EO tank on Oct. 28, 2019.
8. Following the separation of the two force mains and the installation of GWTS#2 on November 7, 2019, instantaneous Influent flow rates are estimated by approximating 50% of the Combined Instantaneous Influent flow rate values.
9. Instantaneous Effluent Flow Rate is recorded as the instantaneous flow rate as calculated or indicated from the totalizer flow meter on the system's effluent discharge piping. Reading is collected after bag filter change and/or backwashing.
10. The Average Effluent Flow Rate is calculated from the net gallons (Total Gallons Treated) obtained from the system's effluent totalizer flow meter and days that the system was in operation.
11. Prior to Nov. 7, 2019, calculated average effluent flow rates and the estimated PFAS removed total were calculated based on the reported totalizer readings. The totalizer flow meter readings on the effluent discharge side were not reliable at flow rates less than 40 GPM. Therefore the data are shaded to indicate that they are approximations only and for this reason the July through October data are also considered approximates.
12. As of September 2019, the "Totals" shown from left to right include the Average Instantaneous Influent Flow Rate, Total Days of System Operation, Average Instantaneous Effluent Flow Rate, Total Gallons Treated, Average Net Effluent Flow Rate, and Estimated PFAS Removed for the respective monthly reporting period. Running average values shown for the effluent flow rate. Prior to November 7, 2019, totals shown (from left to right) included the Average Instantaneous Influent Flow Rate, Total Days of Operation, Average Instantaneous Effluent Flow Rate, and Estimated PFAS Removed for the respective monthly reporting period.
13. The calculated Net Gallons Treated and Average Effluent Flow Rates are based on totalizer readings from each monitoring date and the totals are representative of the monthly (RR) reporting period. The average effluent flow rates calculated from the first monitoring date are based on measurements from the last monitoring date of the previous reporting period.

Table 1B - Summary of Groundwater Pump and Treatment System Total PFAs Analytical Data - GWTS #2
 Barnstable County Fire and Rescue Training Academy
 155 Flint Rock Road, Barnstable, MA
 RTN 4-26179

SAMPLE ID	INFLUENT (PRW-4)						MIDPOINT						EFFLUENT					
USEPA Method 537.2	PFOS (ng/L)	PFOA (ng/L)	PFNA (ng/L)	PFHxS (ng/L)	PFHpA (ng/L)	PFDA (ng/L)	PFOS (ng/L)	PFOA (ng/L)	PFNA (ng/L)	PFHxS (ng/L)	PFHpA (ng/L)	PFDA (ng/L)	PFOS (ng/L)	PFOA (ng/L)	PFNA (ng/L)	PFHxS (ng/L)	PFHpA (ng/L)	PFDA (ng/L)
MassDEP ORS Guidline*	70 ng/L						70 ng/L						70 ng/L					
MCP Method 1 GW-1 Standard ¹⁵	20 ng/L						20 ng/L						20 ng/L					
SAMPLE DATE																		
System Startup on 11/11/19.																		
11/12/2019	4200	53	85	200	59	15	BRL (<5.2)	BRL (<7.4)	BRL (<4.9)	BRL (<5.2)	BRL (<7.1)	BRL (<4.1)	BRL (<5.2)	BRL (<7.4)	BRL (<4.9)	BRL (<5.2)	BRL (<7.1)	BRL (<4.1)
11/15/2019	--	--	--	--	--	--	BRL (<5.2)	BRL (<7.4)	BRL (<4.9)	BRL (<5.2)	BRL (<7.1)	BRL (<4.1)	BRL (<5.2)	BRL (<7.4)	BRL (<4.9)	BRL (<5.2)	BRL (<7.1)	BRL (<4.1)
11/19/2019	--	--	--	--	--	--	BRL (<5.2)	44	BRL (<4.9)	BRL (<5.2)	BRL (<7.1)	BRL (<4.1)	BRL (<5.2)	42	BRL (<4.9)	BRL (<5.2)	BRL (<7.1)	BRL (<4.1)
12/17/2019 ¹⁶	1500	43	51	180	54	10	BRL (<5.2)	BRL (<7.4)	BRL (<4.9)	BRL (<5.2)	BRL (<7.1)	BRL (<4.1)	BRL (<5.2)	BRL (<7.4)	BRL (<4.9)	BRL (<5.2)	BRL (<7.1)	BRL (<4.1)
1/17/2020	2200	57	60	220	69	13	BRL (<5.2)	BRL (<7.4)	BRL (<4.9)	BRL (<5.2)	BRL (<7.1)	BRL (<4.1)	BRL (<5.2)	BRL (<7.4)	BRL (<4.9)	BRL (<5.2)	BRL (<7.1)	BRL (<4.1)
2/13/2020	3100	74	66	310	92	17	BRL (<5.2)	BRL (<7.4)	BRL (<4.9)	BRL (<5.2)	BRL (<7.1)	BRL (<4.1)	BRL (<5.2)	BRL (<7.4)	BRL (<4.9)	BRL (<5.2)	BRL (<7.1)	BRL (<4.1)
3/3/2020	3300	72	64	300	81	14	5.6	BRL (<0.23)	BRL (<0.48)	BRL (<0.33)	BRL (<0.37)	BRL (<0.18)	BRL (<0.43)	BRL (<0.23)	BRL (<0.48)	BRL (<0.33)	BRL (<0.37)	BRL (<0.18)
4/28/2020	1900	52	42	210	56	42	64	2.2	1.7	9.7	3.0	0.27	0.47	BRL (<0.23)	BRL (<0.48)	BRL (<0.33)	BRL (<0.37)	BRL (<0.18)
5/21/2020	1800	46	40	200	50	11	76	2.8	2.0	10	3.6	0.52	BRL (<0.43)	BRL (<0.23)	BRL (<0.48)	BRL (<0.33)	BRL (<0.37)	BRL (<0.18)
6/24/2020	1400	41	41	160	49	19	39	2.9	2.3	12	4.3	1.1	0.84	BRL (<0.49)	BRL (<0.80)	BRL (<0.53)	BRL (<0.51)	BRL (<0.64)
7/28/2020	1700	44	43	200	52	12	84	3.8	3.3	17	5.7	0.76	BRL (<0.43)	BRL (<0.49)	BRL (<0.80)	BRL (<0.53)	BRL (<0.51)	BRL (<0.64)
8/27/2020	1400	42	38	170	48	9	6.1	BRL (<0.49)	BRL (<0.80)	1.2	0.61	BRL (<0.64)	BRL (<0.43)	BRL (<0.49)	BRL (<0.80)	BRL (<0.53)	BRL (<0.51)	BRL (<0.64)
9/23/2020	2000	46	50	200	57	14	18	0.79	0.86	2.4	1.3	BRL (<0.64)	BRL (<0.43)	BRL (<0.49)	BRL (<0.80)	BRL (<0.53)	BRL (<0.51)	BRL (<0.64)
10/20/2020	2300	49	50	230	63	15	7.5	0.64	BRL (<2.0)	1.4	1.0	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)
11/24/2020	2300	59	43	240	71	18	120	3.2	2.4	17	5.0	0.92	1.5	0.52	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)
12/21/2020	1400	51	42	200	60	9.0	190	7.5	5.2	23	9.3	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)
1/27/2021	1000	47	36	170	49	7.7	190	11	7.3	37	13	1.5	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)
2/23/2021	2300	67	54	290	80	14	52	3.5	2.4	12	4.7	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)
3/12/2021	1100	54	43	210	57	11	370	18	15	70	22	3.3	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)
4/21/2021	690	28	25	100	32	7.6	120	7	5.3	22	9.3	1.7	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)
4/21/2021	690	28	25	100	32	7.6	120	7	5.3	22	9.3	1.7	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)
5/20/2021	970	32	38	130	37	10	BRL (<0.43)	BRL (<0.49)	BRL (<0.80)	BRL (<0.53)	BRL (<0.51)	BRL (<0.64)	42	3.1	2.4	9.1	4.9	BRL (<0.64)
System performance samples were not collected for the June 2021 Reporting Period because the System was shutdown as a result of breakthrough observed during the previous reporting period (May 2021).																		
7/23/2021	720	26	29	95	30	9.3	310	11	12	39	13	4.5	BRL (<2.0)	0.51	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)
8/25/2021	570	14	17	79	24	BRL (<3.9)	530	14	16	80	21	BRL (<3.9)	25	BRL (<5.0)	BRL (<5.1)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)
9/20/2021	480	19	19	90	28	5.1	530	19	22	91	28	6.7	1.6	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)
11/2/2021	560	19	21	90	30	6.2	540	17	19	85	28	6.2	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)
11/17/2021	640	21	22	97	34	6.9	2.5	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	0.88	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)
12/16/2021	570	19	20	92	30	6.4	1.3	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	BRL (<2.0)	1	0.53	BRL (<2.0)	BRL (<2.0)	0.9	BRL (<2.0)
1/25/2022	600	23	20	110	37	5.5	530	21	19	110	34	4.6	550	22	18	110	36	4.8

Notes:

- Concentrations presented in ng/L - nanograms per Liter - parts per trillion
- MassDEP's Office of Research and Standards (ORS) expanded upon the USEPA's Health Advisory and created the ORS Guideline that applies to the total summed of five PFAS chemicals, PFOS, PFOA, PFNA, PFHxS, and PFHpA, effective June 11, 2018.
- Concentrations of the PFAS compound, PFDA, are presented based on the April 19, 2019, MassDEP draft of new/proposed groundwater standards for PFAS that includes a sixth, PFAS compound, PFDA. However the concentration of PFDA is not included in total PFAS removal calculations.
- BRL - Below Laboratory Reporting Limits; reporting limit shown in parentheses.
- Concentrations in bold exceed applicable MassDEP ORS Guideline
- PFOS - Perfluorooctanesulfonic acid
- PFOA - Perfluorooctanoic Acid
- PFNA - Perfluorononanoic Acid
- PFHxS - Perfluorohexanesulfonic Acid
- PFHpA - Perfluoroheptanoic Acid
- PFDA - Perfluorodecanoic Acid
- : Concentration data not available and/or sample was not collected on that date.
- Per MCP Regulations, the system was sampled one day, three days, and seven (7) days following the initial week of startup (11/11/19).
- On December 13, 2019, MassDEP published the newly established clean up standards for PFAS in soil and groundwater. These standards were effective as of December 27, 2019 and apply to the total sum of six PFAS chemicals, PFOS, PFOA, PFNA, PFHxS, PFHpA, and PFDA. Concentrations of the six PFAS compounds presented in the table were not compared to the new MassDEP standards until the January 2020 monthly system sample collection.
- The December monthly sample was collected from the system's effluent stream on 12/17/2019 following the receipt of the laboratory results from the 11/19/2019 sampling event on 12/16/2019. The effluent was resampled again to ensure significant breakthrough was not occurring from the secondary carbon vessel.

Table 2B - Summary of Groundwater Pump and Treatment System Operating and Maintenance Data - System No. 2 (GWTS #2)
Barnstable County Fire and Rescue Training Academy
155 Flint Rock Road, Barnstable, MA
RTN 4-26179

Date	Operator ¹	System Operating on Arrival	Days System Operating	Transfer Pump Pres. (psi)	Pre-Filter Changeout Differential Pressure (psi) ²			Post-Filter Changeout Differential Pressure (psi)		Carbon Vessels. Pre-change out (psi)		Carbon Vessels. Post-change out (psi)		Instantaneous Estimated INFILTRANT ⁷ Flow Rate (GPM) ¹⁺¹	EFFLUENT				Estimated Total PFAs Removal (kg)	System Operating on Departure	System Sampled	Comments
				Gauge: P1	Gauge: P2	Gauge: P3	Gauge: P2	Gauge: P3	Gauge: P4	Gauge: P5	Gauge: P4	Gauge: P5	Totalizer (Gal)		Instant. Flow Rate (GPM) ²	Net Gallons Treated ⁴	Average Effluent Flow Rate (GPM) ⁵					
11/11/2019	GWTT	Yes	1	38	0	0	0	0	<2	0	2	2	12.56	416900	32.00	0.0	--	0.00032	Yes	No	Influent flow stream from PRW-4 split and started system #2. Conducted system checks, changed bag filters after initial flush.	
11/15/2019	GWTT	Yes	4	40	24	2	5	2	2	2	2	2	34.00	451645	34.00	34745.0	8.043	0.0008	Yes	Yes	Conducted system pressure checks and changed the bag filters. System shutdown temporarily to calculate influent flow rate at GWTPS #1. Collected system startup samples on 11/12/19 and 11/15/19.	
11/18/2019	GWTT	Yes	7	--	32	2	6	6	2	2	4	4	44.00	491280	33.00	39635.0	9.175	0.0016	Yes	No	Conducted system pressure checks and changed the bag filters. System shutdown temporarily to calculate influent flow rate at GWTPS #1.	
11/22/2019	GWTT	Yes	11	40	31	4	7	7	4	4	6	5	12.50	549022	34.00	57742.0	10.025	0.0028	Yes	No	Conducted system pressure checks and changed the bag filters. System shutdown temporarily to calculate influent flow rate at GWTPS #1. Collected system startup samples on 11/19/19.	
11/25/2019	GWTT	Yes	14	40	15	6	7	7	4	5	5	6	12.50	594623	33.00	45601.0	10.556	0.0037	Yes	No	Conducted system pressure checks and changed the bag filters.	
11/29/2019	GWTT	Yes	18	40	18	6	8	8	3	3	4	4	NR	649150	34.00	54527.0	9.466	0.0043	Yes	No	Conducted system pressure checks and changed the bag filters.	
Totals - November 2019 ^{6,10}				19									23.11		33	232250	8.49	0.0040				
12/2/2019	BETA	Yes	2	--	--	--	--	--	--	--	--	--	--	686500	--	37350.0	8.6	--	No	Yes	System shutdown at 10:00 for force main de-scale process. system locked out and tagged out.	
12/4/2019	BETA	No	2	40	--	--	7	7	--	--	4	4	22.70	686700	30.00	200.0	0.07	0.00000	Yes	No	System restarted at 12:12 upon finishing the de-scale purging process and restarted PRW-4.	
12/6/2019	GWTT	No	4	35	--	--	14	13	--	--	10	8	25.0	707866	47.00	21166.0	7.35	0.00029	Yes	No	System off upon arrival and bag filters were completed clogged with iron sediments. Bag filters had to be changed after 20 minutes of operation. GWTT observed a high amount of solids floating in the EQ tank and pumped down the EQ tank and observed significant iron sediment sludge on the bottom of the tank. GWTT notified BETA that they would raise the floats in EQ tank to help lessen the agitation of the sludge and carryover into the bag filters. System was on high level alarm and continued to shutoff of PRW-4, which shut off system #1 due to significant iron oxide sediment accumulation in EQ tank.	
12/9/2019	GWTT	Yes	7	37	39	8	16	16	7	5	14	8	25.0	813065	46.00	105199.0	24.35	0.00171	Yes	No	Conducted system checks, changed bag filters. Raising floats in EQ tank has not affected the iron sediment at the bottom.	
12/13/2019	GWTT	Yes	11	38	43	11	21	20	10	5	18	7	25.0	943807	42.00	130742.0	22.70	0.00250	Yes	No	Conducted system checks, changed bag filters.	
12/16/2019	GWTT	Yes	14	45	43	13	23	22	10	3	21	5	25.0	1049390	41.00	105583.0	24.44	0.00343	Yes	No	Conducted system checks, changed bag filters, EQ tank "High Level" alarm triggered.	
12/20/2019	GWTT	Yes	18	42	33	14	20	20	10	4	18	6.00	25.0	1148998	43.00	99608.0	17.29	0.00312	Yes	No	Conducted system checks and changed the bag filters. System shutdown temporarily for pump out of iron oxide sediment accumulation in EQ tank.	
12/23/2019	GWTT	Yes	21	--	--	--	--	--	--	--	--	--	--	1209649	NR	60651.0	14.04	0.00296	Yes	No	System shutdown at 08:00 for carbon changeout conducted on System #1.	
12/26/2019	GWTT	Yes	22	38	30	15	19	19	14	6	18	7	24.2	1209820	42.00	171.0	0.04	0.00001	Yes	No	System restarted at 09:30 AM following carbon changeout conducted on System #1. Conducted system checks and changed bag filters.	
12/30/2019	GWTT	Yes	26	38	38	13	22	22	12	5	20	7	24.00	1320824	40.00	111004.0	19.27	0.00503	Yes	No	Conducted system pressure checks and changed the bag filters. Reset pump control floats in EQ tank back to original depths (following the removal of iron sediments at bottom of the tank).	
Totals - December 2019 ^{6,10}				27									24.49		41	671674	17.3	0.005				
1/3/2020	GWTT	Yes	3	43	35	13	20	20	10	4	18	6	--	1422315	42.00	101491.0	17.6	0.00076	Yes	No	Conducted system checks, changed bag filters.	
1/6/2020	GWTT	Yes	6	40	27	15	19	19	11	5	16	8	20.98	1507290	43.00	84975.0	19.7	0.00169	Yes	No	Conducted system checks, changed bag filters.	
1/10/2020	GWTT	Yes	10	38	29	15	19	19	13	5	17	6	20.42	1602935	43.00	95645.0	16.6	0.00237	Yes	No	Conducted system checks, changed bag filters.	
1/13/2020	GWTT	Yes	13	38	26	16	19	19	18	6	6	8	18.28	1674840	41.00	71905.0	16.6	0.00309	Yes	No	Conducted system checks, changed bag filters.	
1/17/2020	GWTT	Yes	17	--	28	16	20	20	15	6	18	7	16.94	1750933	41.00	76993.0	13.2	0.00321	Yes	No	Conducted system checks, changed bag filters.	
1/20/2020	GWTT	Yes	20	38	25	16	11	11	15	6	18	7	15.44	1808630	48.00	57697.0	13.4	0.00382	Yes	No	Conducted system checks, changed bag filters. Backwashed primary LGAC vessel.	
1/24/2020	GWTT	Yes	24	35	19	9	11.5	11.5	6	7	8	8	11.93	1872940	48.00	64310.0	11.2	0.00383	Yes	No	Conducted system checks, changed bag filters.	
1/24/2020	GWTT	Yes	24	35	19	9	11.5	11.5	6	7	8	8	10.65	1872940	48.00	0.0	#DIV/0!					
1/27/2020	GWTT	Yes	27	35	16	10	12	11	7	7	9	8.00	10.65	1915785	46.00	42845.0	9.9	0.00383	Yes	No	Conducted system checks, changed bag filters, pumped backwash water through system's influent stream.	
1/31/2020	GWTT	Yes	31	36	18	10	12	12	9	8	8	7	9.01	1962050	--	46265.0	8.0	0.00356	Yes	No	Conducted system checks, changed bag filters.	
Totals - January 2020 ^{6,10}				31		2/22/1900							14.92		44	641226	14.4	0.004				
2/4/2020	GWTT	Yes	4	2	18	10	12	12	9	8	8	7	7.66	2000333	46.00	38283	6.6	0.00053	Yes	No	Conducted system checks, changed bag filters.	
2/7/2020	GWTT	Yes	7	36	14	11	12	11	8	7	8	6	7.75	2023878	46.00	23545	5.5	0.00076	Yes	No	Conducted system checks, changed bag filters.	
2/11/2020	GWTT	Yes	11	35	14	12	13	13	9	8	10	8	5.53	2049888	47.00	26010	4.5	0.00099	Yes	No	Conducted system checks, changed bag filters.	
2/13/2020	GWTT	Yes	13	36	13	12	14	13	10	8	10	8	4.97	2060169	46.00	10281	3.6	0.00093	Yes	Yes	Conducted system checks, changed bag filters. Pumped backwash water from GWTS #1 through system.	
2/18/2020	GWTT	Yes	18	36	15	12	13	14	9	8	9	8	3.68	2081950	57.00	21781	3.0	0.00109	Yes	Yes	Conducted system checks, changed bag filters.	
2/21/2020	GWTT	Yes	21	36	15	13	14	13	10	8	10	8	2.70	2094054	48.00	12104	2.8	0.00117	Yes	Yes	Conducted system checks, changed bag filters.	
2/24/2020	GWTT	Yes	24	37	43	5	16	16	2	2	13	7	23.11	2108080	47.00	14026	3.2	0.00156	Yes	Yes	Conducted system checks, changed bag filters. Bag filters packed with significant iron-oxide sediments, influent flow rate into EQ tank significantly increased: slug of iron must have broke through. Had to change bag filters twice.	
2/26/2020	GWTT	Yes	26	36	43	6	16	15	6	2	16	8	23.56	2134241	45.00	26161	9.1	0.00472	Yes	Yes	Conducted system checks and changed bag filters.	
2/28/2020	GWTT	Yes	28	36	44	5	21	20	5	2	18	7	24.02	2168295	42.00	34054	11.8	0.00661	Yes	Yes	Conducted system checks, changed bag filters. Approximately 6 inch of iron-oxide sludge has accumulated on bottom of EQ tank: control float switches were raised to reduce disruption of settled sludge.	
Totals - February 2020 ^{6,10}				29									11.44		47	206245	4.9	0.003				
3/2/2020	GWTT	Yes	2	36	35	10	15	15	9	5	10	11	21.6	2249000	48.00	80705	18.7	0.00078	Yes	Yes	Conducted system checks, changed bag filters. Backwashed primary LGAC vessel, vacuumed the iron-oxide sludge out of the EQ tank, and into 55-gal drums on site: water from the drum can be decanted back through the system. System sampled on 3/2/2020.	
3/6/2020	GWTT	Yes	6	37	25	10	16	15	8	8	12	10	20.4	2315739	47.00	66739	11.6	0.00145	Yes	No	Conducted system checks, changed bag filters. System shutdown temporarily to pump backwash water from exterior totes through system.	
3/9/2020	GWTT	Yes	9	37	30	9	16	16	7	6.5	14	10	20.4	2366315	44.00	50576	11.7	0.00220	Yes	No	Conducted system checks, changed bag filters.	
3/13/2020	GWTT	Yes	13	38	37	9	20	20	8	5	18	10	18.9	2476035	42.00	109720	19.0	0.00518	Yes	No	Conducted system checks, changed bag filters.	
3/16/2020	GWTT	Yes	16	38	29	15	20	20	12	8	18	10	16.3	2544858	41.00	68823	15.9	0.00533	Yes	No	Conducted system checks, changed bag filters.	
3/20/2020	GWTT	Yes	20	38	28	17	19	19	10	7	17	10	17.0	2615618	41.00	70760	12.3	0.00514	Yes	No	Conducted system checks, changed bag filters. Observed significant iron-oxide accumulation in EQ tank.	
3/23/2020	GWTT	Yes	23	38	26	16	21	20	14	8.5	18	10	20.4	2636761	41.00	21143	4.9	0.00235	Yes	No	Conducted system checks, changed bag filters.	
3/26/2020	GWTT	Yes	26	38	29	14	20	19	14	8.5	18	10	20.4	2663514	41.00	26753	6.2	0.00337	Yes	No	Conducted system checks, changed bag filters.	
3/30/2020	GWTT	Yes	30	46	44	5	24	24	2	1	20	9	18.8	2721065	37.00	57551	10.0	0.00627	Yes	No	Conducted system checks, changed bag filters.	
Totals - March 2020 ^{6,10}				31									19.37		42	552770	12.4	0.00549				
4/2/2020	GWTT	Yes	2	42	42	13	24	23	10	3	21	5	20.8	2768543	27.00	47478	11.0	0.00028	Yes	No	Conducted system checks, changed bag filters, and slowed down the effluent discharge flow rate to reduce carry over of significant iron sludge into the bag filters.	
4/6/2020	GWTT	Yes	6	42.5	42	12	27	27	10	3	25	6	19.7	2833368	25.00	64825	11.3	0.00085	Yes	No	Conducted system checks and changed bag filters.	
4/9/2020	GWTT	Yes	8.5	39	--	--	9	8	7	6.5	7	6.5	17.7	2903750	39.00	70382	16.3	0.00174	Yes	No	System shutdown for 2-4 hours at 7am for vac out of EQ holding tank and backwash of primary carbon vessel. Conducted system checks and changed bag filters.	
4/13/2020	GWTT	Yes	12.5	39	24.5	7	10	9	4	5	8	6.0	15.6	3004475	38.00	100725	17.5	0.00275	Yes	No	Conducted system checks and changed bag filters. Lowered transfer pump "off control" float in EQ holding tank to allow longer run time and less cycling.	
4/16/2020	GWTT	Yes	15.5	40	20.8	8	11	10	7	6	8	6.0	14.2	3074510	36.00	70035	16.2	0.00316	Yes	No	Conducted system checks and changed bag filters, pumped backwash water from exterior totes into (system #2) holding tank.	
4/20/2020	GWTT	Yes	19.5	40	25	8	11	10	6	5	9	6.0	12.3	3156813	37.00	82303	14.3	0.00350	Yes	No	Conducted system checks and changed bag filters. Lowered transfer pump "off control" float in EQ holding tank to allow longer run time and less cycling.	
4/24/2020	GWTT	Yes	23.5.																			

Table 2B - Summary of Groundwater Pump and Treatment System Operating and Maintenance Data - System No. 2 (GWTS #2)
Barnstable County Fire and Rescue Training Academy
155 Flint Rock Road, Barnstable, MA
RTN 4-26179

Date	Operator ¹	System Operating on Arrival	Days System Operating	Transfer Pump Pres. (psi)	Pre-Filter Changeout Differential Pressure (psi) ²		Post-Filter Changeout Differential Pressure (psi)		Carbon Vessels. Pre-change out (psi)		Carbon Vessels. Post-change out (psi)		Instantaneous Estimated INFILUENT ⁷ Flow Rate (GPM) ¹¹	EFFLUENT				Estimated Total PFAs Removal (kg)	System Operating on Departure	System Sampled	Comments
				Gauge: P1	Gauge: P2	Gauge: P3	Gauge: P2	Gauge: P3	Gauge: P4	Gauge: P5	Gauge: P4	Gauge: P5		Totalizer (Gal)	Instant. Flow Rate (GPM) ⁸	Net Gallons Treated ⁴	Average Effluent Flow Rate (GPM) ⁹				
5/1/2020	GWTT	Yes	1	47	43	9	22	22	8	3	20	5.0	16.3	3320924	32.00	49114	8.5	0.00310	Yes	No	Conducted system checks and changed bag filters twice during visit. system on idle upon arrival due to high level.
5/5/2020	GWTT	Yes	5	42	42	12	26	26	10	3	23	5.0	18.0	3359082	25.00	38158	6.6	0.00241	Yes	No	Conducted system checks and changed bag filters twice: influent flow rate has spiked but has caused a large influx of iron sediments.
5/8/2020	GWTT	Yes	8	42	35	13	22	22	10	4	20	6.0	18.1	3426824	34.00	67742	15.7	0.00570	Yes	No	Conducted system checks and changed bag filters.
5/11/2020	GWTT	Yes	11	42	25	16	22	22	14	5	20	6.0	16.5	3485100	32.00	58276	13.5	0.00490	Yes	No	Conducted system checks and changed bag filters. Pumped down green exterior tote holding backwash water from system #1.
5/15/2020	GWTT	Yes	15	39	35	17	8.5	8	16	4	7	6.0	12.8	3562051	38.00	76951	13.4	0.00485	Yes	No	Conducted system checks and changed bag filters. Backwashed primary LGAC vessel.
5/18/2020	GWTT	Yes	18	39	16	8	9	9	6	6	7	6.0	13.3	3614934	39.00	52883	12.2	0.00445	Yes	Yes	Conducted system checks and changed bag filters. Pumped down green exterior tote holding backwash water from 5.15.20 through System #2. System sampled on 5/21/2020.
5/22/2020	GWTT	Yes	22	42	24	7	10	10	4	4	7	6.0	12.0	3682536	36.00	67602	11.7	0.00426	Yes	No	Conducted system checks and changed bag filters.
5/26/2020	GWTT	Yes	26	41	44	4	17	16	0	0	14	5.0	14.8	3735642	34.00	53106	9.2	0.00335	Yes	No	Conducted system checks and changed bag filters twice.
5/29/2020	GWTT	Yes	29	40	44	4	21	19	4	1	15	4.0	14.8	3785810	34.00	50168	11.6	0.00422	Yes	No	Conducted system checks and changed bag filters twice.
Totals - May 2020 ¹⁰				31									15.2		33.8	514000	11.5	0.00418			
6/2/2020	GWTT	Yes	2	43	42	8	23	23	8	3	21	5.0	14.4	3832928	32.00	47118	8.2	0.00235	Yes	No	Conducted system checks and changed bag filters. primary carbon vessel needs to be backwashed.
6/5/2020	GWTT	Yes	5	40	35	9	13	13	2	2	10	5.0	17.7	3887828	35.00	54900	12.7	0.00366	Yes	No	Conducted system checks and changed bag filters.
6/9/2020	GWTT	Yes	9	40	21	10	7.5	7	8	5	6	5.0	15.9	3922210	35.00	34382	6.0	0.00172	Yes	No	Conducted system checks and changed bag filters. Bakcwashed primary LGAC vessel. pumped down outside holding tank through system before backwashing carbon vessel.
6/12/2020	GWTT	Yes	12	40	21	10	7.5	7	8	5	6	5.0	14.9	3970210	35.00	48000	11.1	0.00320	Yes	No	Conducted system checks and changed bag filters.
6/16/2020	GWTT	Yes	16	41	23	8	10	10	6	5	8	6.0	13.1	4029179	36.00	58969	10.2	0.00295	Yes	No	Conducted system checks and changed bag filters. Pumped backwash water from exterior holding totes through system.
6/19/2020	GWTT	Yes	19	40	21	10	7.5	7	8	5	6	5.0	12.3	4069514	38.00	40335	9.3	0.00269	Yes	No	Conducted system checks and changed bag filters.
6/22/2020	GWTT	Yes	22	41	14	10	11	11	9	5	9	5.0	10.7	4102439	37.00	32925	7.6	0.00219	Yes	No	Conducted system checks and changed bag filters.
6/25/2020	GWTT	Yes	25	42	16	12	10	10	8	4	5	5.0	10.9	4128010	35.00	25571	5.9	0.00170	Yes	No	Conducted system checks and changed bag filters.
6/29/2020	GWTT	Yes	29	41	16	9	10	10	8	5	9	5.0	11.9	4154842	35.00	26832	4.7	0.00134	Yes	No	Conducted system checks and changed bag filters.
Totals - June 2020 ¹⁰				30									13.5		35.3	369032	8.5	0.00238			
7/2/2020	GWTT	Yes	2	42	43	4	12	11	0	0	10	5.0	13.3	4173048	34.00	18206	4.2	0.00146	Yes	No	Conducted system checks and changed bag filters.
7/6/2020	GWTT	Yes	6	42	37	8	16.5	16	7	3	14	5.0	12.3	4243300	34.00	70252	12.2	0.00423	Yes	No	Conducted system checks and changed bag filters.
7/9/2020	GWTT	Yes	9	43	42	8	23	23	8	3	21	5.0	12.3	4279505	31.00	36205	8.4	0.00291	Yes	No	Conducted system checks and changed bag filters.
7/12/2020	GWTT	Yes	12	47	47	18	18	18	7	3	16	5.0	11.6	4329440	32.00	49935	11.6	0.00401	Yes	No	Conducted system checks and changed bag filters.
7/16/2020	GWTT	Yes	16	42	25	13	16.5	16	12	5	14	7.0	10.2	4374349	33.00	44909	7.8	0.00271	Yes	No	Conducted system checks and changed bag filters.
7/20/2020	GWTT	Yes	20	40	34	12	7.5	7	10	3	6	5.0	9.3	4435010	40.00	60661	10.5	0.00365	Yes	No	Conducted system checks and changed bag filters. Pumped backwash water from System #1 through system and then backwashed primary LGAC vessel.
7/24/2020	GWTT	Yes	24	40	37	4	9.5	9	2	2	8	6.0	8.5	4493135	40.00	58125	10.1	0.00350	Yes	No	Changed bag filters and pumped excess backwash water through system.
7/27/2020	GWTT	Yes	27	41	43	6	13	12	2	0	10	5.0	8.2	4521639	38.00	28504	6.6	0.00229	Yes	No	Conducted system checks and changed bag filters twice due to iron-oxide accumulation in the EQ tank.
7/30/2020	GWTT	Yes	30	41	32	7	14	13	6	3	10	5.0	9.0	4585515	37.00	63876	14.8	0.00513	Yes	No	Conducted system checks; the system is receiving more water (influent) that GWTS#1, operator assumes it's related to the build up of iron in the force main piping.
Totals - July 2020 ¹⁰				31									10.5		35.4	430673	9.6	0.00335			
8/4/2020	GWTT	No	4	41	41	7	17	16	5	3	14	5.5	9.5	4669181	38.00	83666	11.6	0.00336	Yes	No	System down on arrival due to split/rupture of 2 inch hard hose connecting the transfer pump to the bag filters. Hose was replaced and system restarted on 8/4/2020. Conducted system checks and changed bag filters.
8/7/2020	GWTT	Yes	7	41	18	14	16	15	12	6	12	6.0	9.6	4686019	34.00	16838	3.9	0.00113	Yes	No	Conducted system checks and changed bag filters.
8/10/2020	GWTT	Yes	10	40.5	16.5	14	15	14	11	5	12	6.0	9.4	4701138	31.00	15119	3.5	0.00101	Yes	No	Conducted system checks and changed bag filters. System shutdown on 8/12/2020 for carbon changeout.
8/14/2020	GWTT	Yes	12	40	--	--	15	14	--	--	10.5	6.0	8.8	4714722	41.00	13584	2.4	0.00068	Yes	No	Restarted system after carbon changeout. Conducted system checks and changed bag filters.
8/17/2020	GWTT	Yes	15	40	16.5	13.5	15	14	10	6	12	6.0	8.8	4732036	41.00	17314	4.0	0.00116	Yes	No	Conducted system checks and changed bag filters.
8/20/2020	GWTT	Yes	18	44	22	12	15	14	10	5	12	6.0	8.7	4744901	40.00	12865	3.0	0.00086	Yes	No	Conducted system checks and changed bag filters.
8/24/2020	GWTT	Yes	22	41	19	13	15	14	10	5	12	6.0	7.7	4774135	40.00	29234	5.1	0.00147	Yes	No	Conducted system checks and changed bag filters.
8/28/2020	GWTT	Yes	26	30	18	14	25	23	10	5	20	12.0	8.3	4793800	40.00	19665	3.4	0.00099	Yes	No	Conducted system checks and changed bag filters. System sampled on 8/27/2020 and iron sediment vacuum removed from EQ tank on 8/27/2020.
8/31/2020	GWTT	Yes	29	40	20	12	14	12	8	6	10	7.0	8.0	4807524	42.00	13724	3.2	0.00092	Yes	No	Conducted system checks and changed bag filters.
Totals - August 2020 ¹⁰				29									8.7		38.6	222009	5.3	0.00144			
9/4/2020	GWTT	Yes	4	40	15	12	13	13	8	6	10	6.0	6.3	4821810	42.00	14286	2.5	0.00099	Yes	No	Conducted system checks and changed bag filters.
9/8/2020	GWTT	Yes	8	40	45	4	9	8	0	0	6	6.0	8.9	4834498	38.00	12688	2.2	0.00088	Yes	No	Conducted system checks and changed bag filters.
9/11/2020	GWTT	Yes	11	44	16	6	9	7	5	5	6	5.0	7.1	4866725	38.00	32227	7.5	0.00299	Yes	No	Conducted system checks and changed bag filters.
9/15/2020	GWTT	Yes	15	42	19	7	8	7	6	5	6	8.0	6.6	4907555	38.00	40830	7.1	0.00284	Yes	No	Conducted system checks and changed bag filters.
9/18/2020	GWTT	Yes	18	42	9.5	27	8	7	6	5	6	5.0	5.5	4937021	37.00	29466	6.8	0.00273	Yes	No	Conducted system checks and changed bag filters.
9/21/2020	GWTT	Yes	21	35	14	8	9	9	6	5	6	5.0	5.4	4963941	37.00	26920	6.2	0.00250	Yes	No	Conducted system checks and changed bag filters.
9/25/2020	GWTT	Yes	25	45	21	7	8	7	4	4	4	5.0	4.9	4999400	35.00	35459	6.2	0.00247	Yes	No	Conducted system checks and changed bag filters.
9/28/2020	GWTT	Yes	28	43	43	3	10	10	8	5	8	5.0	5.0	5032229	35.00	32829	7.6	0.00304	Yes	No	Conducted system checks and changed bag filters.
Totals - September 2020 ¹⁰				30									6.2		37.5	224705	5.2	0.00202			
10/2/2020	GWTT	Yes	2	43	28	6	9	8	5	4	7	5.0	4.5	5076447	34.00	44218	7.7	0.00352	Yes	No	Conducted system checks and changed bag filters.
10/5/2020	GWTT	Yes	5	40	15	12	13	13	8	6	10	6.0	4.8	5088882	35.00	12435	2.9	0.00132	Yes	No	Conducted system checks and changed bag filters.
10/8/2020	GWTT	Yes	8	42	10	9	9	9	6	5	6	5.0	4.8	5097900	35.00	9018	2.1	0.00096	Yes	No	Conducted system checks and changed bag filters.
10/13/2020	GWTT	Yes	13	42	11	9	10	9	7	5	7	5.0	4.7	5107054	35.00	91					

Table 2B - Summary of Groundwater Pump and Treatment System Operating and Maintenance Data - System No. 2 (GWTS #2)
Barnstable County Fire and Rescue Training Academy
155 Flint Rock Road, Barnstable, MA
RTN 4-26179

Date	Operator ¹	System Operating on Arrival	Days System Operating	Transfer Pump Pres. (psi)	Pre-Filter Changeout Differential Pressure (psi) ²			Post-Filter Changeout Differential Pressure (psi)		Carbon Vessels. Pre-change out (psi)		Carbon Vessels. Post-change out (psi)		Instantaneous Estimated INFILUENT ⁷ Flow Rate (GPM) ¹¹	EFFLUENT				Estimated Total PFAs Removal (kg)	System Operating on Departure	System Sampled	Comments
				Gauge: P1	Gauge: P2	Gauge: P3	Gauge: P2	Gauge: P3	Gauge: P4	Gauge: P5	Gauge: P4	Gauge: P5	Totalizer (Gal)		Instant. Flow Rate (GPM) ⁸	Net Gallons Treated ⁴	Average Effluent Flow Rate (GPM) ⁹					
12/1/2020	GWTT	Yes	1	44	44	4	13.5	13	2	3	10	5.5	32.8	5219532	32.00	24352	4.2	0.00126	Yes	No	Conducted system checks and changed bag filters twice.	
12/3/2020	GWTT	Yes	3	43	--	--	8	7.5	--	--	6	6.0	31.4	5284833	36.00	67301	23.4	0.00697	Yes	No	Conducted system checks, Global on site to vacuum out the EQ tank, backwash primary GAC vessel.	
12/7/2020	GWTT	Yes	7	43	41	5	10	10	2	2	8	6.0	32.5	5390190	33.00	103357	17.9	0.00535	Yes	No	Conducted system checks and changed bag filters twice. Pumped backwash water through system.	
12/11/2020	GWTT	Yes	11	44	42	8	14	14	6	3	10	6.0	33.1	5483045	33.00	92855	16.1	0.00481	Yes	No	Conducted system checks and changed bag filters.	
12/15/2020	GWTT	Yes	15	45	45	10	18	18	9	5	15	5.0	31.4	5578819	34.00	95774	16.6	0.00496	Yes	No	Conducted system checks and changed bag filters. High level alarm in INF tank was active on arrival. Bag filters were impacted with iron.	
12/18/2020	GWTT	Yes	18	45	39	18	25	25	16	4	18	7.0	32.8	5670557	28.00	91738	21.2	0.00633	Yes	No	Conducted system checks and changed bag filters. Increased flow rate through system.	
12/21/2020	GWTT	Yes	21	41	38	8	20	20	6	4	16	8.0	--	5765668	41.00	95111	22.0	0.00656	Yes	Yes	Conducted system checks and changed bag filters.	
12/24/2020	GWTT	Yes	24	48	41	16	26	26	14	3	22	7.0	28.7	5859505	38.00	93837	21.7	0.00648	Yes	No	Conducted system checks and changed bag filters. High level alarm in INF tank was active on arrival. Bag filters were impacted with iron.	
12/28/2020	GWTT	Yes	28	45	41	23	31	31	20	4	25	6.0	26.3	5975018	38.00	115513	20.1	0.00598	Yes	No	Conducted system checks and changed bag filters.	
Totals - December 2020 ¹⁰				31									31.1		34.8	779838	17.5	0.005				
1/1/2021	GWTT	Yes	1	48	42	22	33	33	20	3	30	5.0	23.7	6069850	26.00	94832	16.5	0.00365	Yes	No	Conducted system checks and changed bag filters.	
1/4/2021	GWTT	Yes	4	46	37	28	27	27	16	5	24	6.0	22.4	6159356	33.00	89506	20.7	0.00459	Yes	No	Conducted system checks and changed bag filters.	
1/8/2021	GWTT	Yes	8	48	40	18	30	30	18	2	24	5.0	21.6	6265900	30.00	106544	18.5	0.00410	Yes	No	Conducted system checks and changed bag filters.	
1/11/2021	GWTT	Yes	11	42	26	26	25	24	22	6	22	7.0	17.1	6343500	30.00	77600	18.0	0.00398	Yes	No	Conducted system checks and changed bag filters. Took bag filter unit #3330 offline.	
1/15/2021	GWTT	Yes	15	45	43	28	33	33	16	3	30	5.0	18.3	6425570	38.00	82070	14.2	0.00316	Yes	No	Conducted system checks and changed bag filters. Bag filter housing from unit #3330 was replaced.	
1/18/2021	GWTT	Yes	18	44	42	16	8	8	13	3	9	9.0	22.0	6480181	32.00	54611	12.6	0.00280	Yes	No	Conducted system checks and changed bag filters. Pumped backwash water from GWTS #1 through system, then backwashed the primary carbon vessel. Bag filter housing from unit #3330 was replaced.	
1/22/2021	GWTT	Yes	22	43	28	10	11	11	7	5	8	6.0	18.7	6561860	32.00	81679	14.2	0.00314	Yes	No	Conducted system checks and changed bag filters. Pumped contents of backwash from GWTS#1 through system.	
1/25/2021	GWTT	Yes	25	43	26	12	16	16	9	5	12	6.0	15.6	6619040	29.00	57180	13.2	0.00293	Yes	No	Conducted system checks and changed bag filters.	
1/29/2021	GWTT	Yes	29	44	28	14	19	19	10	5	16	6.0	15.9	6683438	27.00	64398	11.2	0.00248	Yes	No	Conducted system checks and changed bag filters.	
Totals - January 2021 ¹⁰				31									19.5		30.8	708420	15.9	0.004				
2/2/2021	GWTT	Yes	2	44	26	16	14	14	15	6	10	5.0	13.2	6736550	30.00	53112	9.2	0.00438	Yes	No	Conducted system checks and changed bag filters.	
2/5/2021	GWTT	Yes	5	44	24	16	19	19	13	5	16	6.0	11.6	6770434	30.00	33884	7.8	0.00372	Yes	No	Conducted system checks and changed bag filters.	
2/8/2021	GWTT	Yes	8	44	25	18	21	21	16	6	18	6.0	9.5	6800133	27.00	29699	6.9	0.00326	Yes	No	Conducted system checks and changed bag filters.	
2/12/2021	GWTT	Yes	12	44	28	17	21	21	14	5	18	6.0	10.0	6834311	26.00	34178	5.9	0.00282	Yes	No	Conducted system checks and changed bag filters.	
2/19/2021	GWTT	Yes	19	44	23	20	21	21	17	6	18	6.0	6.3	6876800	26.00	42489	4.2	0.00200	Yes	No	Conducted system checks and changed bag filters.	
2/22/2021	GWTT	Yes	22	--	30	12	--	--	7	4	--	--	5.7	6889638	11.00	12838	3.0	0.00141	No	Yes	Conducted system checks and changed bag filters. System shutdown on departure due to significant iron fouling in the EQ tank and in primary carbon vessel. GWTT and BETA decided to shut down GWTS #2 until a pump out of the tanks can be completed to reduce additional iron sedimentation in the carbon vessels. System was sampled on 2/23/2021.	
Totals - February 2021 ¹⁰				22									10.9		25.0	206200	6.5	0.002				
3/1/2021	GWTT	No	--	--	--	--	--	--	--	--	--	--	--	6889715	--	--	--	--	--	--	--	System off.
3/5/2021	GWTT	No	--	--	--	--	--	--	--	--	--	--	--	6889715	--	--	--	--	--	--	--	Settled water from EQ tank pumped into System #1. Blue lay flat hose was replaced with hard hose at influent manifold.
3/8/2021	GWTT	No	--	--	--	--	--	--	--	--	--	--	--	6889715	--	--	--	--	--	--	--	Flushed influent line into System #1.
3/12/2021	GWTT	No	1	42	8	7	6	6	4	3	4	3.0	24.2	6892375	36.00	2660	0.5	0.00012	Yes	Yes	--	Global Cycle on site to vacuum iron oxide sediments from the EQ tank, bag filter housings, and exterior totes. Both carbon vessels backwashed. Restarted system, conducted system checks, changed bag filters twice.
3/15/2021	GWTT	Yes	3	43	42	8	12	12	6	3	12	4.0	19.5	6978828	30.00	86453	20.0	0.00499	Yes	No	--	Conducted system checks and changed bag filters.
3/19/2021	GWTT	Yes	7	44	42	28	27	27	16	4	23	4.0	19.7	7074315	30.00	95487	16.6	0.00414	Yes	No	--	Conducted system checks and changed bag filters.
3/22/2021	GWTT	Yes	10	44	42	18	28	28	16	3	28	4.0	18.0	7129300	30.00	54985	12.7	0.00318	Yes	No	--	Conducted system checks and changed bag filters.
3/26/2021	GWTT	Yes	14	43	42	18	8	8	16	2	5	5.0	16.9	7197740	31.00	68440	11.9	0.00297	Yes	No	--	Conducted system checks and changed bag filters twice. Backwashed primary LGAC vessel. Reduced discharge to 30 GPM to reduce the amount of iron sludge carry over into LGAC vessels.
3/30/2021	GWTT	Yes	18	44	42	14	13	13	5	3	10	5.0	15.6	7286339	28.00	88599	15.4	0.00384	Yes	No	--	Conducted system checks and changed bag filters.
Totals - March 2021 ¹⁰				19									17.9		30.8	396624	14.5	0.002				
4/2/2021	GWTT	Yes	2	44	41	13	21	21	10	3	18	5.0	15.8	7350578	25.00	64239	14.9	0.00222	Yes	No	--	Conducted system checks and changed bag filters. Backwashed primary LGAC vessel.
4/6/2021	GWTT	Yes	6	45	43	12	25	25	10	2	22	4.0	14.8	7400768	22.00	50190	8.7	0.00130	Yes	No	--	Conducted system checks and changed bag filters.
4/9/2021	GWTT	Yes	9	46	42	15	9	9	12	3	6	6.5	14.5	7451550	23.00	50782	11.8	0.00176	Yes	No	--	Conducted system checks, changed bag filters, and backwashed primary carbon vessel.
4/13/2021	GWTT	Yes	13	46	34	9	12	12	7	4	10	6.0	12.6	7536033	21.00	84483	14.7	0.00219	Yes	Yes	--	Conducted system checks and changed bag filters.
4/15/2021	GWTT	Yes	15	45	20	10	14	14	8	5	12	8.0	11.2	7576369	24.00	40336	14.0	0.00209	Yes	No	--	Conducted system checks and changed bag filters.
4/19/2021	GWTT	Yes	19	46	30	10	16	16	8	4	14	6.0	9.5	7645588	20.00	69219	12.0	0.00179	Yes	No	--	Conducted system checks and changed bag filters.
4/23/2021	GWTT	Yes	23	46	31	10	16	16	8	4	13	6.0	8.1	7706867	19.00	61279	10.6	0.00159	Yes	No	--	Conducted system checks and changed bag filters.
4/27/2021	GWTT	Yes	27	47	28	23	18	18	10	5	17	6.0	6.9	7759389	18.00	52522	9.1	0.00136	Yes	No	--	Conducted system checks and changed bag filters.
4/30/2021	GWTT	Yes	30	46	23	15	17	17	12	5	14	6.0	6.1	7793537	19.00	34148	7.9	0.00118	Yes	No	--	Conducted system checks and changed bag filters.
Totals - April 2021 ¹⁰				30									11.1		21.2	507198	11.7	0.002				
5/4/2021	GWTT	Yes	4	46	25	15	8	8	12	5	7	6.0	4.9	7831797	21.00	38260	6.6	0.00137	Yes	No	--	Conducted system checks and changed bag filters. Backwashed primary LGAC vessel.
5/7/2021	GWTT	Yes	7	46	25	15	9	9	8	8	7	7.0	4.2	7855288	23.00	23491	5.4	0.00112	Yes	No	--	Conducted system checks and changed bag filters.
5/10/2021	GWTT	Yes	10	44	36	4	13	13	2	2	10	9.0	21.4	7874795	29.00	19507	4.5	0.00093	Yes	No	--	Conducted system checks, changed bag filters, increased discharge/effluent flow rate.
5/14/2021	GWTT	Yes	14	46	43	6	40	7	4	3	12	8.0	21.9	7923831	26.00	49036	8.5	0.00175	Yes	Yes	--	Conducted system checks and changed bag filters twice
5/17/2021																						

Table 2B - Summary of Groundwater Pump and Treatment System Operating and Maintenance Data - System No. 2 (GWTS #2)
Barnstable County Fire and Rescue Training Academy
155 Flint Rock Road, Barnstable, MA
RTN 4-26179

Date	Operator ¹	System Operating on Arrival	Days System Operating	Transfer Pump Pres. (psi)	Pre-Filter Changeout Differential Pressure (psi) ²			Post-Filter Changeout Differential Pressure (psi)		Carbon Vessels. Pre-change out (psi)		Carbon Vessels. Post-change out (psi)		Instantaneous Estimated InFLUENT ⁷ Flow Rate (GPM) ¹⁺⁴	EFFLUENT				Estimated Total PFAs Removal (kg)	System Operating on Departure	System Sampled	Comments
				Gauge: P1	Gauge: P2	Gauge: P3	Gauge: P2	Gauge: P3	Gauge: P4	Gauge: P5	Gauge: P4	Gauge: P5	Totalizer (Gal)		Instant. Flow Rate (GPM) ⁵	Net Gallons Treated ⁴	Average Effluent Flow Rate (GPM) ⁶					
9/3/2021	GWTT	Yes	3	46	24	7	10	10	5	5	8	8	12.0	9123034	27	58414	10.1	0.00011	Yes	No	Conducted system checks, changed bag filters.	
9/7/2021	GWTT	Yes	7	46	31	10	14	14	7	8	11.0	10.0	12.6	9184007	27.00	60973	10.6	0.00026	Yes	No	Conducted system checks, changed bag filters, pumped backwash water from GWTS#1 through system.	
9/10/2021	GWTT	Yes	10	46	24	11	14	14	10	10	12	12.0	9.9	9224854	25.00	40847	9.5	0.00033	Yes	No	Conducted system checks, changed bag filters.	
9/14/2021	GWTT	Yes	14	46	24	11	14	14	10	10	12	12.0	8.5	9272468	24.00	47614	8.3	0.00040	Yes	No	Conducted system checks, changed bag filters.	
9/17/2021	GWTT	Yes	17	48	24	12	15	15	8	9	13	13.0	10.5	9297187	24.00	24719	5.7	0.00034	Yes	No	Conducted system checks and changed bag filters.	
9/20/2021	GWTT	Yes	20	48	14	11	12	12	10	9	10	10.0	10.6	9311449	26.00	14282	3.3	0.00023	Yes	Yes	Conducted system checks and changed bag filters.	
9/24/2021	GWTT	Yes	24	46	--	--	10	10	--	--	8	7.0	8.8	9331227	27.00	19758	3.4	0.00029	Yes	No	Conducted system checks and changed bag filters.	
9/27/2021	GWTT	Yes	27	46	10	10	10	10	8	8	8	8.0	8.2	9342333	27.00	11106	2.6	0.00024	Yes	No	Conducted system checks and changed bag filters.	
Totals - September 2021 ¹⁰				30									10.1		25.9	277713	6.4	0.001				
10/1/2021	GWTT	Yes	1	46	10	10	10	10	8	8	8	8	7.8	9355201	27	12868	2.2	0.00001	Yes	No	Conducted system checks, changed bag filters.	
10/5/2021	GWTT	Yes	5	46	10	10	10	10	8	8	8.0	8.0	8.0	9363138	27	7937	1.4	0.00003	No	No	Conducted system checks, changed bag filters. System shutdown due to influx of iron oxide sediment overloading the bag filters.	
10/8/2021	GWTT	No	6	46	24	11	14	14	10	10	12	12.0	9.2	9365050	25.00	1912	0.4	0.00001	Yes	No	Restarted system, conducted system checks, changed bag filters twice.	
10/12/2021	GWTT	Yes	10	48	42	12	25	23	11	11	20	20.0	9.5	9405023	20.00	39973	6.9	0.00028	Yes	No	Conducted system checks, changed bag filters. System in high level alarm on arrival.	
10/15/2021	GWTT	Yes	13	49	41	15	28	28	14	15	24	25.0	9.6	9445540	18.00	40517	9.4	0.00048	Yes	No	Conducted system checks, changed bag filters twice due to high flux of iron sediments.	
10/19/2021	GWTT	Yes	17	48	43	17	28	28	16	16	26	26.0	8.9	9497110	18.00	51570	9.0	0.00060	Yes	No	Conducted system checks, changed bag filters twice due to high flux of iron sediments and swapped force main piping to reduce iron flux into system.	
10/22/2021	GWTT	Yes	20	47	15	10	--	--	--	--	16	15.0	8.7	9516542	24.00	19432	4.5	0.00036	Yes	No	Conducted system checks, changed bag filters and backwashed secondary LGAC vessel.	
10/26/2021	GWTT	Yes	24	46	19	17	10	10	15	15	7	7.0	8.5	9539918	27.00	23376	4.1	0.00039	Yes	No	Conducted system checks, changed bag filters. Slightly increased discharge flow rate. Pumped backwash water through system.	
10/29/2021	GWTT	Yes	27	46	12	11	11	11	8	8	9	9.0	6.8	9554825	26.00	14907	3.5	0.00037	Yes	No	Conducted system checks and changed bag filters.	
Totals - October 2021 ¹⁰				29									6.8		23.6	212492	5.1	0.0006				
11/2/2021	GWTT	Yes	2	46	13	12	11	11	10	10	10	9	6.3	9566990	27	12165	2.1	0.00029	Yes	No	Conducted system checks, changed bag filters.	
11/5/2021	GWTT	Yes	5	38	12	11	12	12	10	10	10.0	10.0	6.0	9574635	26	7645	1.8	0.00025	No	No	Conducted system checks, changed bag filters and replaced broken pressure gauge on transfer pump.	
11/8/2021	GWTT	No	8	40	35	8	15	15	8	9	14	13.0	6.2	9612590	25.00	37955	8.8	0.00122	Yes	No	Conducted system checks, changed bag filters twice.	
11/12/2021	GWTT	Yes	12	44	37	12	22	22	10	10	20	20.0	5.9	9659581	20.00	46991	8.2	0.00113	Yes	No	Conducted system checks, changed bag filters. System in high level alarm on arrival.	
11/15/2021	GWTT	Yes	15	42	43	11	10	10	10	11	7	6.0	6.1	9691324	18.00	31743	7.3	0.00102	Yes	No	Conducted system checks, changed bag filters twice. Backwashed both primary and secondary carbon vessels.	
11/22/2021	GWTT	Yes	18	43	--	--	8	8	--	--	6	7.0	28.9	9717710	21.00	26386	2.6	0.00036	Yes	No	System shutdown for maintenance and redevelopment on PRW-4 and force main on 11/17/2021 - system restarted on 11/22/2021. GWTT flushed 2,500 gallons from the force mains (PRW-4) prior to system restart. Bag filters changed twice, significant iron sediment still coming through in the influent.	
11/26/2021	GWTT	Yes	22	48	45	5	12	12	4	6	10	11.0	31.1	9748840	21.00	31130	5.4	0.00075	Yes	No	Conducted system checks and changed bag filters.	
11/30/2021	GWTT	Yes	26	46	35	17	22	22	15	16	20	20.0	28.9	9817965	24.00	69125	12.0	0.00167	Yes	No	Conducted system checks and changed bag filters, increased flow through transfer pump in response to cycling high level alarm (increased influent rates).	
Totals - November 2021 ¹⁰				26									14.9		22.8	263140	7.0	0.001				
12/3/2021	GWTT	Yes	3	43	42	21	30	30	24	24	24	8	30.1	9870995	20	53030	12.3	0.00153	Yes	No	Conducted system checks, changed bag filters.	
12/7/2021	GWTT	Yes	7	44	42	27	36	36	25	26	34.0	35.0	29.9	9939134	15	68139	11.8	0.00148	No	No	Conducted system checks, changed bag filters.	
12/9/2021	GWTT	Yes	9	42	42	29	28	24	22	26	22	22.0	29.4	9973745	25.00	34611	12.0	0.00150	Yes	No	Conducted system checks, changed bag filters. Global Cycle conducted a pump out.	
12/13/2021	GWTT	Yes	13	38	34	15	20	20	14	16	17	17.0	30.1	10078138	25.00	104393	18.1	0.00226	Yes	No	Conducted system checks, changed bag filters, and backwashed primary carbon vessel and increased discharge flow rate.	
12/16/2021	GWTT	Yes	16	38	43	7	19	19	4	5	16	13.0	30.4	10153382	25.00	75244	17.4	0.00217	Yes	Yes	Conducted system checks, changed bag filters.	
12/20/2021	GWTT	Yes	20	47	43	11	21	21	18	12	12.0	5.0	28.7	10246532	32	93150	16.2	0.00202	Yes	No	Conducted system checks, changed bag filters.	
12/23/2021	GWTT	Yes	23	40	44	9	22	22	6	4	19.0	12.0	28.0	10314095	31	67563	15.6	0.00195	Yes	No	Conducted system checks, changed bag filters.	
12/28/2021	GWTT	Yes	28	39	43	10	22	22	7	4	21.0	10.0	28.3	10409055	29	94960	13.2	0.00165	Yes	No	Conducted system checks, changed bag filters, pumped backwash water through system.	
12/31/2021	GWTT	Yes	31	35	23	11	9	9	9	6	6.0	7.0	28.1	10459586	37	50531	11.7	0.00146	Yes	No	Conducted system checks, changed bag filters. Primary carbon vessel backwashed.	
Totals - December 2021 ¹⁰				31									29.4		26.6	641621	14.4	0.002				
1/4/2022	GWTT	Yes	4	46	41	6	14	14	4	4	12	10	26.8	10523955	34	64369	11.2	0.00150	Yes	No	Conducted system checks, changed bag filters.	
1/10/2022	GWTT	Yes	10	37	45	5	11	11	3	3	10.0	10.0	25.3	10586232	35	62277	7.2	0.00097	No	No	Conducted system checks, changed bag filters twice. Pumped backwash water from GWTS #1 through system.	
1/14/2022	GWTT	Yes	14	37	44	2	14	13	0	0	10	11.0	26.4	10648575	36.00	62343	10.8	0.00146	Yes	No	Conducted system checks, changed bag filters.	
1/18/2022	GWTT	Yes	18	36	45	2	14	14	0	0	12	12.0	24.2	10690606	34.00	42031	7.3	0.00098	Yes	No	Conducted system checks, changed bag filters twice.	
1/21/2022	GWTT	Yes	21	37	45	4	13	13	0	2	10	12.0	23.9	10729831	25.00	39225	9.1	0.00122	Yes	No	Conducted system checks, changed bag filters.	
1/24/2022	GWTT	Yes	24	36	43	4	14	14	0	0	11	11.0	23.0	10792092	35.00	62261	14.4	0.00194	Yes	Yes	Conducted system checks, changed bag filters twice. System sampled on 1/25/2022.	
1/28/2022	GWTT	Yes	28	36	45	3	15	15	0	0	10.0	11.0	22.5	10838454	33	46362	8.0	0.00108	No	No	Conducted system checks, changed bag filters.	
1/31/2022	GWTT	Yes	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	No	No	Upon arrival, system was shutdown due to loss of power from snow storm on 1/29/2022. Heat was off and system was frozen. Attempts were made to drain water from the pumps and associated piping, but everything was frozen.	
Totals - January 2022 ¹⁰				29									24.6		33.1	378968	9.1	0.001				

Notes:
1. GWTT - Groundwater Treatment Technologies
2. Pressure readings before filter bag changeout or if no changeout was done.
3. Influent flow is an instantaneous estimate of the flow rate from the submersible Well Pump at PRW-4.
4. During monthly reporting periods the net gallons are calculated from previous effluent totalizer readings. (Difference between the current totalizer reading - the last dated totalizer reading).
5. The Average effluent flow rate is calculated from the net gallons obtained from the system's effluent totalizer flow meter and days that the system was in operation.
6. The "Totals" shown (from left to right) include the, Total Days of System Operation, Average Instantaneous Influent Flow Rate, Average Instantaneous Effluent Flow Rate, Total Gallons Treated, Average Net Effluent Flow Rate, and Estimated PFAS Removed for the respective monthly reporting period.
7. Instantaneous influent flow rates are estimated by approximating 50% of the influent flow rate values calculated from GWFTS #1 (See Table 2A).
8. Instantaneous effluent flow rate estimated by stopwatch at totalizer meter.
9. Flow calculated based on gallons marking on EQ tank. Estimated flow rate = 25 GPM (i.e. flow is calculated based on an in-situ observation of flow into the EQ tank, and 100 gallons of groundwater flows into the EQ tank for a 4 minute duration.
10. The monthly totals represent the monthly IRA reporting period and the average effluent flow rates calculated from the first monitoring date are based on measurements from the last monitoring date of the previous reporting period.

Table 3 - Groundwater Elevation and Gauging Date 2018-2022
Former Barnstable County Fire Rescue Training Academy
RTN 4-26179

Well ID	Location (From Academy)	Elev. (TOC) (Feet)	Groundwater Level from TOC (Feet)													
			Date													
			6/26/2018	1/9/2019	4/23/2019	7/22/2019	10/28/2019	2/18-19/2020	5/11/2020	7/27/2020	10/20/2020	1/28/2021	5/19/2021	7/29/2021	11/1/2021	1/25/2022
FS-1sa2	Academy	41.839	--	12.45	10.96	11.78	--	11.56	10.82	13.47	15.16	15.54	15.15	16.81	15.85	--
FS-1sA	Academy	41.769	--	--	--	--	--	--	--	--	--	--	--	--	--	--
FS-1sC	Academy	41.915	--	--	--	--	--	--	--	--	--	15.43	--	--	--	--
HSW-1/HS-1(a)	Academy	40.012	--	9.62	8.78	8.02	11.67	9.45	7.9	12.33	14.37	13.31	13.04	14.73	13.94	13.13
HSW-6/HS-2(a)	Academy	39.305	9.37	10.39	8.02	8.02	10.76	8.74	8.63	10.67	13.36	12.61	12.35	14.04	13.32	12.41
OW-2D	Academy	37.36	--	7.91	6.39	6.39	8.76	7.00	6.20	6.94	11.75	10.78	10.60	12.34	11.34	10.90
OW-2S	Academy	37.532	--	8.33	6.22	7.93	9.59	7.65	6.98	9.54	12.52	11.49	11.3	12.94	12	11.34
OW-4	Not Located	NS	--	--	--	--	--	--	--	--	--	--	--	--	--	--
OW-8A	Academy	42.471	12.33	12.21	11.75	12.59	14.37	12.4	11.57	14.26	16.91	16.19	15.94	17.6	16.62	15.92
OW-8i	Academy	42.579	--	--	--	--	--	--	--	--	17.01	16.15	--	--	--	--
PFW-1	Academy	41.83	11.67	12.53	11.02	11.83	13.78	11.65	10.84	13.54	16.25	15.54	15.19	16.87	15.95	15.25
PFW-2	Academy	40.019	--	10.44	8.95	9.72	11.53	9.6	8.77	11.48	15.21	13.48	13.05	14.85	13.95	13.28
PFW-3	Academy	37.832	--	8.2	6.67	7.5	9.29	7.32	6.5	9.25	12.00	11.14	10.92	12.60	11.64	11.00
PFW-4	Academy	39.344	--	9.78	8.21	9.07	10.98	8.84	8.03	10.81	14.5	12.69	12.45	14.12	13.15	12.46
PFW-5	Academy	42.017	--	12.38	11.29	11.79	13.56	11.55	10.77	13.48	16.15	15.38	15.11	16.82	15.8	15.11
PFW-6	Academy	40.577	--	11.23	9.75	10.59	--	10.4	9.59	12.28	14.94	14.26	13.98	16.65	destroyed	--
MW-1	Adjacent Academy	42.584	--	--	12.06	12.54	14.46	12.35	11.54	14.19	16.92	16.22	15.9	17.59	16.65	15.95
MW-2	Adjacent Academy	42.72	--	--	--	--	14.79	12.7	11.82	14.56	17.24	16.56	16.25	17.92	17.05	16.3
MW-3D	Adjacent Academy	43.654	--	--	--	--	--	--	--	--	17.61	16.91	16.55	--	--	--
MW-3i	Adjacent Academy	43.823	--	13.8	12.31	13.14	15.04	--	--	--	17.49	16.84	--	--	--	--
MW-3S	Adjacent Academy -SE	43.535	--	13.64	12.17	12.99	14.89	12.8	11.99	14.69	17.39	16.65	16.35	18.04	17.25	16.4
MW-6	Adjacent Academy -SE	41.432	--	--	--	--	13.58	11.4	10.61	13.24	--	15.3	15.0	17.62	15.80	15
MW-7	Adjacent Academy -SE	43.126	--	--	12.8	13.6	15.59	13.42	12.63	15.24	dry	17.33	17.0	18.56	17.75	17
MW-8	Adjacent Academy -SE	48.721	--	--	13.46	14.28	16.22	--	13.29	--	dry	dry	--	--	--	--
MW-8C	Adjacent Academy -SE	43.992	--	--	--	--	--	14.1	--	--	dry	17.96	17.6	18.2	18.4	17.65
MW-9D (not viable)	Adjacent Academy -SE	45.079	--	--	14.21	--	17.08	14.9	--	--	19.44	--	--	--	--	-
MW-9S	Adjacent Academy -SE	44.629	--	--	--	--	--	--	--	--	--	18.84	--	--	--	18.5
MW-10	Adjacent Academy	44.212	--	14.85	13.43	14.26	16.23	14.06	13.26	15.92	dry	dry	17.53	17.53	18.43	17.8
MW-10D	Adjacent Academy/Destr	NS	--	--	--	--	--	--	--	--	--	--	--	--	--	-
MW-10S	Adjacent Academy/Destr	NS	--	--	--	--	--	--	--	--	--	--	--	--	--	-
MW-11	Adjacent Academy/Destr	NS	--	--	--	--	15.5	--	--	--	--	--	--	--	--	-
MW-12s	DG -E	43.421	14.62	14.76	13.3	14.29	16.1	13.94	13.2	15.8	18.32	17.94	17.6	dry	17.7	17.35
MW-12i	DG -E	43.448	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-13	DG -E	43.404	--	--	--	--	--	--	--	--	--	--	--	19.5	--	--
MW-15D	DG -E	43.591	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-15S	DG -E	43.458	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-17	DG -E	NS	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-19A	DG- NE	44.06	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-19B	DG- NE	44.146	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-21	DG-NE	41.23	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-22	DG-NE	43.46	14.3	15.06	13.5	14.4	16.35	14.13	13.32	15.9	18.46	18.23	17.22	dry	18.35	17.5
MW-23	DG-NE	49.491	--	--	--	--	--	--	--	--	--	--	--	18.99	--	--
MW-27	DG-NE	41.909	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-28S	DG- NE	41.413	--	--	--	--	12.95	10.9	10.1	12.77	15.41	14.75	14.6	16.14	15.15	14.41
MW-28D (abandoned)	DG- NE	NA	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-32	DG- NE	41.984	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-33	DG- NE	52.612	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-35i	DG- NE	52.265	--	27.32	--	--	29.08	--	--	--	28.39	--	--	--	28.9	--
MW-35s	DG- NE	52.557	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-35D	DG- NE	52.481	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-36A	DG- NE	58.548	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-36B	DG- NE	58.498	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-36D	DG- NE	58.43	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-37D	DG-E	46.862	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-37i	DG-E	46.875	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-37s	DG-E	47.046	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-99i	DG-E - North of PRW-4	49.98	--	--	--	--	22.94	--	--	--	--	--	--	--	--	--
PC-0	DG-SE	58.276	--	--	--	--	--	--	--	--	--	--	--	--	--	--
PC-1	DG-SE	54.57	26.14	26.81	25.36	26.22	28.34	26	25.24	27.88	30.41	--	29.45	31.23	30.25	29.8
PC-2	DG-SE	51.776	--	--	--	--	--	--	--	--	--	--	--	--	--	--
PC-3	DG-SE	52.047	--	--	--	--	--	--	--	--	--	--	--	--	--	--
PC-4	DG-SE/destroyed	NS	--	--	--	--	--	--	--	--	--	--	--	--	--	-
PC-5	DG-SE/destroyed	NS	--	--	--	--	--	--	--	--	--	--	--	--	--	-
PC-6A	DG- Far east	59.322	31.05													

Table 3 - Groundwater Elevation and Gauging Date 2018-2022
Former Barnstable County Fire Rescue Training Academy
RTN 4-26179

Well ID	Location (From Academy)	Elev. (TOC) (Feet)	Groundwater Elevation (Feet)													
			Date													
			6/26/2018	1/9/2019	4/23/2019	7/22/2019	10/28/2019	2/18-19/2020	5/11/2020	7/27/2020	10/20/2020	1/28/2021	5/19/2021	7/29/2021	11/1/2021	1/25/2022
FS-1sa2	Academy	41.839	--	29.389	30.879	30.059	--	30.279	31.019	28.369	26.679	26.299	26.689	25.029	25.989	--
FS-1sA	Academy	41.769	--	--	--	--	--	--	--	--	--	--	--	--	--	--
FS-1sC	Academy	41.915	--	--	--	--	--	--	--	--	--	--	--	--	--	--
HSW-1/HS-1(a)	Academy	40.012	--	30.392	31.232	31.992	28.342	30.562	32.112	27.682	25.642	26.702	26.972	25.282	26.072	26.882
HSW-6/HS-2(a)	Academy	39.305	29.935	28.915	31.285	31.285	28.545	30.565	30.675	28.635	25.945	26.695	26.955	25.265	25.985	26.895
OW-2D	Academy	37.36	--	29.45	30.97	30.97	28.6	30.36	31.16	30.42	25.61	26.58	26.76	25.02	26.02	26.46
OW-2S	Academy	37.532	--	29.202	31.312	29.602	27.942	29.882	30.552	27.992	25.012	26.042	26.232	24.592	25.532	26.192
OW-4	Not Located	NS	--	--	--	--	--	--	--	--	--	--	--	--	--	--
OW-8A	Academy	42.471	30.141	30.261	30.721	29.881	28.101	30.071	30.901	28.211	25.561	26.281	26.531	24.871	25.851	26.551
OW-8i	Academy	42.579	--	--	--	--	--	--	--	--	25.569	26.429	--	--	--	--
PFW-1	Academy	41.83	30.16	29.3	30.81	30	28.05	30.18	30.99	28.29	25.58	26.29	26.64	24.96	25.88	26.58
PFW-2	Academy	40.019	--	29.579	31.069	30.299	28.489	30.419	31.249	28.539	24.809	26.539	26.969	25.169	26.069	26.739
PFW-3	Academy	37.832	--	29.632	31.162	30.332	28.542	30.512	31.332	28.582	25.832	26.692	26.912	25.232	26.192	26.832
PFW-4	Academy	39.344	--	29.564	31.134	30.274	28.364	30.504	31.314	28.534	24.844	26.654	26.894	25.224	26.194	26.884
PFW-5	Academy	42.017	--	29.637	30.727	30.227	28.457	30.467	31.247	28.537	25.867	26.637	26.907	25.197	26.217	26.907
PFW-6	Academy	40.577	--	29.347	30.827	29.987	--	30.177	30.987	28.297	25.637	26.317	26.597	23.927	--	--
MW-1	Adjacent Academy	42.584	--	--	20.79	30.044	28.124	30.234	31.044	28.394	25.664	26.364	26.684	24.994	25.934	26.634
MW-2	Adjacent Academy	42.72	--	--	--	--	27.93	30.02	30.9	28.16	25.48	26.16	26.47	24.8	25.67	26.42
MW-3D	Adjacent Academy	43.654	--	--	--	--	--	--	--	--	26.044	26.744	27.104	--	--	--
MW-3i	Adjacent Academy	43.823	--	29.24	30.73	29.9	28.783	--	--	--	26.333	26.983	--	--	--	--
MW-3S	Adjacent Academy -SE	43.535	--	29.22	30.75	29.93	28.645	30.735	31.545	28.845	26.145	26.885	27.185	25.495	26.285	27.135
MW-6	Adjacent Academy -SE	41.432	--	--	--	--	27.852	30.032	30.822	28.192	--	--	--	--	25.632	26.432
MW-7	Adjacent Academy -SE	43.126	--	--	30.326	27.536	27.536	29.706	30.496	27.886	dry	25.796	26.126	24.566	25.376	26.126
MW-8	Adjacent Academy -SE	48.721	--	--	35.261	34.441	32.501	--	--	--	--	dry	dry	dry	--	--
MW-8C	Adjacent Academy -SE	43.992	--	--	--	--	--	--	--	--	--	26.032	26.392	25.792	25.592	26.342
MW-9D (not viable)	Adjacent Academy -SE	45.079	--	--	30.869	--	27.999	30.179	--	--	--	--	--	--	--	--
MW-9S	Adjacent Academy -SE	44.629	--	--	--	--	--	--	--	--	--	25.789	--	--	--	26.129
MW-10	Adjacent Academy	44.212	--	29.362	30.782	29.952	27.982	30.152	30.952	28.292	--	dry	26.682	26.682	25.782	26.412
MW-10D	Adjacent Academy/Destroyed	NS	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-10S	Adjacent Academy/Destroyed	NS	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-11	Adjacent Academy/Destroyed	NS	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-12s	DG -E	43.421	28.801	28.661	30.121	29.131	27.321	29.481	30.221	27.621	25.101	25.481	25.821	dry	25.721	26.071
MW-12i	DG -E	43.448	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-13	DG -E	43.404	--	--	--	--	--	--	--	--	--	--	--	23.626	--	--
MW-15D	DG -E	43.591	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-15S	DG -E	43.458	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-17	DG -E	NS	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-19A	DG- NE	44.06	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-19B	DG- NE	44.146	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-21	DG-NE	41.23	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-22	DG-NE	43.46	29.16	28.4	29.96	29.06	27.11	29.33	30.14	27.56	25.00	25.23	26.24	dry	25.11	25.96
MW-23	DG-NE	49.491	--	--	--	--	--	--	--	--	--	--	--	30.501	--	--
MW-27	DG-NE	41.909	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-28S	DG- NE	41.413	--	--	--	--	28.463	30.513	31.313	28.643	26.003	26.663	26.813	25.273	26.263	27.003
MW-28D (abandoned)	DG- NE	NA	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-32	DG- NE	41.984	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-33	DG- NE	52.612	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-35i	DG- NE	52.265	--	24.945	--	--	23.185	--	--	--	23.875	--	--	--	23.365	--
MW-35s	DG- NE	52.557	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-35D	DG- NE	52.481	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-36A	DG- NE	58.548	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-36B	DG- NE	58.498	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-36D	DG- NE	58.43	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-37D	DG-E	46.862	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-37i	DG-E	46.875	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-37s	DG-E	47.046	--	--	--	--	--	--	--	--	--	--	--	--	--	--
MW-99i	DG-E - North of PRW-4	49.98	--	--	--	--	27.04	--	--	--	--	--	--	--	--	--
PC-0	DG-SE	58.276	--	--	--	--	--	--	--	--	--	--	--	--	--	--
PC-1	DG-SE	54.57	28.43	27.76	29.21	28.35	26.23	28.57	29.33	26.69	24.16	--	--	23.34	24.32	24.77
PC-2	DG-SE	51.776	--	--	--	--	--	--	--	--	--	--	--	--	--	--
PC-3	DG-SE	52.047	--	--	--	--	--	--	--	--	--	--	--	--	--	--
PC-4	DG-SE/destroyed	NS	--	--	--	--	--	--	--	--	--	--	--	--	--	--
PC-5	DG-SE/destroyed	NS	--	--	--	--	--	--	--	--	--	--	--	--	--	--
PC-6A																

Table 4A - Summary of Long Term Monitoring Groundwater PFAS Analytical Data

Former Barnstable Country Fire and Rescue Training Academy

155 S. Flint Rock Road, Barnstable, MA

RTN 4-26179

SAMPLE ID	USEPA ^{1,2} HEALTH ADVISORY	Method 1 GW-1 Standards ⁴	HSW-6/HS-2(a)																
SCREEN DEPTH (FEET)																			
WELL DIAMETER (INCHES)			2																
WELL STATUS			Viable																
SAMPLING DATE			1/21/2016	3/30/2016	8/11/2016	4/10/2017	7/27/2017	11/17/2017	2/9/2018	6/26/2018	1/9/2019	10/28/2019	7/28/2020	10/20/2020	1/26/2021	5/20/2021	7/28/2021	11/2/2021	1/25/2022
UNITS	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L
PFAS (Method 537.2)																			
PFOA	70	20	77,000	320,000	41,000	28,000	21,000	45,000	25,000	950	1,300	3,600	2,300	5,700	2,800	2,700	1,500	1,900	1,600
PFNA	70	20	--	--	--	660	--	320	160	15	94	79	80	48	320	180	45	550	170
PFNA	NE	20	--	--	--	--	--	--	--	BRL (<87)	26	46	40	52	35	47	57	65	46
PFHxS	NE	20	--	--	--	--	--	--	--	26	140	310	350	71	1,400	440	100	2,500	410
PFHpA	NE	20	--	--	--	--	--	--	--	15	66	100	69	56	640	150	49	870	160
PFDA	NE	20	--	--	--	--	--	--	--	--	--	30	18	23	21	19	13	12	7
TOTAL Σ 6 PFAS	70	20	77,000	320,000	41,000	28,660	21,000	45,320	25,160	1,006	1,626	4,165	2,857	5,950	5,216	3,536	1,764	5,897	2,393

Notes:

- Prior to June 11, 2018, the USEPA established the EPA Health Advisory for two PFAS chemicals, PFOA and PFOS, which was 70 ng/L. Subsequently, MassDEP's Office of Research and Standards (ORS) expanded on this Health Advisory and created the ORS Guideline that applies to the total summed of five PFAS chemicals, PFOS, PFOA, PFNA, PFHxS, and PFHpA, effective June 11, 2018.
- The USEPA and MassDEP ORS Guideline applies to five PFAS chemicals of concern (PFOS, PFOA, PFNA, PFHpA, and PFHxS) individually as well as the sum of the five PFAS of concern.
- The complete PFAS concentration data set collected from PRW-4 is detailed in the data table titled "Summary of Groundwater Pump and Treatment System PFOS/PFOA Analytical Data. Data presented herein is summarized and data was selected based on quarterly sampling events.
- (--) Concentrations of the three additional PFAS chemicals, PFNA, PFHxS, and PFHpA were not presented until after the MassDEP ORS Guideline was in effect on 06.11.18. PFAS concentrations were regulated by the USEPA Health Advisory prior to 6.11.18. Concentrations of PFDA were not presented prior to April 19, 2019. MassDEP released drafted Method 1 groundwater risk standards for PFAS on April 19, 2019 that applies to the total sum and individual concentrations of six PFAS compounds (PFOS, PFOA, PFNA, PFHxS, PFHpA, and PFDA), which is 20 ng/L. These drafted groundwater standards were finalized and became effective on December 27, 2019.
- BRL - Below Laboratory Detection Limits
- Concentrations presented in ng/L - nanograms per Liter - parts per trillion
- Concentrations in bold exceed applicable Health Advisory Limit or Method 1 GW-1 Standard
- PFOS - Perfluorooctanesulfonate
- PFOA - Perfluorooctanoic Acid
- PFNA - Perfluorononanoic Acid
- PFHxS - Perfluorohexanesulfonic Acid
- PFHpA - Perfluoroheptanoic Acid
- PFDA - Perfluorodecanoic Acid
- NA - Concentration data not available
- Monitoring well HS-1, HS-2, HS-2S, and HS-6 were destroyed or removed during soil removal activities in January 2017 as part of an Immediate Response Action Plan. The well was replaced with HSW-1/HS-1a as post-exacavation activities.
- Monitoring well HW-1D is a downgradient well located on the north side of Mary Dunn Pond.
- NE - Not Established

Table 4A - Summary of Long Term Monitoring Groundwater PFAS Analytical

Former Barnstable Country Fire and Rescue Training Academy

155 S. Flint Rock Road, Barnstable, MA

RTN 4-26179

SAMPLE ID	USEPA ^{1,2} HEALTH ADVISORY	Method 1 GW-1 Standards ⁴	HSW-1/HS-1(a)												
SCREEN DEPTH (FEET)															
WELL DIAMETER (INCHES)			2												
WELL STATUS			Viable												
SAMPLING DATE			1/21/2016	8/11/2016	4/10/2017	7/27/2017	11/17/2017	2/9/2018	1/9/2019	4/23/2019	7/22/2019	10/28/2019	2/18/2020	5/11/2020	11/2/2021
UNITS	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L
PFAS (Method 537.2)															
PFOS	70	20	110,000	56,000	38,000	24,000	25,000	13,000	1,800	2,000	1,100	1,800	740	1,300	1,800
PFOA	70	20	--	--	1,000	350	1,300	320	840	100	64	46	36	100	470
PFNA	NE	20	--	--	--	--	--	--	43	65	43	33	22	57	46
PFHxS	NE	20	--	--	--	--	--	--	1,700	300	170	150	66	300	1,600
PFHpA	NE	20	--	--	--	--	--	--	510	67	52	43	32	63	430
PFDA	NE	20	--	--	--	--	--	--	--	55	19	13	9.1	37	12
TOTAL Σ 6 PFAS	70	20	110,000	56,000	39,000	24,350	26,300	13,320	4,893	2,587	1,448	2,085	905	1,857	4,358

Notes:

1. Prior to June 11, 2018, the USEPA established the EPA Health Advisory for two PFAS chemicals, PFOA and PFOS, which was 70 ng/L. Subsequently, MassDEP's Office of Research and Standards (ORS) expanded on this Health Advisory and created the ORS Guideline that applies to the total summed of five PFAS chemicals, PFOS, PFOA, PFNA, PFHxS, and PFHpA, effective June 11, 2018.
2. The USEPA and MassDEP ORS Guideline applies to five PFAS chemicals of concern (PFOS, PFOA, PFNA, PFHpA, and PFHxS) individually as well as the sum of the five PFAS of concern.
3. The complete PFAS concentration data set collected from PRW-4 is detailed in the data table titled "Summary of Groundwater Pump and Treatment System PFOS/PFOA Analytical Data." Data presented herein is summarized and data was selected based on quarterly sampling events.
4. (--) Concentrations of the three additional PFAS chemicals, PFNA, PFHxS, and PFHpA were not presented until after the MassDEP ORS Guideline was in effect on 06.11.18. PFAS concentrations were regulated by the USEPA Health Advisory prior to 6.11.18. Concentrations of PFDA were not presented prior to April 19, 2019. MassDEP released drafted Method 1 groundwater risk standards for PFAS on April 19, 2019 that applies to the total sum and individual concentrations of six PFAS compounds (PFOS, PFOA, PFNA, PFHxS, PFHpA, and PFDA), which is 20 ng/L. These drafted groundwater standards were finalized and became effective on December 27, 2019.
5. BRL - Below Laboratory Detection Limits
6. Concentrations presented in ng/L - nanograms per Liter - parts per trillion
7. Concentrations in bold exceed applicable Health Advisory Limit or Method 1 GW-1 Standard
8. PFOS - Perfluorooctanesulfonate
9. PFOA - Perfluorooctanoic Acid
10. PFNA - Perfluorononanoic Acid
11. PFHxS - Perfluorohexanesulfonic Acid
12. PFHpA - Perfluoroheptanoic Acid
13. PFDA - Perfluorodecanoic Acid
14. NA - Concentration data not available
15. Monitoring well HS-1, HS-2, HS-2S, and HS-6 were destroyed or removed during soil removal activities in January 2017 as part of an Immediate Response Action Plan. The well was replaced with HSW-1/HS-1a as post-exacavation activities.
16. Monitoring well HW-1D is a downgradient well located on the north side of Mary Dunn Pond.
17. NE - Not Established

Table 4A - Summary of Long Term Monitoring Groundwater PFAS Analytical

Former Barnstable Country Fire and Rescue Training Academy

155 S. Flint Rock Road, Barnstable, MA

RTN 4-26179

SAMPLE ID	USEPA ^{1,2} HEALTH ADVISORY	Method 1 GW-1 Standards ⁴	PFW-1																					
SCREEN DEPTH (FEET)																								
WELL DIAMETER(INCHES)			2																					
WELL STATUS			Viable																					
SAMPLING DATE			4/1/2015	10/7/2015	3/8/2016	3/30/2016	8/11/2016	4/10/2017	2/9/2018	6/26/2018	1/9/2019	4/23/2019	7/22/2019	10/28/2019	2/18/2020	5/11/2020	7/28/2020	10/20/2020	1/26/2021	5/20/2021	7/28/2021	11/2/2021	1/25/2022	
UNITS	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L		
PFAS (Method 537.2)																								
PFO5	70	20	8,400	60,000	7,000	56,000	3,500	4,100	8,100	76,000	38,000	20,000	24,000	16,000	22,000	6,000	5,200	4,000	3,400	3,100	3,300	3,900	4,400	
PFOA	70	20	360	800	--	--	--	--	470	1,500	160	300	560	130	220	250	210	110	150	160	330	170	270	
PFNA	NE	20	--	--	--	--	--	--	--	3,900	330	360	210	570	230	94	110	80	94	66	50	69	120	
PFHxS	NE	20	--	--	--	--	--	--	--	7,400	960	1,500	4,800	910	1,000	890	820	450	750	750	2,500	870	1,000	
PFHpA	NE	20	--	--	--	--	--	--	--	610	140	290	500	150	200	220	160	82	200	250	440	190	390	
PFDA	NE	20	--	--	--	--	--	--	--	--	--	110	160	120	200	81	89	37	69	45	28	54	36	
TOTAL Σ 6 PFAS	70	20	8,760	60,800	7,000	56000	3500	4,100	8,570	89,410	39,590	22,560	30,230	17,880	23,850	7,535	6,589	4,759	4,663	4,371	6,648	5,253	6,216	

Notes:

1. Prior to June 11, 2018, the USEPA established the EPA Health Advisory for two PFAS chemicals, PFOA and PFOS, which was 70 ng/L. Subsequently, MassDEP's Office of Research and Standards (ORS) expanded on this Health Advisory and created the ORS Guideline that applies to the total summed of five PFAS chemicals, PFOS, PFOA, PFNA, PFHxS, and PFHpA, effective June 11, 2018.
2. The USEPA and MassDEP ORS Guideline applies to five PFAS chemicals of concern (PFOS, PFOA, PFNA, PFHpA, and PFHxS) individually as well as the sum of the five PFAS of concern.
3. The complete PFAS concentration data set collected from PRW-4 is detailed in the data table titled "Summary of Groundwater Pump and Treatment System PFOS/PFOA Analytical Data." Data presented herein is summarized and data was selected based on quarterly sampling events.
4. (-) Concentrations of the three additional PFAS chemicals, PFNA, PFHxS, and PFHpA were not presented until after the MassDEP ORS Guideline was in effect on 06.11.18. PFAS concentrations were regulated by the USEPA Health Advisory prior to 6.11.18. Concentrations of PFDA were not presented prior to April 19, 2019. MassDEP released drafted Method 1 groundwater risk standards for PFAS on April 19, 2019 that applies to the total sum and individual concentrations of six PFAS compounds (PFOS, PFOA, PFNA, PFHxS, PFHpA, and PFDA), which is 20 ng/L. These drafted groundwater standards were finalized and became effective on December 27, 2019.

5. BRL - Below Laboratory Detection Limits

6. Concentrations presented in ng/L - nanograms per Liter - parts per trillion

7. Concentrations in bold exceed applicable Health Advisory Limit or Method 1 GW-1 Standard

8. PFOS - Perfluorooctanesulfonate

9. PFOA - Perfluorooctanoic Acid

10. PFNA - Perfluorononanoic Acid

11. PFHxS - Perfluorohexanesulfonic Acid

12. PFHpA - Perfluoroheptanoic Acid

13. PFDA - Perfluorodecanoic Acid

14. NA - Concentration data not available

15. Monitoring well HS-1, HS-2, HS-2S, and HS-6 were destroyed or removed during soil removal activities in January 2017 as part of an Immediate Response Action Plan. The well was replaced with HSW-1/HS-1a as post-exacavation activities.

16. Monitoring well HW-1D is a downgradient well located on the north side of Mary Dunn Pond.

17. NE - Not Established

Table 4A - Summary of Long Term Monitoring Groundwater PFAS Analytical

Former Barnstable Country Fire and Rescue Training Academy

155 S. Flint Rock Road, Barnstable, MA

RTN 4-26179

SAMPLE ID	USEPA ^{1,2} HEALTH ADVISORY	Method 1 GW-1 Standards ⁴	PFW-2															
SCREEN DEPTH (FEET)																		
WELL DIAMETER (INCHES)			2															
WELL STATUS			Viable															
SAMPLING DATE			4/1/2015	6/18/2015	10/27/2015	1/21/2016	3/30/2016	8/11/2016	12/8/2016	4/10/2017	7/27/2017	11/17/2017	2/9/2018	1/9/2019	10/28/2019	5/11/2020	10/20/2020	11/2/2021
UNITS	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L
PFAS (Method 537.2)																		
PFOA	70	20	220,000	200,000	32,000	39,000	120,000	65,000	13,000	17,000	73,000	25,000	32,000	5,200	2,100	690	1,700	1,200
PFNA	70	20	5200	BRL (<800)	--	1,100	2,100	--	--	970	910	400	400	720	74	48	30	170
PFNA	NE	20	--	--	--	--	--	--	--	--	--	--	--	110	64	39	52	32
PFHxS	NE	20	--	--	--	--	--	--	--	--	--	--	--	1,800	230	140	71	650
PFHpA	NE	20	--	--	--	--	--	--	--	--	--	--	--	470	68	45	31	270
PFDA	NE	20	--	--	--	--	--	--	--	--	--	--	--	--	27	14	23	4
TOTAL Σ 6 PFAS	70	20	225,200	200,000	32,000	40,100	122,100	65,000	13,000	17,970	73,910	25,400	32,400	8,300	2,563	976	1,907	2,326

Notes:

1. Prior to June 11, 2018, the USEPA established the EPA Health Advisory for two PFAS chemicals, PFOA and PFOS, which was 70 ng/L. Subsequently, MassDEP's Office of Research and Standards (ORS) expanded on this Health Advisory and created the ORS Guideline that applies to the total summed of five PFAS chemicals, PFOS, PFOA, PFNA, PFHxS, and PFHpA, effective June 11, 2018.

2. The USEPA and MassDEP ORS Guideline applies to five PFAS chemicals of concern (PFOS, PFOA, PFNA, PFHpA, and PFHxS) individually as well as the sum of the five PFAS of concern.

3. The complete PFAS concentration data set collected from PRW-4 is detailed in the data table titled "Summary of Groundwater Pump and Treatment System PFOS/PFOA Analytical Data." Data presented herein is summarized and data was selected based on quarterly sampling events.

4. (--) Concentrations of the three additional PFAS chemicals, PFNA, PFHxS, and PFHpA were not presented until after the MassDEP ORS Guideline was in effect on 06.11.18. PFAS concentrations were regulated by the USEPA Health Advisory prior to 6.11.18. Concentrations of PFDA were not presented prior to April 19, 2019. MassDEP released drafted Method 1 groundwater risk standards for PFAS on April 19, 2019 that applies to the total sum and individual concentrations of six PFAS compounds (PFOS, PFOA, PFNA, PFHxS, PFHpA, and PFDA), which is 20 ng/L. These drafted groundwater standards were finalized and became effective on December 27, 2019.

5. BRL - Below Laboratory Detection Limits

6. Concentrations presented in ng/L - nanograms per Liter - parts per trillion

7. Concentrations in bold exceed applicable Health Advisory Limit or Method 1 GW-1 Standard

8. PFOS - Perfluorooctanesulfonate

9. PFOA - Perfluorooctanoic Acid

10. PFNA - Perfluorononanoic Acid

11. PFHxS - Perfluorohexanesulfonic Acid

12. PFHpA - Perfluoroheptanoic Acid

13. PFDA - Perfluorodecanoic Acid

14. NA - Concentration data not available

15. Monitoring well HS-1, HS-2, HS-2S, and HS-6 were destroyed or removed during soil removal activities in January 2017 as part of an Immediate Response Action Plan. The well was replaced with HSW-1/HS-1a as post-exacavation activities.

16. Monitoring well HW-1D is a downgradient well located on the north side of Mary Dunn Pond.

17. NE - Not Established

Table 4A - Summary of Long Term Monitoring Groundwater PFAS Analytical

Former Barnstable Country Fire and Rescue Training Academy

155 S. Flint Rock Road, Barnstable, MA

RTN 4-26179

SAMPLE ID	USEPA ^{1,2} HEALTH ADVISORY	Method 1 GW-1 Standards ⁴	PFW-5														
SCREEN DEPTH (FEET)																	
WELL DIAMETER (INCHES)			2														
WELL STATUS			Viable														
SAMPLING DATE			3/31/2015	4/11/2017	1/9/2019	4/23/2019	7/22/2019	10/28/2019	2/18/2020	5/11/2020	7/28/2020	10/20/2020	1/26/2021	5/19/2020	7/28/2021	11/2/2021	1/25/2022
UNITS	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L
PFAS (Method 537.2)																	
PFOA	70	20	2,700	2,100	1,100	1,900	1,600	2,400	1,000	1,200	980	1,500	1,200	1,200	3,100	370	370
PFNA	70	20	250	170	64	150	120	26	88	120	100	120	84	120	180	89	150
PFHxS	NE	20	--	--	BRL (<8.7)	25	16	BRL (<4.9)	11	22	15	29	32	27	15	12	8.6
PFHpA	NE	20	--	--	240	680	630	260	360	720	610	420	310	790	1,100	560	1,300
PFOA	NE	20	--	--	30	82	54	22	56	66	44	60	80	110	160	76	240
PFDA	NE	20	--	--	--	12	11	BRL (<4.1)	10	13	11	16	5	7	7	BRL (<3.9)	5.4
TOTAL Σ 6 PFAS	70	20	2,950	2,270	1,434	2,849	2,431	2,708	1,525	2,141	1,760	2,145	1,711	2,254	4,562	1,107	2,074

Notes:

1. Prior to June 11, 2018, the USEPA established the EPA Health Advisory for two PFAS chemicals, PFOA and PFOS, which was 70 ng/L. Subsequently, MassDEP's Office of Research and Standards (ORS) expanded on this Health Advisory and created the ORS Guideline that applies to the total summed of five PFAS chemicals, PFOS, PFOA, PFNA, PFHxS, and PFHpA, effective June 11, 2018.

2. The USEPA and MassDEP ORS Guideline applies to five PFAS chemicals of concern (PFOS, PFOA, PFNA, PFHpA, and PFHxS) individually as well as the sum of the five PFAS of concern.

3. The complete PFAS concentration data set collected from PRW-4 is detailed in the data table titled "Summary of Groundwater Pump and Treatment System PFOS/PFOA Analytical Data." Data presented herein is summarized and data was selected based on quarterly sampling events.

4. (--) Concentrations of the three additional PFAS chemicals, PFNA, PFHxS, and PFHpA were not presented until after the MassDEP ORS Guideline was in effect on 06.11.18. PFAS concentrations were regulated by the USEPA Health Advisory prior to 6.11.18. Concentrations of PFDA were not presented prior to April 19, 2019. MassDEP released drafted Method 1 groundwater risk standards for PFAS on April 19, 2019 that applies to the total sum and individual concentrations of six PFAS compounds (PFOS, PFOA, PFNA, PFHxS, PFHpA, and PFDA), which is 20 ng/L. These drafted groundwater standards were finalized and became effective on December 27, 2019.

5. BRL - Below Laboratory Detection Limits

6. Concentrations presented in ng/L - nanograms per Liter - parts per trillion

7. Concentrations in bold exceed applicable Health Advisory Limit or Method 1 GW-1 Standard

8. PFOS - Perfluorooctanesulfonate

9. PFOA - Perfluorooctanoic Acid

10. PFNA - Perfluorononanoic Acid

11. PFHxS - Perfluorohexanesulfonic Acid

12. PFHpA - Perfluoroheptanoic Acid

13. PFDA - Perfluorodecanoic Acid

14. NA - Concentration data not available

15. Monitoring well HS-1, HS-2, HS-2S, and HS-6 were destroyed or removed during soil removal activities in January 2017 as part of an Immediate Response Action Plan. The well was replaced with HSW-1/HS-1a as post-exacavation activities.

16. Monitoring well HW-1D is a downgradient well located on the north side of Mary Dunn Pond.

17. NE- Not Established

Table 4A - Summary of Long Term Monitoring Groundwater PFAS Analytical

Former Barnstable Country Fire and Rescue Training Academy
155 S. Flint Rock Road, Barnstable, MA
RTN 4-26179

SAMPLE ID	USEPA ^{1,2} HEALTH ADVISORY	Method 1 GW-1 Standards ⁴	OW-8A																	
SCREEN DEPTH (FEET)																				
WELL DIAMETER (INCHES)			2																	
WELL STATUS			Viable																	
SAMPLING DATE			11/22/2013	6/3/2014	4/11/2017	8/16/2017	6/26/2018	1/9/2019	4/23/2019	7/22/2019	10/28/2019	2/18/2020	5/11/2020	7/28/2020	10/20/2020	1/26/2021	5/19/2021	7/28/2021	11/3/2021	1/25/2022
UNITS	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L
PFAS (Method 537.2)																				
PFOS	70	20	2,700	8,600	1,700	770	2,800	990	880	780	220	650	150	170	40	230	120	11	520	120
PFOA	70	20	430	1,000	2,000	120	65	420	66	55	130	62	18	12	BRL (<5.0)	290	120	7	720	11
PFNA	NE	20	--	--	--	--	310	150	120	78	10	110	12	11	BRL (<5.1)	120	250	BRL (<5.1)	70	BRL (<5.1)
PFHxS	NE	20	--	--	--	--	250	890	140	100	750	190	77	30	11	760	330	23	3,100	39
PFHpA	NE	20	--	--	--	--	43	210	40	26	190	35	8.9	7.4	BRL (<6.7)	150	66	BRL (<6.7)	360	12
PFDA	NE	20	--	--	--	--	--	--	15	18	14	17	3.6	10	BRL (<3.9)	BRL (<2.0)	3.9	TBAL	BRL (<3.9)	BRL (<3.9)
TOTAL Σ 6 PFAS	70	20	3,130	9,600	3,700	890	3,468	2,660	1,261	1,057	1,314	1,064	270	240	51	1,550	890	41	4,770	182

- Notes:
- Prior to June 11, 2018, the USEPA established the EPA Health Advisory for two PFAS chemicals, PFOA and PFOS, which was 70 ng/L. Subsequently, MassDEP's Office of Research and Standards (ORS) expanded on this Health Advisory and created the ORS Guideline that applies to the total summed of five PFAS chemicals, PFOS, PFOA, PFNA, PFHxS, and PFHpA, effective June 11, 2018.
 - The USEPA and MassDEP ORS Guideline applies to five PFAS chemicals of concern (PFOS, PFOA, PFNA, PFHpA, and PFHxS) individually as well as the sum of the five PFAS of concern.
 - The complete PFAS concentration data set collected from PRW-4 is detailed in the data table titled "Summary of Groundwater Pump and Treatment System PFOS/PFOA Analytical Data. Data presented herein is summarized and data was selected based on quarterly sampling events.
 - (-) Concentrations of the three additional PFAS chemicals, PFNA, PFHxS, and PFHpA were not presented until after the MassDEP ORS Guideline was in effect on 06.11.18. PFAS concentrations were regulated by the USEPA Health Advisory prior to 6.11.18. Concentrations of PFDA were not presented prior to April 19, 2019. MassDEP released drafted Method 1 groundwater risk standards for PFAS on April 19, 2019 that applies to the total sum and individual concentrations of six PFAS compounds (PFOS, PFOA, PFNA, PFHxS, PFHpA, and PFDA), which is 20 ng/L. These drafted groundwater standards were finalized and became effective on December 27, 2019.
 - BRL - Below Laboratory Detection Limits
 - Concentrations presented in ng/L - nanograms per Liter - parts per trillion
 - Concentrations in bold exceed applicable Health Advisory Limit or Method 1 GW-1 Standard
 - PFOS - Perfluorooctanesulfonate
 - PFOA - Perfluorooctanoic Acid
 - PFNA - Perfluorononanoic Acid
 - PFHxS - Perfluorohexanesulfonic Acid
 - PFHpA - Perfluoroheptanoic Acid
 - PFDA - Perfluorodecanoic Acid
 - NA - Concentration data not available
 - Monitoring well HS-1, HS-2, HS-2S, and HS-6 were destroyed or removed during soil removal activities in January 2017 as part of an Immediate Response Action Plan. The well was replaced with HSW-1/HS-1a as post-exacavation activities.
 - Monitoring well HW-1D is a downgradient well located on the north side of Mary Dunn Pond.
 - NE - Not Established

Table 4A - Summary of Long Term Monitoring Groundwater PFAS Analytical

Former Barnstable Country Fire and Rescue Training Academy

155 S. Flint Rock Road, Barnstable, MA

RTN 4-26179

SAMPLE ID	USEPA ^{1,2} HEALTH ADVISORY	Method 1 GW-1 Standards ⁴	FS-1SA		PFW-6					MW-3S			MW-201	MW-215
SCREEN DEPTH (FEET)														
WELL DIAMETER (INCHES)					2									
WELL STATUS			Viable		Destroyed					Viable			Not Surveyed	Destroyed
SAMPLING DATE			6/16/2016	5/19/2021	4/1/2015	3/8/2016	4/18/2016	1/9/2019	10/10/2020	6/3/2014	8/18/2016	11/3/2021	5/19/2021	5/19/2021
UNITS	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L
PFAS (Method 537.2)														
PFOA	70	20	1,700	12	3,400	2,400	850	1,500	810	4,900	1,900	1,400	230	1,100
PFNA	70	20	550	BRL (5.0)	350	470	19	400	70	530	690	360	14	310
PFNA	NE	20	--	BRL (<5.1)	--	--	--	140	63	--	--	36	19	31
PFHxS	NE	20	--	BRL (<4.4)	--	--	--	1,100	150	--	--	1,800	84	620
PFHpA	NE	20	--	BRL (<6.7)	--	--	--	220	170	--	--	210	24	110
PFDA	NE	20	--	BRL (<3.9)	--	--	--	--	3.9	--	--	<3.9	BRL (<3.9)	11
TOTAL Σ 6 PFAS	70	20	2,250	12	3,750	2,870	869	3,360	1,267	5,430	2,590	3,806	371	2182

Notes:

1. Prior to June 11, 2018, the USEPA established the EPA Health Advisory for two PFAS chemicals, PFOA and PFOS, which was 70 ng/L. Subsequently, MassDEP's Office of Research and Standards (ORS) expanded on this Health Advisory and created the ORS Guideline that applies to the total summed of five PFAS chemicals, PFOS, PFOA, PFNA, PFHxS, and PFHpA, effective June 11, 2018.

2. The USEPA and MassDEP ORS Guideline applies to five PFAS chemicals of concern (PFOS, PFOA, PFNA, PFHpA, and PFHxS) individually as well as the sum of the five PFAS of concern.

3. The complete PFAS concentration data set collected from PRW-4 is detailed in the data table titled "Summary of Groundwater Pump and Treatment System PFOS/PFOA Analytical Data. Data presented herein is summarized and data was selected based on quarterly sampling events.

4. (-) Concentrations of the three additional PFAS chemicals, PFNA, PFHxS, and PFHpA were not presented until after the MassDEP ORS Guideline was in effect on 06.11.18. PFAS concentrations were regulated by the USEPA Health Advisory prior to 6.11.18. Concentrations of PFDA were not presented prior to April 19, 2019. MassDEP released drafted Method 1 groundwater risk standards for PFAS on April 19, 2019 that applies to the total sum and individual concentrations of six PFAS compounds (PFOS, PFOA, PFNA, PFHxS, PFHpA, and PFDA), which is 20 ng/L. These drafted groundwater standards were finalized and became effective on December 27, 2019.

5. BRL - Below Laboratory Detection Limits

6. Concentrations presented in ng/L - nanograms per Liter - parts per trillion

7. Concentrations in bold exceed applicable Health Advisory Limit or Method 1 GW-1 Standard

8. PFOS - Perfluorooctanesulfonate

9. PFOA - Perfluorooctanoic Acid

10. PFNA - Perfluorononanoic Acid

11. PFHxS - Perfluorohexanesulfonic Acid

12. PFHpA - Perfluoroheptanoic Acid

13. PFDA - Perfluorodecanoic Acid

14. NA - Concentration data not available

15. Monitoring well HS-1, HS-2, HS-2S, and HS-6 were destroyed or removed during soil removal activities in January 2017 as part of an Immediate Response Action Plan. The well was replaced with HSW-1/HS-1a as post-exacavation activities.

16. Monitoring well HW-1D is a downgradient well located on the north side of Mary Dunn Pond.

17. NE - Not Established

Table 4A - Summary of Long Term Monitoring Groundwater PFAS Analytical
Former Barnstable Country Fire and Rescue Training Academy
155 S. Flint Rock Road, Barnstable, MA
RTN 4-26179

SAMPLE ID	USEPA ^{1,2} HEALTH ADVISORY	Method 1 GW-1 Standards ⁴	MW-12I	MW-12S														
SCREEN DEPTH (FEET)																		
WELL DIAMETER (INCHES)																		
WELL STATUS			Viable	Viable														
SAMPLING DATE			4/24/2017	8/20/2014	4/1/2015	6/26/2018	1/11/2019	4/23/2019	7/23/2019	10/29/2019	2/19/2020	5/12/2020	7/29/2020	10/21/2020	1/27/2021	5/20/2021	11/2/2021	1/25/2022
UNITS	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	
PFAS (Method 537.2)																		
PFOS	70	20	490	2,500	4,800	3,000	2,700	2,800	2,800	2,300	3,100	3,500	2,900	3,900	2,300	360	1,400	950
PFOA	70	20	36	400	470	280	650	920	250	380	580	280	220	280	230	46	150	100
PFNA	NE	20	--	--	--	56	64	92	87	80	78	86	51	51	28	6	27	27
PFHxS	NE	20	--	--	--	1,200	1,500	1,700	880	1,300	1,200	1,100	900	93	630	170	670	390
PFHpA	NE	20	--	--	--	130	490	440	170	310	390	140	120	110	74	14	73	63
PFDA	NE	20	--	--	--	--	--	16	11	10	7.5	23	18	13	21	BRL (<3.9)	BRL (<3.9)	4.7
TOTAL Σ 6 PFAS	70	20	526	2,900	5,270	4,666	5,404	5,968	4,198	4,380	5,356	5,129	4,209	4,447	3,283	596	2,320	1,535

Notes:

1. Prior to June 11, 2018, the USEPA established the EPA Health Advisory for two PFAS chemicals, PFOA and PFOS, which was 70 ng/L. Subsequently, MassDEP's Office of Research and Standards (ORS) expanded on this Health Advisory and created the ORS Guideline that applies to the total summed of five PFAS chemicals, PFOS, PFOA, PFNA, PFHxS, and PFHpA, effective June 11, 2018.

2. The USEPA and MassDEP ORS Guideline applies to five PFAS chemicals of concern (PFOS, PFOA, PFNA, PFHpA, and PFHxS) individually as well as the sum of the five PFAS of concern.

3. The complete PFAS concentration data set collected from PRW-4 is detailed in the data table titled "Summary of Groundwater Pump and Treatment System PFOS/PFOA Analytical Data." Data presented herein is summarized and data was selected based on quarterly sampling events.

4. (--) Concentrations of the three additional PFAS chemicals, PFNA, PFHxS, and PFHpA were not presented until after the MassDEP ORS Guideline was in effect on 06.11.18. PFAS concentrations were regulated by the USEPA Health Advisory prior to 6.11.18. Concentrations of PFDA were not presented prior to April 19, 2019. MassDEP released drafted Method 1 groundwater risk standards for PFAS on April 19, 2019 that applies to the total sum and individual concentrations of six PFAS compounds (PFOS, PFOA, PFNA, PFHxS, PFHpA, and PFDA), which is 20 ng/L. These drafted groundwater standards were finalized and became effective on December 27, 2019.

5. BRL - Below Laboratory Detection Limits

6. Concentrations presented in ng/L - nanograms per Liter - parts per trillion

7. Concentrations in bold exceed applicable Health Advisory Limit or Method 1 GW-1 Standard

8. PFOS - Perfluorooctanesulfonate

9. PFOA - Perfluorooctanoic Acid

10. PFNA - Perfluorononanoic Acid

11. PFHxS - Perfluorohexanesulfonic Acid

12. PFHpA - Perfluoroheptanoic Acid

13. PFDA - Perfluorodecanoic Acid

14. NA - Concentration data not available

15. Monitoring well HS-1, HS-2, HS-2S, and HS-6 were destroyed or removed during soil removal activities in January 2017 as part of an Immediate Response Action Plan. The well was replaced with HSW-1/HS-1a as post-exacavation activities.

16. Monitoring well HW-1D is a downgradient well located on the north side of Mary Dunn Pond.

17. NE - Not Established

Table 4A - Summary of Long Term Monitoring Groundwater PFAS Analytical
Former Barnstable Country Fire and Rescue Training Academy
155 S. Flint Rock Road, Barnstable, MA
RTN 4-26179

SAMPLE ID	USEPA ^{1,2} HEALTH ADVISORY	Method 1 GW-1 Standards ⁴	MW-22															MW-23
SCREEN DEPTH (FEET)																		
WELL DIAMETER (INCHES)																		
WELL STATUS			Viable															Viable
SAMPLING DATE			6/3/2014	4/1/2015	6/26/2018	1/11/2019	4/23/2019	7/23/2019	10/29/2019	2/19/2020	5/12/2020	7/29/2020	10/21/20020	1/27/2021	5/20/2021	11/2/2021	1/25/2022	7/29/2021
UNITS	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L
PFAS (Method 537.2)																		
PFOA	70	20	4,900	600	320	350	320	410	510	460	380	790	680	470	2,300	340	430	1,100
PFOA	70	20	530	90	30	140	160	190	150	230	120	92	160	250	150	83	94	76
PFNA	NE	20	--	--	9	BRL (<8.7)	81	7.6	8.3	5	10	14	14	7	24	<5.1	5.7	BRL (<20)
PFHxS	NE	20	--	--	130	680	600	520	690	540	330	360	740	800	570	220	280	260
PFHpA	NE	20	--	--	13	69	49	33	61	38	32	27	100	88	65	13	21	98
PFDA	NE	20	--	--	--	--	BRL (<4.1)	BRL (<4.1)	BRL (<4.1)	BRL (<4.1)	1	5	5	1	15	<3.9	<3.9	BRL (<20)
TOTAL Σ 6 PFAS	70	20	5,430	690	502	1,239	1,210	1,161	1,419	1,273	873	1,288	1,699	1,616	3,124	656	831	1,534

Notes:

1. Prior to June 11, 2018, the USEPA established the EPA Health Advisory for two PFAS chemicals, PFOA and PFOS, which was 70 ng/L. Subsequently, MassDEP's Office of Research and Standards (ORS) expanded on this Health Advisory and created the ORS Guideline that applies to the total summed of five PFAS chemicals, PFOS, PFOA, PFNA, PFHxS, and PFHpA, effective June 11, 2018.

2. The USEPA and MassDEP ORS Guideline applies to five PFAS chemicals of concern (PFOS, PFOA, PFNA, PFHpA, and PFHxS) individually as well as the sum of the five PFAS of concern.

3. The complete PFAS concentration data set collected from PRW-4 is detailed in the data table titled "Summary of Groundwater Pump and Treatment System PFOS/PFOA Analytical Data." Data presented herein is summarized and data was selected based on quarterly sampling events.

4. (--) Concentrations of the three additional PFAS chemicals, PFNA, PFHxS, and PFHpA were not presented until after the MassDEP ORS Guideline was in effect on 06.11.18. PFAS concentrations were regulated by the USEPA Health Advisory prior to 6.11.18. Concentrations of PFDA were not presented prior to April 19, 2019. MassDEP released drafted Method 1 groundwater risk standards for PFAS on April 19, 2019 that applies to the total sum and individual concentrations of six PFAS compounds (PFOS, PFOA, PFNA, PFHxS, PFHpA, and PFDA), which is 20 ng/L. These drafted groundwater standards were finalized and became effective on December 27, 2019.

5. BRL - Below Laboratory Detection Limits

6. Concentrations presented in ng/L - nanograms per Liter - parts per trillion

7. Concentrations in bold exceed applicable Health Advisory Limit or Method 1 GW-1 Standard

8. PFOS - Perfluorooctanesulfonate

9. PFOA - Perfluorooctanoic Acid

10. PFNA - Perfluorononanoic Acid

11. PFHxS - Perfluorohexanesulfonic Acid

12. PFHpA - Perfluoroheptanoic Acid

13. PFDA - Perfluorodecanoic Acid

14. NA - Concentration data not available

15. Monitoring well HS-1, HS-2, HS-2S, and HS-6 were destroyed or removed during soil removal activities in January 2017 as part of an Immediate Response Action Plan. The well was replaced with HSW-1/HS-1a as post-exacavation activities.

16. Monitoring well HW-1D is a downgradient well located on the north side of Mary Dunn Pond.

17. NE - Not Established

Table 4A - Summary of Long Term Monitoring Groundwater PFAS Analytical

Former Barnstable Country Fire and Rescue Training Academy
155 S. Flint Rock Road, Barnstable, MA
RTN 4-26179

SAMPLE ID	USEPA ^{1,2} HEALTH ADVISORY	Method 1 GW-1 Standards ⁴	MW-35i					
SCREEN DEPTH (FEET)								
WELL DIAMETER (INCHES)								
WELL STATUS			Viable					
SAMPLING DATE			8/20/2014	5/3/2017	1/10/2019	10/30/2019	10/22/2020	11/2/2021
UNITS	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L
PFAS (Method 537.2)								
PFO	70	20	60	42	BRL (<6)	BRL (<5.2)	BRL (<5.9)	<5.7
PFOA	70	20	BRL	14	BRL (<3.3)	BRL (<7.4)	BRL (<5.0)	<5.0
PFNA	NE	20	--	--	BRL (<8.7)	BRL (<4.9)	BRL (<5.1)	<5.1
PFHxS	NE	20	--	--	BRL (<5.6)	6	6	10.0
PFHpA	NE	20	--	--	BRL (<7.4)	BRL (<7.1)	BRL (<6.7)	<6.7
PFDA	NE	20	--	--	--	BRL (<4.1)	BRL (<3.9)	<3.9
TOTAL Σ 6 PFAS	70	20	60	56	BRL	6	6	10

- Notes:
1. Prior to June 11, 2018, the USEPA established the EPA Health Advisory for two PFAS chemicals, PFOA and PFOS, which was 70 ng/L. Subsequently, MassDEP's Office of Research and Standards (ORS) expanded on this Health Advisory and created the ORS Guideline that applies to the total summed of five PFAS chemicals, PFOS, PFOA, PFNA, PFHxS, and PFHpA, effective June 11, 2018.
 2. The USEPA and MassDEP ORS Guideline applies to five PFAS chemicals of concern (PFOS, PFOA, PFNA, PFHpA, and PFHxS) individually as well as the sum of the five PFAS of concern.
 3. The complete PFAS concentration data set collected from PRW-4 is detailed in the data table titled "Summary of Groundwater Pump and Treatment System PFOS/PFOA Analytical Data." Data presented herein is summarized and data was selected based on quarterly sampling events.
 4. (--) Concentrations of the three additional PFAS chemicals, PFNA, PFHxS, and PFHpA were not presented until after the MassDEP ORS Guideline was in effect on 06.11.18. PFAS concentrations were regulated by the USEPA Health Advisory prior to 6.11.18. Concentrations of PFDA were not presented prior to April 19, 2019. MassDEP released drafted Method 1 groundwater risk standards for PFAS on April 19, 2019 that applies to the total sum and individual concentrations of six PFAS compounds (PFOS, PFOA, PFNA, PFHxS, PFHpA, and PFDA), which is 20 ng/L. These drafted groundwater standards were finalized and became effective on December 27, 2019.
 5. BRL - Below Laboratory Detection Limits
 6. Concentrations presented in ng/L - nanograms per Liter - parts per trillion
 7. Concentrations in bold exceed applicable Health Advisory Limit or Method 1 GW-1 Standard
 8. PFOS - Perfluorooctanesulfonate
 9. PFOA - Perfluorooctanoic Acid
 10. PFNA - Perfluorononanoic Acid
 11. PFHxS - Perfluorohexanesulfonic Acid
 12. PFHpA - Perfluoroheptanoic Acid
 13. PFDA - Perfluorodecanoic Acid
 14. NA - Concentration data not available
 15. Monitoring well HS-1, HS-2, HS-2S, and HS-6 were destroyed or removed during soil removal activities in January 2017 as part of an Immediate Response Action Plan. The well was replaced with HSW-1/HS-1a as post-exacavation activities.
 16. Monitoring well HW-1D is a downgradient well located on the north side of Mary Dunn Pond.
 17. NE- Not Established

Table 4A - Summary of Long Term Monitoring Groundwater PFAS Analytical
Former Barnstable Country Fire and Rescue Training Academy
155 S. Flint Rock Road, Barnstable, MA
RTN 4-26179

SAMPLE ID	USEPA ^{1,2} HEALTH ADVISORY	Method 1 GW-1 Standards ⁴	PC-1																	
SCREEN DEPTH (FEET)																				
WELL DIAMETER (INCHES)			2																	
WELL STATUS			Viable																	
SAMPLING DATE			6/17/2015	10/7/2015	3/30/2016	4/24/2017	2/6/2018	6/26/2018	1/11/2019	4/24/2019	7/23/2019	10/29/2019	2/19/2020	5/12/2020	7/28/2020	10/22/2020	1/27/2021	5/20/2021	11/1/2021	1/26/2022
UNITS	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L
PFAS (Method 537.2)																				
PFOA	70	20	48,000	2,000	56,000	5,700	9,000	10,000	1,700	8,000	4,300	1,600	1,700	1,700	1,900	1,200	1,500	1,500	440	630
PFNA	70	20	1,100	BRL (<800)	1,200	--	370	190	140	300	150	72	180	110	63	110	59	49	48	66
PFNA	NE	20	--	--	--	--	--	140	62	150	140	75	70	110	58	100	52	72	33	31
PFHxS	NE	20	--	--	--	--	--	850	380	650	430	380	450	400	240	350	190	230	170	180
PFHpA	NE	20	--	--	--	--	--	200	200	180	230	150	240	150	98	190	76	83	100	95
PFDA	NE	20								78	67	19	20	28	36	27	26	15	<3.9	7.5
TOTAL Σ 6 PFAS	70	20	49,100	2,000	57,200	5,700	9,370	11,380	2,482	9,358	5,317	2,296	2,660	2,498	2,395	1,977	1,903	1,949	791	1,010

Notes:

1. Prior to June 11, 2018, the USEPA established the EPA Health Advisory for two PFAS, PFOA and PFNA, effective June 11, 2018.

2. The USEPA and MassDEP ORS Guideline applies to five PFAS chemicals of concern: PFOA, PFNA, PFHxS, PFHpA, and PFDA.

3. The complete PFAS concentration data set collected from PRW-4 is detailed in the full data report.

4. (--) Concentrations of the three additional PFAS chemicals, PFNA, PFHxS, and PFHpA, are below the detection limit of the method used for analysis. Method 1 groundwater risk standards for PFAS on April 19, 2019 that applies to these chemicals are: PFOA: 70 ng/L, PFNA: 70 ng/L, PFHxS: 70 ng/L, PFHpA: 70 ng/L, and PFDA: 70 ng/L.

5. BRL - Below Laboratory Detection Limits

6. Concentrations presented in ng/L - nanograms per Liter - parts per trillion

7. Concentrations in bold exceed applicable Health Advisory Limit or Method 1 Standard

8. PFOA - Perfluorooctanesulfonic Acid

9. PFNA - Perfluorononanoic Acid

10. PFHxS - Perfluorohexanesulfonic Acid

11. PFHpA - Perfluoroheptanoic Acid

12. PFDA - Perfluorodecanoic Acid

13. NA - Concentration data not available

14. Monitoring well HS-1, HS-2, HS-2S, and HS-6 were destroyed or removed

15. Monitoring well HW-1D is a downgradient well located on the north side of the site

16. NE - Not Established

Table 4A - Summary of Long Term Monitoring Groundwater PFAS Analytical
Former Barnstable Country Fire and Rescue Training Academy
155 S. Flint Rock Road, Barnstable, MA
RTN 4-26179

SAMPLE ID	USEPA ^{1,2} HEALTH ADVISORY	Method 1 GW-1 Standards ⁴	PC-6A															
SCREEN DEPTH (FEET)																		
WELL DIAMETER (INCHES)			2															
WELL STATUS			Viable															
SAMPLING DATE			3/9/2016	4/27/2017	6/26/2018	1/10/2019	4/24/2019	7/23/2019	10/29/2019	2/19/2020	5/12/2020	7/29/2020	10/21/2020	1/27/2021	5/20/2021	7/28/2021	11/1/2021	1/26/2022
UNITS	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L
PFAS (Method 537.2)																		
PFOA	70	20	1,300	3,200	1,300	1,800	1,900	940	1,100	1,600	86	1,300	920	1,100	920	500	550	760
PFOA	70	20	110	150	60	30	68	33	62	67	4.1	37	28	35	31	14	22	29
PFNA	NE	20	--	--	55	25	60	36	48	65	3.8	44	44	58	45	23	32	41
PFHxS	NE	20	--	--	300	190	310	150	290	180	23	99	71	83	72	49	59	62
PFHpA	NE	20	--	--	75	37	83	45	86	71	9	43	37	43	42	24	32	39
PFDA	NE	20					10	BRL (<4.1)	7.4	5.9	0.7	11	12	12	11	3.9	10	10
TOTAL Σ 6 PFAS	70	20	1,410	3,350	1,790	2,082	2,431	1,204	1,593	1,989	127	1,534	1,112	1,331	1,121	614	705	941

Notes:

1. Prior to June 11, 2018, the USEPA established the EPA Health Advisory for two PFAS chemicals, PFOA and PFOS, which was 70 ng/L. Subsequently, MassDEP's Office of Research and Standards (ORS) expanded on this Health Advisory and created the ORS Guideline that applies to the total summed of five PFAS chemicals, PFOS, PFOA, PFNA, PFHxS, and PFHpA, effective June 11, 2018.

2. The USEPA and MassDEP ORS Guideline applies to five PFAS chemicals of concern (PFOS, PFOA, PFNA, PFHpA, and PFHxS) individually as well as the sum of the five PFAS of concern.

3. The complete PFAS concentration data set collected from PRW-4 is detailed in the data table titled "Summary of Groundwater Pump and Treatment System PFOS/PFOA Analytical Data. Data presented herein is summarized and data was selected based on quarterly sampling events.

4. (-) Concentrations of the three additional PFAS chemicals, PFNA, PFHxS, and PFHpA were not presented until after the MassDEP ORS Guideline was in effect on 06.11.18. PFAS concentrations were regulated by the USEPA Health Advisory prior to 6.11.18. Concentrations of PFDA were not presented prior to April 19, 2019. MassDEP released drafted Method 1 groundwater risk standards for PFAS on April 19, 2019 that applies to the total sum and individual concentrations of six PFAS compounds (PFOS, PFOA, PFNA, PFHxS, PFHpA, and PFDA), which is 20 ng/L. These drafted groundwater standards were finalized and became effective on December 27, 2019.

5. BRL - Below Laboratory Detection Limits

6. Concentrations presented in ng/L - nanograms per Liter - parts per trillion

7. Concentrations in bold exceed applicable Health Advisory Limit or Method 1 GW-1 Standard

8. PFOS - Perfluorooctanesulfonate

9. PFOA - Perfluorooctanoic Acid

10. PFNA - Perfluorononanoic Acid

11. PFHxS - Perfluorohexanesulfonic Acid

12. PFHpA - Perfluoroheptanoic Acid

13. PFDA - Perfluorodecanoic Acid

14. NA - Concentration data not available

15. Monitoring well HS-1, HS-2, HS-2S, and HS-6 were destroyed or removed during soil removal activities in January 2017 as part of an Immediate Response Action Plan. The well was replaced with HSW-1/HS-1a as post-exacavation activities.

16. Monitoring well HW-1D is a downgradient well located on the north side of Mary Dunn Pond.

17. NE - Not Established

Table 4A - Summary of Long Term Monitoring Groundwater PFAS Analytical

Former Barnstable Country Fire and Rescue Training Academy

155 S. Flint Rock Road, Barnstable, MA

RTN 4-26179

SAMPLE ID	USEPA ^{1,2} HEALTH ADVISORY	Method 1 GW-1 Standards ⁴	PC-11																	
SCREEN DEPTH (FEET)																				
WELL DIAMETER (INCHES)																				
WELL STATUS			Viable																	
SAMPLING DATE			4/2/2015	5/12/2016	4/24/2017	2/6/2018	6/26/2018	1/10/2019	4/24/2019	7/23/2019	10/29/2019	2/19/2020	5/12/2020	7/29/2020	10/21/2020	1/27/2021	5/19/2021	7/28/2021	11/1/2021	1/26/2022
UNITS	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L
PFAS (Method 537.2)																				
PFOS	70	20	4,400	32,000	3,600	4,000	9,600	14,000	200,000	68,000	22,000	18,000	12,000	9,500	7,200	2,700	2,100	2,400	2,900	1,900
PFOA	70	20	550	430	250	180	250	410	640	BRL (<240)	150	290	140	130	150	78	59	74	58	40
PFNA	NE	20	--	--	--	--	230	190	1,700	540	320	140	130	110	100	74	69	61	78	63
PFHxS	NE	20	--	--	--	--	1,500	1,500	2,400	1,200	800	1,300	720	610	640	250	170	320	270	160
PFHpA	NE	20	--	--	--	--	200	310	210	BRL (<210)	160	210	140	130	160	92	65	75	88	60
PFDA	NE	20	--	--	--	--	--	--	450	BRL (<260)	73	69	56	55	52	69	32	31	21	18
TOTAL Σ 6 PFAS	70	20	4950	32430	3850	4180	11,780	16,410	205,400	69,740	23,503	20,009	13,186	10,535	8,302	3,263	2,495	2,961	3,415	2,241

Notes:

1. Prior to June 11, 2018, the USEPA established the EPA Health Advisory for two PFAS chemicals, PFOA and PFOS, which was 70 ng/L. Subsequently, MassDEP's Office of Research and Standards (ORS) expanded on this Health Advisory and created the ORS Guideline that applies to the total summed of five PFAS chemicals, PFOS, PFOA, PFNA, PFHxS, and PFHpA, effective June 11, 2018.
2. The USEPA and MassDEP ORS Guideline applies to five PFAS chemicals of concern (PFOS, PFOA, PFNA, PFHpA, and PFHxS) individually as well as the sum of the five PFAS of concern.
3. The complete PFAS concentration data set collected from PRW-4 is detailed in the data table titled "Summary of Groundwater Pump and Treatment System PFOS/PFOA Analytical Data. Data presented herein is summarized and data was selected based on quarterly sampling events.
4. (--) Concentrations of the three additional PFAS chemicals, PFNA, PFHxS, and PFHpA were not presented until after the MassDEP ORS Guideline was in effect on 06.11.18. PFAS concentrations were regulated by the USEPA Health Advisory prior to 6.11.18. Concentrations of PFDA were not presented prior to April 19, 2019. MassDEP released drafted Method 1 groundwater risk standards for PFAS on April 19, 2019 that applies to the total sum and individual concentrations of six PFAS compounds (PFOS, PFOA, PFNA, PFHxS, PFHpA, and PFDA), which is 20 ng/L. These drafted groundwater standards were finalized and became effective on December 27, 2019.

5. BRL - Below Laboratory Detection Limits

6. Concentrations presented in ng/L - nanograms per Liter - parts per trillion

7. Concentrations in bold exceed applicable Health Advisory Limit or Method 1 GW-1 Standard

8. PFOS - Perfluorooctanesulfonate

9. PFOA - Perfluorooctanoic Acid

10. PFNA - Perfluorononanoic Acid

11. PFHxS - Perfluorohexanesulfonic Acid

12. PFHpA - Perfluoroheptanoic Acid

13. PFDA - Perfluorodecanoic Acid

14. NA - Concentration data not available

15. Monitoring well HS-1, HS-2, HS-2S, and HS-6 were destroyed or removed during soil removal activities in January 2017 as part of an Immediate Response Action Plan. The well was replaced with HSW-1/HS-1a as post-exacavation activities.

16. Monitoring well HW-1D is a downgradient well located on the north side of Mary Dunn Pond.

17. NE- Not Established

Table 4A - Summary of Long Term Monitoring Groundwater PFAS Analytical
Former Barnstable Country Fire and Rescue Training Academy
155 S. Flint Rock Road, Barnstable, MA
RTN 4-26179

SAMPLE ID	USEPA ^{1,2} HEALTH ADVISORY	Method 1 GW-1 Standards ⁴	PC-14				PC-16d																
SCREEN DEPTH (FEET)																							
WELL DIAMETER(INCHES)																							
WELL STATUS			Viable				Viable																
SAMPLING DATE			8/20/2014	3/30/2016	4/28/2017	11/2/2021	4/2/2015	10/7/2015	2/6/2018	6/26/2018	1/10/2019	4/24/2019	7/23/2019	10/29/2019	2/19/2020	5/12/2020	7/28/2020	10/21/2020	1/27/2021	5/20/2021	7/28/2021	11/1/2021	1/26/2022
UNITS	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	
PFAS (Method 537.2)																							
PFOS	70	20	550	2,100	1,600	700	700	560	980	1,900	1,600	2,000	1,400	1,300	1,600	1,200	930	1,900	690	1,200	460	250	300
PFOA	70	20	40	250	160	26	70	84	64	150	9.3	140	33	75	130	57	99	99	46	70	18	8.9	18
PFNA	NE	20	--	--	--	37	--	--	--	100	BRL (<8.7)	110	36	79	110	63	49	62	48	83	23	8.9	26
PFHxS	NE	20	--	--	--	92	--	--	--	670	60	520	270	220	360	170	260	280	110	16	72	49	55
PFHpA	NE	20	--	--	--	43	--	--	--	170	13	140	74	80	92	61	68	63	54	47	15	9	25
PFDA	NE	20	--	--	--	<3.9	--	--	--	--	8.7	BRL (<4.1)	7.2	7.2	8.5	11	11	5	9	6	BRL (<3.9)	BRL (<3.9)	
TOTAL Σ 6 PFAS	70	20	590	2,350	1,760	898	770	644	1044	2,990	1,682	2,919	1,813	1,761	2,299	1,560	1,417	2,415	953	1,425	594	326	424

Notes:

1. Prior to June 11, 2018, the USEPA established the EPA Health Advisory for two PFAS chemicals, PFOA and PFOS, which was 70 ng/L. Subsequently, MassDEP's Office of Research and Standards (ORS) expanded on this Health Advisory and created the ORS Guideline that applies to the total summed of five PFAS chemicals, PFOS, PFOA, PFNA, PFHxS, and PFHpA, effective June 11, 2018.

2. The USEPA and MassDEP ORS Guideline applies to five PFAS chemicals of concern (PFOS, PFOA, PFNA, PFHpA, and PFHxS) individually as well as the sum of the five PFAS of concern.

3. The complete PFAS concentration data set collected from PRW-4 is detailed in the data table titled "Summary of Groundwater Pump and Treatment System PFOS/PFOA Analytical Data." Data presented herein is summarized and data was selected based on quarterly sampling events.

4. (--) Concentrations of the three additional PFAS chemicals, PFNA, PFHxS, and PFHpA were not presented until after the MassDEP ORS Guideline was in effect on 06.11.18. PFAS concentrations were regulated by the USEPA Health Advisory prior to 6.11.18. Concentrations of PFDA were not presented prior to April 19, 2019. MassDEP released drafted Method 1 groundwater risk standards for PFAS on April 19, 2019 that applies to the total sum and individual concentrations of six PFAS compounds (PFOS, PFOA, PFNA, PFHxS, PFHpA, and PFDA), which is 20 ng/L. These drafted groundwater standards were finalized and became effective on December 27, 2019.

5. BRL - Below Laboratory Detection Limits

6. Concentrations presented in ng/L - nanograms per Liter - parts per trillion

7. Concentrations in bold exceed applicable Health Advisory Limit or Method 1 GW-1 Standard

8. PFOS - Perfluorooctanesulfonate

9. PFOA - Perfluorooctanoic Acid

10. PFNA - Perfluorononanoic Acid

11. PFHxS - Perfluorohexanesulfonic Acid

12. PFHpA - Perfluoroheptanoic Acid

13. PFDA - Perfluorodecanoic Acid

14. NA - Concentration data not available

15. Monitoring well HS-1, HS-2, HS-2S, and HS-6 were destroyed or removed during soil removal activities in January 2017 as part of an Immediate Response Action Plan. The well was replaced with HSW-1/HS-1a as post-exacavation activities.

16. Monitoring well HW-1D is a downgradient well located on the north side of Mary Dunn Pond.

17. NE - Not Established

Table 4A - Summary of Long Term Monitoring Groundwater PFAS Analytical

Former Barnstable Country Fire and Rescue Training Academy

155 S. Flint Rock Road, Barnstable, MA

RTN 4-26179

SAMPLE ID	USEPA ^{1,2} HEALTH ADVISORY	Method 1 GW-1 Standards ⁴	PC-17			PC-18							
SCREEN DEPTH (FEET)													
WELL DIAMETER (INCHES)													
WELL STATUS			Viable			Viable							
SAMPLING DATE			8/20/2014	10/7/2015	2/6/2018	6/17/2015	10/7/2015	4/27/2017	2/6/2018	1/10/2019	10/29/2019	10/21/2020	11/1/2021
UNITS	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L
PFAS (Method 537.2)													
PFOS	70	20	140	230	140	1,200	900	580	890	1,500	1,500	330	290
PFOA	70	20	BRL	24	17	110	590	--	70	110	75	18	6.3
PFNA	NE	20	--	--	--	--	--	--	--	130	79	20	10
PFHxS	NE	20	--	--	--	--	--	--	--	540	220	57	59
PFHpA	NE	20	--	--	--	--	--	--	--	140	80	21	20
PFDA	NE	20	--	--	--	--	--	--	--	--	7.2	6.8	<0.0039
TOTAL Σ 6 PFAS	70	20	140	254	157	1310	1490	580	960	2420	1,961	453	385

Notes:

1. Prior to June 11, 2018, the USEPA established the EPA Health Advisory for two PFAS chemicals, PFOA and PFOS, which was 70 ng/L. Subsequently, MassDEP's Office of Research and Standards (ORS) expanded on this Health Advisory and created the ORS Guideline that applies to the total summed of five PFAS chemicals, PFOS, PFOA, PFNA, PFHxS, and PFHpA, effective June 11, 2018.
2. The USEPA and MassDEP ORS Guideline applies to five PFAS chemicals of concern (PFOS, PFOA, PFNA, PFHpA, and PFHxS) individually as well as the sum of the five PFAS of concern.
3. The complete PFAS concentration data set collected from PRW-4 is detailed in the data table titled "Summary of Groundwater Pump and Treatment System PFOS/PFOA Analytical Data." Data presented herein is summarized and data was selected based on quarterly sampling events.
4. (--) Concentrations of the three additional PFAS chemicals, PFNA, PFHxS, and PFHpA were not presented until after the MassDEP ORS Guideline was in effect on 06.11.18. PFAS concentrations were regulated by the USEPA Health Advisory prior to 6.11.18. Concentrations of PFDA were not presented prior to April 19, 2019. MassDEP released drafted Method 1 groundwater risk standards for PFAS on April 19, 2019 that applies to the total sum and individual concentrations of six PFAS compounds (PFOS, PFOA, PFNA, PFHxS, PFHpA, and PFDA), which is 20 ng/L. These drafted groundwater standards were finalized and became effective on December 27, 2019.
5. BRL - Below Laboratory Detection Limits
6. Concentrations presented in ng/L - nanograms per Liter - parts per trillion
7. Concentrations in bold exceed applicable Health Advisory Limit or Method 1 GW-1 Standard
8. PFOS - Perfluorooctanesulfonate
9. PFOA - Perfluorooctanoic Acid
10. PFNA - Perfluorononanoic Acid
11. PFHxS - Perfluorohexanesulfonic Acid
12. PFHpA - Perfluoroheptanoic Acid
13. PFDA - Perfluorodecanoic Acid
14. NA - Concentration data not available
15. Monitoring well HS-1, HS-2, HS-2S, and HS-6 were destroyed or removed during soil removal activities in January 2017 as part of an Immediate Response Action Plan. The well was replaced with HSW-1/HS-1a as post-exacavation activities.
16. Monitoring well HW-1D is a downgradient well located on the north side of Mary Dunn Pond.
17. NE- Not Established

Table 4A - Summary of Long Term Monitoring Groundwater PFAS Analytical

Former Barnstable Country Fire and Rescue Training Academy

155 S. Flint Rock Road, Barnstable, MA

RTN 4-26179

SAMPLE ID	USEPA ^{1,2} HEALTH ADVISORY	Method 1 GW-1 Standards ⁴	PC-28														
SCREEN DEPTH (FEET)																	
WELL DIAMETER (INCHES)																	
WELL STATUS			Viable														
SAMPLING DATE			3/9/2016	4/28/2017	1/10/2019	4/24/2019	7/23/2019	10/28/2019	2/19/2020	5/12/2020	7/29/2020	10/21/2020	1/27/2021	5/20/2021	7/28/2021	11/3/2021	1/26/2022
UNITS	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L
PFAS (Method 537.2)																	
PFOA	70	20	400	770	38	18	82	270	270	430	200	1,100	1,200	820	100	730	670
PFOA	70	20	27	61	BRL (<3.3)	BRL (<7.4)	190	12	BRL (<7.4)	18	12	65	48	22	38	16	26
PFNA	NE	20	--	--	BRL (<8.7)	BRL (<4.9)	BRL (<4.9)	9	BRL (<4.9)	15	10	49	61	33	45	23	28
PFHxS	NE	20	--	--	17	15	30	94	72	120	71	230	170	110	120	85	83
PFHpA	NE	20	--	--	20	24	25	33	23	41	30	89	66	45	53	43	51
PFDA	NE	20	--	--	--	BRL (<4.1)	BRL (<4.1)	BRL (<4.1)	BRL (<4.1)	2.2	BRL (<4.1)	8	10	6	9	<3.9	7.5
TOTAL Σ 6 PFAS	70	20	427	831	75	57	327	418	365	626	323	1,541	1,555	1,036	365	897	865.5

Notes:

1. Prior to June 11, 2018, the USEPA established the EPA Health Advisory for two PFAS chemicals, PFOA and PFOS, which was 70 ng/L. Subsequently, MassDEP's Office of Research and Standards (ORS) expanded on this Health Advisory and created the ORS Guideline that applies to the total summed of five PFAS chemicals, PFOS, PFOA, PFNA, PFHxS, and PFHpA, effective June 11, 2018.

2. The USEPA and MassDEP ORS Guideline applies to five PFAS chemicals of concern (PFOS, PFOA, PFNA, PFHpA, and PFHxS) individually as well as the sum of the five PFAS of concern.

3. The complete PFAS concentration data set collected from PRW-4 is detailed in the data table titled "Summary of Groundwater Pump and Treatment System PFOS/PFOA Analytical Data." Data presented herein is summarized and data was selected based on quarterly sampling events.

4. (-) Concentrations of the three additional PFAS chemicals, PFNA, PFHxS, and PFHpA were not presented until after the MassDEP ORS Guideline was in effect on 06.11.18. PFAS concentrations were regulated by the USEPA Health Advisory prior to 6.11.18. Concentrations of PFDA were not presented prior to April 19, 2019. MassDEP released drafted Method 1 groundwater risk standards for PFAS on April 19, 2019 that applies to the total sum and individual concentrations of six PFAS compounds (PFOS, PFOA, PFNA, PFHxS, PFHpA, and PFDA), which is 20 ng/L. These drafted groundwater standards were finalized and became effective on December 27, 2019.

5. BRL - Below Laboratory Detection Limits

6. Concentrations presented in ng/L - nanograms per Liter - parts per trillion

7. Concentrations in bold exceed applicable Health Advisory Limit or Method 1 GW-1 Standard

8. PFOS - Perfluorooctanesulfonate

9. PFOA - Perfluorooctanoic Acid

10. PFNA - Perfluorononanoic Acid

11. PFHxS - Perfluorohexanesulfonic Acid

12. PFHpA - Perfluoroheptanoic Acid

13. PFDA - Perfluorodecanoic Acid

14. NA - Concentration data not available

15. Monitoring well HS-1, HS-2, HS-2S, and HS-6 were destroyed or removed during soil removal activities in January 2017 as part of an Immediate Response Action Plan. The well was replaced with HSW-1/HS-1a as post-exacavation activities.

16. Monitoring well HW-1D is a downgradient well located on the north side of Mary Dunn Pond.

17. NE - Not Established

Table 4A - Summary of Long Term Monitoring Groundwater PFAS Analytical

Former Barnstable Country Fire and Rescue Training Academy
155 S. Flint Rock Road, Barnstable, MA
RTN 4-26179

SAMPLE ID	USEPA ^{1,2} HEALTH ADVISORY	Method 1 GW-1 Standards ⁴	PC-30																
SCREEN DEPTH (FEET)																			
WELL DIAMETER (INCHES)																			
WELL STATUS			Viable																
SAMPLING DATE			3/9/2016	4/27/2017	2/6/2018	6/26/2018	1/10/2019	4/24/2019	7/23/2019	10/29/2019	2/19/2020	5/12/2020	7/29/2020	10/21/2020	1/27/2021	5/20/2021	7/28/2021	11/1/2021	1/26/2022
UNITS	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L
PFAS (Method 537.2)																			
PFOA	70	20	980	2,500	1,900	1,600	2,200	1,200	4,300	960	1,200	880	1,100	850	580	540	450	720	480
PFNA	70	20	88	--	98	99	85	85	79	55	130	45	38	32	48	26	21	30	25
PFNA	NE	20	--	--	--	80	88	100	100	61	74	45	57	40	24	40	BRL (<5.1)	51	34
PFHxS	NE	20	--	--	--	510	390	340	300	220	210	180	120	100	76	64	68	96	72
PFHpA	NE	20	--	--	--	130	110	110	96	71	87	80	48	47	47	40	34	43	35
PFDA	NE	20	--	--	--	--	--	12	BRL (<4.1)	6	5.9	8.2	7.7	6.2	5.3	5.2	4.9	<0.0039	6.4
TOTAL Σ 6 PFAS	70	20	1068	2500	1998	2,419	2,873	1,847	4,875	1,373	1,707	1,238	1,371	1,075	780	715	578	940	652

Notes:

1. Prior to June 11, 2018, the USEPA established the EPA Health Advisory for two PFAS chemicals, PFOA and PFOS, which was 70 ng/L. Subsequently, MassDEP's Office of Research and Standards (ORS) expanded on this Health Advisory and created the ORS Guideline that applies to the total sum of five PFAS chemicals, PFOS, PFOA, PFNA, PFHxS, and PFHpA, effective June 11, 2018.
2. The USEPA and MassDEP ORS Guideline applies to five PFAS chemicals of concern (PFOS, PFOA, PFNA, PFHpA, and PFHxS) individually as well as the sum of the five PFAS of concern.
3. The complete PFAS concentration data set collected from PRW-4 is detailed in the data table titled "Summary of Groundwater Pump and Treatment System PFOS/PFOA Analytical Data." Data presented herein is summarized and data was selected based on quarterly sampling events.
4. (--) Concentrations of the three additional PFAS chemicals, PFNA, PFHxS, and PFHpA were not presented until after the MassDEP ORS Guideline was in effect on 06.11.18. PFAS concentrations were regulated by the USEPA Health Advisory prior to 6.11.18. Concentrations of PFDA were not presented prior to April 19, 2019. MassDEP released drafted Method 1 groundwater risk standards for PFAS on April 19, 2019 that applies to the total sum and individual concentrations of six PFAS compounds (PFOS, PFOA, PFNA, PFHxS, PFHpA, and PFDA), which is 20 ng/L. These drafted groundwater standards were finalized and became effective on December 27, 2019.
5. BRL - Below Laboratory Detection Limits
6. Concentrations presented in ng/L - nanograms per Liter - parts per trillion
7. Concentrations in bold exceed applicable Health Advisory Limit or Method 1 GW-1 Standard
8. PFOS - Perfluorooctanesulfonate
9. PFOA - Perfluorooctanoic Acid
10. PFNA - Perfluorononanoic Acid
11. PFHxS - Perfluorohexanesulfonic Acid
12. PFHpA - Perfluoroheptanoic Acid
13. PFDA - Perfluorodecanoic Acid
14. NA - Concentration data not available
15. Monitoring well HS-1, HS-2, HS-2S, and HS-6 were destroyed or removed during soil removal activities in January 2017 as part of an Immediate Response Action Plan. The well was replaced with HSW-1/HS-1a as post-exacavation activities.
16. Monitoring well HW-1D is a downgradient well located on the north side of Mary Dunn Pond.
17. NE- Not Established

Table 4A - Summary of Long Term Monitoring Groundwater PFAS Analytical

Former Barnstable Country Fire and Rescue Training Academy

155 S. Flint Rock Road, Barnstable, MA

RTN 4-26179

SAMPLE ID	USEPA ^{1,2} HEALTH ADVISORY	Method 1 GW-1 Standards ⁴	PC-34S		PC-36S					PC-38										PC-39		
SCREEN DEPTH (FEET)																						
WELL DIAMETER (INCHES)																						
WELL STATUS			Viable		Viable					Viable										Viable		
SAMPLING DATE			4/14/2016	11/2/2021	4/14/2016	1/11/2019	10/29/2019	10/22/2020	11/3/2021	4/24/2017	10/29/2019	5/12/2020	7/28/2020	10/21/2020	1/27/2021	5/20/2021	7/28/2021	11/1/2021	1/26/2022	4/24/2017	2/19/2020	11/2/2021
UNITS	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	
PFAS (Method 537.2)																						
PFOS	70	20	1,300	1,300	35	64	1,200	700	640	BRL (<2.6)	BRL (<5.2)	4.5	BRL (<5.2)	BRL (<5.7)	3	BRL (<5.7)	BRL (<5.7)	BRL (<5.7)	BRL (<5.7)	1,200	820	140
PFOA	70	20	72	74	BRL (<5.3)	BRL (<3.3)	54	36	32	BRL (<4.6)	BRL (<7.4)	BRL (<0.23)	BRL (<7.4)	BRL (<5.0)	BRL (<2.0)	BRL (<5.0)	BRL (<5.0)	BRL (<5.0)	BRL (<5.0)	46	28	BRL (<5.0)
PFNA	NE	20	--	150	--	BRL (<8.7)	80	57	71	--	BRL (<4.9)	BRL (<0.48)	BRL (<4.9)	BRL (<5.1)	BRL (<2.0)	BRL (<5.1)	BRL (<5.1)	BRL (<5.1)	BRL (<5.1)	--	61	6.9
PFHxS	NE	20	--	160	--	38	120	79	73	--	6	2.2	BRL (<5.2)	BRL (<4.4)	2	BRL (<4.4)	BRL (<4.4)	BRL (<4.4)	BRL (<4.4)	--	100	4.9
PFHpA	NE	20	--	87	--	BRL (<7.4)	62	42	38	--	BRL (<7.1)	BRL (<0.37)	BRL (<7.1)	BRL (<6.7)	BRL (<2.0)	BRL (<6.7)	BRL (<6.7)	BRL (<6.7)	BRL (<6.7)	--	28	BRL (<6.7)
PFDA	NE	20	--	7.8	--	--	11	11	11	--	BRL (<4.1)	BRL (<0.18)	BRL (<4.1)	BRL (<3.9)	BRL (<2.0)	BRL (<3.9)	BRL (<3.9)	BRL (<3.9)	BRL (<3.9)	--	BRL (<4.1)	BRL (<3.9)
TOTAL Σ 6 PFAS	70	20	1372	1,779	35	102	1,527	925	865	0	6.1	6.7	0	BRL	4.3	0.0	0.0	0.0	0.0	1,246	1037	151.8

Notes:

1. Prior to June 11, 2018, the USEPA established the EPA Health Advisory for two PFAS chemicals, PFOA and PFOS, which was 70 ng/L. Subsequently, MassDEP's Office of Research and Standards (ORS) expanded on this Health Advisory and created the ORS Guideline that applies to the total sum of five PFAS chemicals, PFOS, PFOA, PFNA, PFHxS, and PFHpA, effective June 11, 2018.
2. The USEPA and MassDEP ORS Guideline applies to five PFAS chemicals of concern (PFOS, PFOA, PFNA, PFHpA, and PFHxS) individually as well as the sum of the five PFAS of concern.
3. The complete PFAS concentration data set collected from PRW-4 is detailed in the data table titled "Summary of Groundwater Pump and Treatment System PFOS/PFOA Analytical Data." Data presented herein is summarized and data was selected based on quarterly sampling events.
4. (--) Concentrations of the three additional PFAS chemicals, PFNA, PFHxS, and PFHpA were not presented until after the MassDEP ORS Guideline was in effect on 06.11.18. PFAS concentrations were regulated by the USEPA Health Advisory prior to 6.11.18. Concentrations of PFDA were not presented prior to April 19, 2019. MassDEP released drafted Method 1 groundwater risk standards for PFAS on April 19, 2019 that applies to the total sum and individual concentrations of six PFAS compounds (PFOS, PFOA, PFNA, PFHxS, PFHpA, and PFDA), which is 20 ng/L. These drafted groundwater standards were finalized and became effective on December 27, 2019.

5. BRL - Below Laboratory Detection Limits

6. Concentrations presented in ng/L - nanograms per Liter - parts per trillion

7. Concentrations in bold exceed applicable Health Advisory Limit or Method 1 GW-1 Standard

8. PFOS - Perfluorooctanesulfonate

9. PFOA - Perfluorooctanoic Acid

10. PFNA - Perfluorononanoic Acid

11. PFHxS - Perfluorohexanesulfonic Acid

12. PFHpA - Perfluoroheptanoic Acid

13. PFDA - Perfluorodecanoic Acid

14. NA - Concentration data not available

15. Monitoring well HS-1, HS-2, HS-2S, and HS-6 were destroyed or removed during soil removal activities in January 2017 as part of an Immediate Response Action Plan. The well was replaced with HSW-1/HS-1a as post-exacavation activities.

16. Monitoring well HW-1D is a downgradient well located on the north side of Mary Dunn Pond.

17. NE - Not Established

Table 4A - Summary of Long Term Monitoring Groundwater PFAS AnalyticalE

Former Barnstable Country Fire and Rescue Training Academy

155 S. Flint Rock Road, Barnstable, MA

RTN 4-26179

SAMPLE ID	USEPA ^{1,2} HEALTH ADVISORY	Method 1 GW-1 Standards ⁴	HW-1D ¹⁶				
SCREEN DEPTH (FEET)							
WELL DIAMETER (INCHES)							
WELL STATUS							
SAMPLING DATE			5/3/2017	1/10/2019	10/28/2019	10/21/2020	11/3/2021
UNITS	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L
PFAS (Method 537.2)							
PFOS	70	20	25	BRL (<6)	BRL (<5.2)	BRL (<5.7)	BRL (<5.7)
PFOA	70	20	8	BRL (<3.3)	BRL (<7.4)	BRL (<5.0)	BRL (<5.0)
PFNA	NE	20	--	BRL (<8.7)	BRL (<4.9)	BRL (<5.1)	BRL (<5.1)
PFHxS	NE	20	--	BRL (<5.6)	BRL (<5.2)	BRL (<4.4)	BRL (<4.4)
PFHpA		20	--	BRL (<7.4)	BRL (<7.1)	BRL (<6.7)	BRL (<6.7)
PFDA	NE	20	--	--	BRL (<4.1)	BRL (<3.9)	BRL (<3.9)
TOTAL Σ 6 PFAS	70	20	33	BRL	BRL	BRL	BRL

Notes:

1. Prior to June 11, 2018, the USEPA established the EPA Health Advisory for two PFAS chemicals, PFOA and PFOS, which was 70 ng/L. Subsequently, MassDEP's Office of Research and Standards (ORS) expanded on this Health Advisory and created the ORS Guideline that applies to the total summed of five PFAS chemicals, PFOS, PFOA, PFNA, PFHxS, and PFHpA, effective June 11, 2018.

2. The USEPA and MassDEP ORS Guideline applies to five PFAS chemicals of concern (PFOS, PFOA, PFNA, PFHpA, and PFHxS) individually as well as the sum of the five PFAS of concern.

3. The complete PFAS concentration data set collected from PRW-4 is detailed in the data table titled "Summary of Groundwater Pump and Treatment System PFOS/PFOA Analytical Data. Data presented herein is summarized and data was selected based on quarterly sampling events.

4. (--) Concentrations of the three additional PFAS chemicals, PFNA, PFHxS, and PFHpA were not presented until after the MassDEP ORS Guideline was in effect on 06.11.18. PFAS concentrations were regulated by the USEPA Health Advisory prior to 6.11.18. Concentrations of PFDA were not presented prior to April 19, 2019. MassDEP released drafted Method 1 groundwater risk standards for PFAS on April 19, 2019 that applies to the total sum and individual concentrations of six PFAS compounds (PFOS, PFOA, PFNA, PFHxS, PFHpA, and PFDA), which is 20 ng/L. These drafted groundwater standards were finalized and became effective on December 27, 2019.

5. BRL - Below Laboratory Detection Limits

6. Concentrations presented in ng/L - nanograms per Liter - parts per trillion

7. Concentrations in bold exceed applicable Health Advisory Limit or Method 1 GW-1 Standard

8. PFOS - Perfluorooctanesulfonate

9. PFOA - Perfluorooctanoic Acid

10. PFNA - Perfluorononanoic Acid

11. PFHxS - Perfluorohexanesulfonic Acid

12. PFHpA - Perfluoroheptanoic Acid

13. PFDA - Perfluorodecanoic Acid

14. NA - Concentration data not available

15. Monitoring well HS-1, HS-2, HS-2S, and HS-6 were destroyed or removed during soil removal activities in January 2017 as part of an Immediate Response Action Plan. The well was replaced with HSW-1/HS-1a as post-exacavation activities.

16. Monitoring well HW-1D is a downgradient well located on the north side of Mary Dunn Pond.

17. NE - Not Established

Table 4B- Summary of Historic Groundwater PFAS Analytical Data
Former Barnstable Country Fire and Rescue Training Academy
155 S. Flint Rock Road, Barnstable, MA
RTN 4-26179

SAMPLE ID	USEPA ^{1,2} HEALTH ADVISORY	Method 1 GW-1 Standards ⁴	HS-1 ¹⁵		HS-6 ¹⁵	HS-2 ¹⁵	HS-2S ¹⁵		PFW-3			PFW-4	OW-2A	OW-2S	OW-2D	FS-1	RW-1		PC-2		PC-3		PC-4	
SCREEN DEPTH (FEET)																								
WELL DIAMETER (INCHES)									2			2							2		2		2	
WELL STATUS			Abandoned		Abandoned	Abandoned	Abandoned		Viable			Viable	Not Viable	Not Viable	Not Viable	Not Viable	OFF		Viable		Damaged - Not Viable		Destroyed	
SAMPLING DATE			8/11/2016	12/8/2016	8/11/2016	7/27/2017	8/18/2016	5/3/2017	4/1/2015	10/15/2015	4/18/2017	4/1/2015	6/3/2014	4/14/2016	4/14/2016	4/11/2017	4/1/2015	4/11/2017	6/17/2015	4/24/2017	8/20/2014	6/17/2015	6/17/2015	3/8/2016
UNITS	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L
PFAS (Method 537.2)																								
PFO	70	20	56,000	36,000	41,000	21,000	300	150	2,700	3,800	3,400	3,300	1,300	2,400	6	1,700	2,300	1,000	3,800	2,200	3,100	4,700	2,200	4,600
PFOA	70	20	460	1,800	450	370	BRL (<5.3)	8.2	140	170	230	420	150	250	BRL (<5.3)	730	240	58	220	110	180	200	79	160
PFNA	NE	20	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
PFHxS	NE	20	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
PFHpA	NE	20	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
PFDA	NE	20	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--						
TOTAL Σ 6 PFAS	70	20	56,460	37,800	41,450	21,370	300	158	2,840	3,970	3,630	3,720	1,450	2,650	6	2,430	2,540	1,058	4,020	2,310	3,280	4,900	2,279	4,760

Notes:

1. Prior to June 11, 2018, the USEPA established the EPA Health Advisory for two PFAS chemicals, PFOA and PFOS, which was 70 ng/L. Subsequently, MassDEP's Office of Research and Standards (ORS) expanded on this Health Advisory and created the ORS Guideline that applies to the total summed of five PFAS chemicals, PFOS, PFOA, PFNA, PFHxS, and PFHpA, effective June 11, 2018.

2. The USEPA and MassDEP ORS Guideline applies to five PFAS chemicals of concern (PFOS, PFOA, PFNA, PFHpA, and PFHxS) individually as well as the sum of the five PFAS of concern.

3. The complete PFAS concentration data set collected from PRW-4 is detailed in the data table titled "Summary of Groundwater Pump and Treatment System PFOS/PFOA Analytical Data." Data presented herein is summarized and data was selected based on quarterly sampling events.

4. (--) Concentrations of the three additional PFAS chemicals, PFNA, PFHxS, and PFHpA were not presented until after the MassDEP ORS Guideline was in effect on 06.11.18. PFAS concentrations were regulated by the USEPA Health Advisory prior to 6.11.18. Concentrations of PFDA were not presented prior to April 19, 2019. MassDEP released drafted Method 1 groundwater risk standards for PFAS on April 19, 2019 that applies to the total sum and individual concentrations of six PFAS compounds (PFOS, PFOA, PFNA, PFHxS, PFHpA, and PFDA), which is 20 ng/L. These drafted groundwater standards were finalized and became effective on December 27, 2019.

5. BRL - Below Laboratory Detection Limits

6. Concentrations presented in ng/L - nanograms per Liter - parts per trillion

7. Concentrations in bold exceed applicable Health Advisory Limit or Method 1 GW-1 Standard

8. PFOS - Perfluorooctanesulfonate

9. PFOA - Perfluorooctanoic Acid

10. PFNA - Perfluorononanoic Acid

11. PFHxS - Perfluorohexanesulfonic Acid

12. PFHpA - Perfluoroheptanoic Acid

13. PFDA - Perfluorodecanoic Acid

14. NA - Concentration data not available

15. Monitoring well HS-1, HS-2, HS-2S, and HS-6 were destroyed or removed during soil removal activities in January 2017 as part of an Immediate Response Action Plan. The well was replaced with HSW-1/HS-1a as post-exacavation activities.

16. Monitoring well HW-1D is a downgradient well located on the north side of Mary Dunn Pond.

17. NE- Not Established

Table 4B- Summary of Historic Groundwater PFAS Analytical Data
Former Barnstable Country Fire and Rescue Training Academy
155 S. Flint Rock Road, Barnstable, MA
RTN 4-26179

SAMPLE ID	USEPA ^{1,2} HEALTH ADVISORY	Method 1 GW-1 Standards ⁴	PC-7					PC-8					PC-9									PC-10	
SCREEN DEPTH (FEET)																							
WELL DIAMETER (INCHES)			2					2														2	
WELL STATUS			Damaged - Not Viable					Damaged - Not Viable					Damaged - Not Viable									Viable	
SAMPLING DATE			4/2/2015	6/17/2015	10/7/2015	3/8/2016	4/27/2017	6/17/2015	10/7/2015	3/8/2016	4/24/2017	2/6/2018	4/1/2015	10/7/2015	3/9/2016	3/30/2016	4/28/2017	1/10/2019	10/30/2019	10/21/2020	4/6/2015	4/28/2017	
UNITS	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L		
PFAS (Method 537.2)																							
PFOS	70	20	17,000	500	700	1,700	2,900	15,000	500	1,600	36,000	1,000	580	510	5,300	8,100	280	1,700	2,300	1,400	790	560	
PFOA	70	20	3,500	27	98	140	130	2,800	370	97	--	71	30	40	1,200	1,600	31	64	100	66	50	67	
PFNA	NE	20	--	--	--	--	--	--	--	--	--	--	--	--	--	--	53	90	88	--	--		
PFHxS	NE	20	--	--	--	--	--	--	--	--	--	--	--	--	--	--	360	420	200	--	--		
PFHpA	NE	20	--	--	--	--	--	--	--	--	--	--	--	--	--	--	81	120	77	--	--		
PFDA	NE	20							--	--	--	--	--	--	--	--	--	15	11	--	--		
TOTAL Σ 6 PFAS	70	20	20,500	527	798	1,840	3,030	17800	870	1697	36000	1071	610	550	6500	9700	311	2258	3045	1,842	840	627	

Notes:

1. Prior to June 11, 2018, the USEPA established the EPA Health Advisory for two PFAS chemicals, PFOA and PFOS, which was 70 ng/L. Subsequently, MassDEP's Office of Research and Standards (ORS) expanded on this Health Advisory and created the ORS Guideline that applies to the total summed of five PFAS chemicals, PFOS, PFOA, PFNA, PFHxS, and PFHpA, effective June 11, 2018.

2. The USEPA and MassDEP ORS Guideline applies to five PFAS chemicals of concern (PFOS, PFOA, PFNA, PFHpA, and PFHxS) individually as well as the sum of the five PFAS of concern.

3. The complete PFAS concentration data set collected from PRW-4 is detailed in the data table titled "Summary of Groundwater Pump and Treatment System PFOS/PFOA Analytical Data. Data presented herein is summarized and data was selected based on quarterly sampling events.

4. (-) Concentrations of the three additional PFAS chemicals, PFNA, PFHxS, and PFHpA were not presented until after the MassDEP ORS Guideline was in effect on 06.11.18. PFAS concentrations were regulated by the USEPA Health Advisory prior to 6.11.18. Concentrations of PFDA were not presented prior to April 19, 2019. MassDEP released drafted Method 1 groundwater risk standards for PFAS on April 19, 2019 that applies to the total sum and individual concentrations of six PFAS compounds (PFOS, PFOA, PFNA, PFHxS, PFHpA, and PFDA), which is 20 ng/L. These drafted groundwater standards were finalized and became effective on December 27, 2019.

5. BRL - Below Laboratory Detection Limits

6. Concentrations presented in ng/L - nanograms per Liter - parts per trillion

7. Concentrations in bold exceed applicable Health Advisory Limit or Method 1 GW-1 Standard

8. PFOS - Perfluorooctanesulfonate

9. PFOA - Perfluorooctanoic Acid

10. PFNA - Perfluorononanoic Acid

11. PFHxS - Perfluorohexanesulfonic Acid

12. PFHpA - Perfluoroheptanoic Acid

13. PFDA - Perfluorodecanoic Acid

14. NA - Concentration data not available

15. Monitoring well HS-1, HS-2, HS-2S, and HS-6 were destroyed or removed during soil removal activities in January 2017 as part of an Immediate Response Action Plan. The well was replaced with HSW-1/HS-1a as post-exacavation activities.

16. Monitoring well HW-1D is a downgradient well located on the north side of Mary Dunn Pond.

17. NE - Not Established

Table 4B- Summary of Historic Groundwater PFAS Analytical Data
Former Barnstable Country Fire and Rescue Training Academy
155 S. Flint Rock Road, Barnstable, MA
RTN 4-26179

SAMPLE ID	USEPA ^{1,2} HEALTH ADVISORY	Method 1 GW-1 Standards ⁴	PC-12			PC-13		PC-15			PC-19				PC-20D	PC-21D	PC-22		PC-23D	PC-24		PC-25
SCREEN DEPTH (FEET)																						
WELL DIAMETER (INCHES)																						
WELL STATUS			Viable			Viable		Destroyed - Not Viable			Damaged - Not Viable				Not Viable	Viable	Viable		Viable	Viable		Viable
SAMPLING DATE			6/17/2015	5/12/2016	4/26/2017	6/17/2015	4/24/2017	4/2/2015	4/28/2017	10/30/2019	4/2/2015	3/30/2016	4/27/2017	10/30/2019	3/9/2016	3/9/2016	4/2/2015	4/28/2017	6/17/2015	3/30/2016	4/28/2017	6/17/2015
UNITS	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L
PFAS (Method 537.2)																						
PFOS	70	20	1,300	1,700	1,600	2,400	2,800	1,300	780	970	3,300	1,600	2,000	1,900	3,200	230	1,200	1,400	1,000	420	320	2,300
PFOA	70	20	140	150	150	280	170	100	80	55	260	120	290	170	200	19	100	170	73	22	33	260
PFNA	NE	20	--	--	--	--	--	--	--	52	--	--	--	130	--	--	--	--	--	--	--	--
PFHxS	NE	20	--	--	--	--	--	--	--	290	--	--	--	450	--	--	--	--	--	--	--	--
PFHpA	NE	20	--	--	--	--	--	--	--	77	--	--	--	95	--	--	--	--	--	--	--	--
PFDA	NE	20	--	--	--	--	--	--	--	4.9	--	--	--	14	--	--	--	--	--	--	--	--
TOTAL Σ 6 PFAS	70	20	1440	1850	1750	2680	2,970	1,400	860	1,449	3560	1720	2290	2759	3,400	249	1300	1,570	1073	442	353	2,560

Notes:

1. Prior to June 11, 2018, the USEPA established the EPA Health Advisory for two PFAS chemicals, PFOA and PFOS, which was 70 ng/L. Subsequently, MassDEP's Office of Research and Standards (ORS) expanded on this Health Advisory and created the ORS Guideline that applies to the total summed of five PFAS chemicals, PFOS, PFOA, PFNA, PFHxS, and PFHpA, effective June 11, 2018.

2. The USEPA and MassDEP ORS Guideline applies to five PFAS chemicals of concern (PFOS, PFOA, PFNA, PFHpA, and PFHxS) individually as well as the sum of the five PFAS of concern.

3. The complete PFAS concentration data set collected from PRW-4 is detailed in the data table titled "Summary of Groundwater Pump and Treatment System PFOS/PFOA Analytical Data. Data presented herein is summarized and data was selected based on quarterly sampling events.

4. (-) Concentrations of the three additional PFAS chemicals, PFNA, PFHxS, and PFHpA were not presented until after the MassDEP ORS Guideline was in effect on 06.11.18. PFAS concentrations were regulated by the USEPA Health Advisory prior to 6.11.18. Concentrations of PFDA were not presented prior to April 19, 2019. MassDEP released drafted Method 1 groundwater risk standards for PFAS on April 19, 2019 that applies to the total sum and individual concentrations of six PFAS compounds (PFOS, PFOA, PFNA, PFHxS, PFHpA, and PFDA), which is 20 ng/L. These drafted groundwater standards were finalized and became effective on December 27, 2019.

5. BRL - Below Laboratory Detection Limits

6. Concentrations presented in ng/L - nanograms per Liter - parts per trillion

7. Concentrations in bold exceed applicable Health Advisory Limit or Method 1 GW-1 Standard

8. PFOS - Perfluorooctanesulfonate

9. PFOA - Perfluorooctanoic Acid

10. PFNA - Perfluorononanoic Acid

11. PFHxS - Perfluorohexanesulfonic Acid

12. PFHpA - Perfluoroheptanoic Acid

13. PFDA - Perfluorodecanoic Acid

14. NA - Concentration data not available

15. Monitoring well HS-1, HS-2, HS-2S, and HS-6 were destroyed or removed during soil removal activities in January 2017 as part of an Immediate Response Action Plan. The well was replaced with HSW-1/HS-1a as post-exacavation activities.

16. Monitoring well HW-1D is a downgradient well located on the north side of Mary Dunn Pond.

17. NE - Not Established

Table 4B- Summary of Historic Groundwater PFAS Analytical Data
Former Barnstable Country Fire and Rescue Training Academy
155 S. Flint Rock Road, Barnstable, MA
RTN 4-26179

SAMPLE ID	USEPA ^{1,2} HEALTH ADVISORY	Method 1 GW-1 Standards ⁴	PC-26				PC-29	PC-31		PC-32		PC-33		PC-34D		PC-35S	PC-35D		PC-36D		PC-37
SCREEN DEPTH (FEET)																					
WELL DIAMETER (INCHES)																					
WELL STATUS			Viable				Viable	Viable		Viable		Viable		Viable		Viable	Viable		Viable		Viable
SAMPLING DATE			6/17/2015	10/8/2015	3/8/2016	4/24/2017	4/28/2017	3/8/2016	4/27/2017	3/30/2016	4/27/2017	3/30/2016	4/27/2017	4/14/2016	4/28/2017	4/14/2016	4/14/2016	4/28/2017	4/14/2016	4/24/2017	4/10/2017
UNITS	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L
PFAS (Method 537.2)																					
PFOS	70	20	1,000	1,900	1,200	380	1,400	1,200	12,000	1,200	960	2,700	2,100	1,400	1,500	1,700	2,000	1,700	3,100	2,500	45
PFOA	70	20	210	190	98	21	BRL (<4.6)	110	160	130	54	250	210	150	130	130	140	97	150	120	BRL (<20)
PFNA	NE	20	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
PFHxS	NE	20	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
PFHpA	NE	20	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
PFDA	NE	20	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
TOTAL Σ 6 PFAS	70	20	1,210	2,090	1,298	401	1400	1310	12160	1330	1014	2950	2310	1550	1630	1830	2140	1797	3250	2620	45

Notes:

1. Prior to June 11, 2018, the USEPA established the EPA Health Advisory for two PFAS chemicals, PFOA and PFOS, which was 70 ng/L. Subsequently, MassDEP's Office of Research and Standards (ORS) expanded on this Health Advisory and created the ORS Guideline that applies to the total summed of five PFAS chemicals, PFOS, PFOA, PFNA, PFHxS, and PFHpA, effective June 11, 2018.

2. The USEPA and MassDEP ORS Guideline applies to five PFAS chemicals of concern (PFOS, PFOA, PFNA, PFHpA, and PFHxS) individually as well as the sum of the five PFAS of concern.

3. The complete PFAS concentration data set collected from PRW-4 is detailed in the data table titled "Summary of Groundwater Pump and Treatment System PFOS/PFOA Analytical Data. Data presented herein is summarized and data was selected based on quarterly sampling events.

4. (-) Concentrations of the three additional PFAS chemicals, PFNA, PFHxS, and PFHpA were not presented until after the MassDEP ORS Guideline was in effect on 06.11.18. PFAS concentrations were regulated by the USEPA Health Advisory prior to 6.11.18. Concentrations of PFDA were not presented prior to April 19, 2019. MassDEP released drafted Method 1 groundwater risk standards for PFAS on April 19, 2019 that applies to the total sum and individual concentrations of six PFAS compounds (PFOS, PFOA, PFNA, PFHxS, PFHpA, and PFDA), which is 20 ng/L. These drafted groundwater standards were finalized and became effective on December 27, 2019.

5. BRL - Below Laboratory Detection Limits

6. Concentrations presented in ng/L - nanograms per Liter - parts per trillion

7. Concentrations in bold exceed applicable Health Advisory Limit or Method 1 GW-1 Standard

8. PFOS - Perfluorooctanesulfonate

9. PFOA - Perfluorooctanoic Acid

10. PFNA - Perfluorononanoic Acid

11. PFHxS - Perfluorohexanesulfonic Acid

12. PFHpA - Perfluoroheptanoic Acid

13. PFDA - Perfluorodecanoic Acid

14. NA - Concentration data not available

15. Monitoring well HS-1, HS-2, HS-2S, and HS-6 were destroyed or removed during soil removal activities in January 2017 as part of an Immediate Response Action Plan. The well was replaced with HSW-1/HS-1a as post-exacavation activities.

16. Monitoring well HW-1D is a downgradient well located on the north side of Mary Dunn Pond.

17. NE- Not Established

Table 4B- Summary of Historic Groundwater PFAS Analytical Data
Former Barnstable Country Fire and Rescue Training Academy
155 S. Flint Rock Road, Barnstable, MA
RTN 4-26179

SAMPLE ID	USEPA ^{1,2} HEALTH ADVISORY	Method 1 GW-1 Standards ⁴	MW-1			MW-3D	SBV-3	MW-6		MW-7	MW-10		MW-13	MW-15	MW-15D	MW-19I
SCREEN DEPTH (FEET)																
WELL DIAMETER (INCHES)																
WELL STATUS			Viable			Viable	Viable	Viable		Viable	Viable		Viable	Viable	Viable	Not Viable
SAMPLING DATE			11/22/2013	6/3/2014	4/28/2017	8/18/2016	11/22/2013	4/1/2015	4/25/2017	11/22/2013	11/22/2013	4/18/2016	7/29/2021	4/24/2017	4/2/2015	8/20/2014
UNITS	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L
PFAS (Method 537.2)																
PFOS	70	20	3,900	4,400	2,600	98	1,100	5,700	2,400	3,100	2,000	1,700	BRL (<0.020)	19	60	BRL
PFOA	70	20	320	880	290	10	350	510	140	580	670	440	BRL (<0.020)	27	60	BRL
PFNA	NE	20	--	--	--	--	--	--	--	--	--	--	BRL (<0.020)	--	--	--
PFHxS	NE	20	--	--	--	--	--	--	--	--	--	--	BRL (<0.020)	--	--	--
PFHpA	NE	20	--	--	--	--	--	--	--	--	--	--	BRL (<0.020)	--	--	--
PFDA	NE	20	--	--	--	--	--	--	--	--	--	--	BRL (<0.020)	--	--	--
TOTAL Σ 6 PFAS	70	20	4,220	5,280	2,890	108	1,450	6,210	2,540	3,680	2,670	2,140	0	46	120	0

Notes:

1. Prior to June 11, 2018, the USEPA established the EPA Health Advisory for two PFAS chemicals, PFOA and PFOS, which was 70 ng/L. Subsequently, MassDEP's Office of Research and Standards (ORS) expanded on this Health Advisory and created the ORS Guideline that applies to the total summed of five PFAS chemicals, PFOS, PFOA, PFNA, PFHxS, and PFHpA, effective June 11, 2018.

2. The USEPA and MassDEP ORS Guideline applies to five PFAS chemicals of concern (PFOS, PFOA, PFNA, PFHpA, and PFHxS) individually as well as the sum of the five PFAS of concern.

3. The complete PFAS concentration data set collected from PRW-4 is detailed in the data table titled "Summary of Groundwater Pump and Treatment System PFOS/PFOA Analytical Data. Data presented herein is summarized and data was selected based on quarterly sampling events.

4. (-) Concentrations of the three additional PFAS chemicals, PFNA, PFHxS, and PFHpA were not presented until after the MassDEP ORS Guideline was in effect on 06.11.18. PFAS concentrations were regulated by the USEPA Health Advisory prior to 6.11.18. Concentrations of PFDA were not presented prior to April 19, 2019. MassDEP released drafted Method 1 groundwater risk standards for PFAS on April 19, 2019 that applies to the total sum and individual concentrations of six PFAS compounds (PFOS, PFOA, PFNA, PFHxS, PFHpA, and PFDA), which is 20 ng/L. These drafted groundwater standards were finalized and became effective on December 27, 2019.

5. BRL - Below Laboratory Detection Limits

6. Concentrations presented in ng/L - nanograms per Liter - parts per trillion

7. Concentrations in bold exceed applicable Health Advisory Limit or Method 1 GW-1 Standard

8. PFOS - Perfluorooctanesulfonate

9. PFOA - Perfluorooctanoic Acid

10. PFNA - Perfluorononanoic Acid

11. PFHxS - Perfluorohexanesulfonic Acid

12. PFHpA - Perfluoroheptanoic Acid

13. PFDA - Perfluorodecanoic Acid

14. NA - Concentration data not available

15. Monitoring well HS-1, HS-2, HS-2S, and HS-6 were destroyed or removed during soil removal activities in January 2017 as part of an Immediate Response Action Plan. The well was replaced with HSW-1/HS-1a as post-exacavation activities.

16. Monitoring well HW-1D is a downgradient well located on the north side of Mary Dunn Pond.

17. NE - Not Established

Table 4B- Summary of Historic Groundwater PFAS Analytical Data

Former Barnstable Country Fire and Rescue Training Academy

155 S. Flint Rock Road, Barnstable, MA

RTN 4-26179

SAMPLE ID	USEPA ^{1,2} HEALTH ADVISORY	Method 1 GW-1 Standards ⁴	MW-28S	MW-30	MW-31	MW-32	MW-36D	MW-37	MW-37D	MW-99i			HW-2S
SCREEN DEPTH (FEET)													
WELL DIAMETER (INCHES)													
WELL STATUS			Viable	Viable	Viable	Not Viable	Viable	Viable	Viable	Not Viable			
SAMPLING DATE			4/1/2015	4/1/2015	8/18/2016	5/3/2017	4/6/2015	4/26/2017	4/2/2015	4/6/2015	4/26/2017	10/29/2019	5/3/2017
UNITS	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L	ng/L
PFAS (Method 537.2)													
PFOA	70	20	2,100	1,400	3,200	240	140	77	60	730	240	630	15
PFOA	70	20	90	130	170	36	<20	77	90	70	18	50	8.2
PFNA	NE	20	--	--	--	--	--	--	--	--	--	58	--
PFHxS	NE	20	--	--	--	--	--	--	--	--	--	340	--
PFHpA	NE	20	--	--	--	--	--	--	--	--	--	46	--
PFDA	NE	20	--	--	--	--	--	--	--	--	--	5.5	--
TOTAL Σ 6 PFAS	70	20	2,190	1,530	3,370	276	140	154	150	800	258	1,130	23.2

Notes:

1. Prior to June 11, 2018, the USEPA established the EPA Health Advisory for two PFAS chemicals, PFOA and PFOS, which was 70 ng/L. Subsequently, MassDEP's Office of Research and Standards (ORS) expanded on this Health Advisory and created the ORS Guideline that applies to the total summed of five PFAS chemicals, PFOS, PFOA, PFNA, PFHxS, and PFHpA, effective June 11, 2018.

2. The USEPA and MassDEP ORS Guideline applies to five PFAS chemicals of concern (PFOS, PFOA, PFNA, PFHpA, and PFHxS) individually as well as the sum of the five PFAS of concern.

3. The complete PFAS concentration data set collected from PRW-4 is detailed in the data table titled "Summary of Groundwater Pump and Treatment System PFOS/PFOA Analytical Data. Data presented herein is summarized and data was selected based on quarterly sampling events.

4. (-) Concentrations of the three additional PFAS chemicals, PFNA, PFHxS, and PFHpA were not presented until after the MassDEP ORS Guideline was in effect on 06.11.18. PFAS concentrations were regulated by the USEPA Health Advisory prior to 6.11.18. Concentrations of PFDA were not presented prior to April 19, 2019. MassDEP released drafted Method 1 groundwater risk standards for PFAS on April 19, 2019 that applies to the total sum and individual concentrations of six PFAS compounds (PFOS, PFOA, PFNA, PFHxS, PFHpA, and PFDA), which is 20 ng/L. These drafted groundwater standards were finalized and became effective on December 27, 2019.

5. BRL - Below Laboratory Detection Limits

6. Concentrations presented in ng/L - nanograms per Liter - parts per trillion

7. Concentrations in bold exceed applicable Health Advisory Limit or Method 1 GW-1 Standard

8. PFOS - Perfluorooctanesulfonate

9. PFOA - Perfluorooctanoic Acid

10. PFNA - Perfluorononanoic Acid

11. PFHxS - Perfluorohexanesulfonic Acid

12. PFHpA - Perfluoroheptanoic Acid

13. PFDA - Perfluorodecanoic Acid

14. NA - Concentration data not available

15. Monitoring well HS-1, HS-2, HS-2S, and HS-6 were destroyed or removed during soil removal activities in January 2017 as part of an Immediate Response Action Plan. The well was replaced with HSW-1/HS-1a as post-exacavation activities.

16. Monitoring well HW-1D is a downgradient well located on the north side of Mary Dunn Pond.

17. NE - Not Established

FIGURES

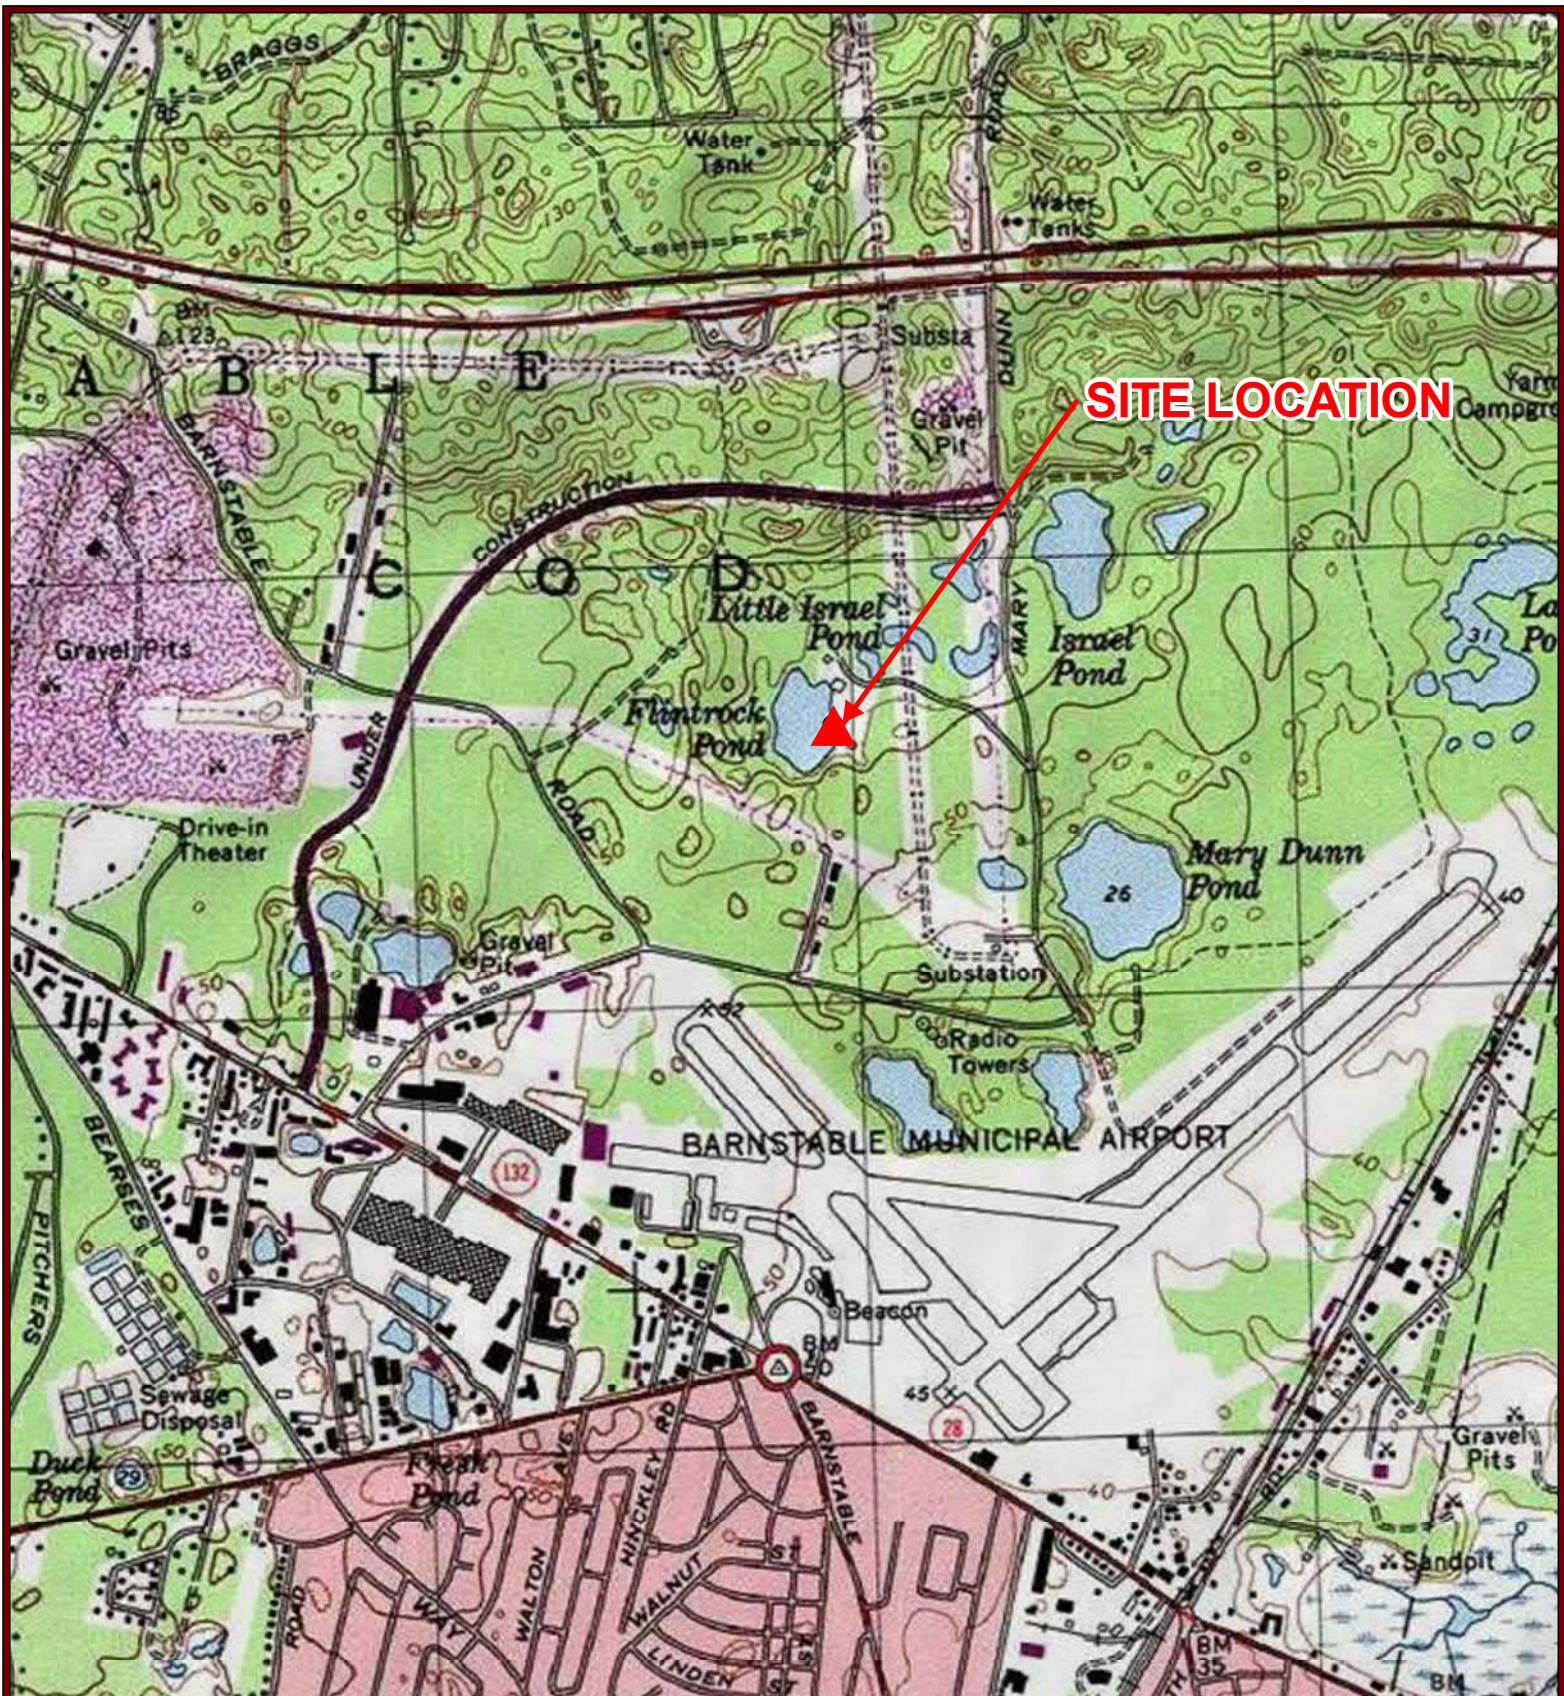


FIGURE 1 - SITE LOCATION


BARNSTABLE COUNTY
FIRE & RESCUE TRAINING ACADEMY SITE
155 S. FLINT ROCK ROAD
BARNSTABLE, MA 02630
RTN 4-26179

LATITUDE: 41°40'41.53"N
LONGITUDE: 70°17'7.82"W

0 500 1,000 2,000
Feet




Service Layer Credits: Esri, HERE, Garmin, (c) OpenStreetMap contributors, and the GIS user community
Copyright: © 2013 National Geographic Society, i-cubed

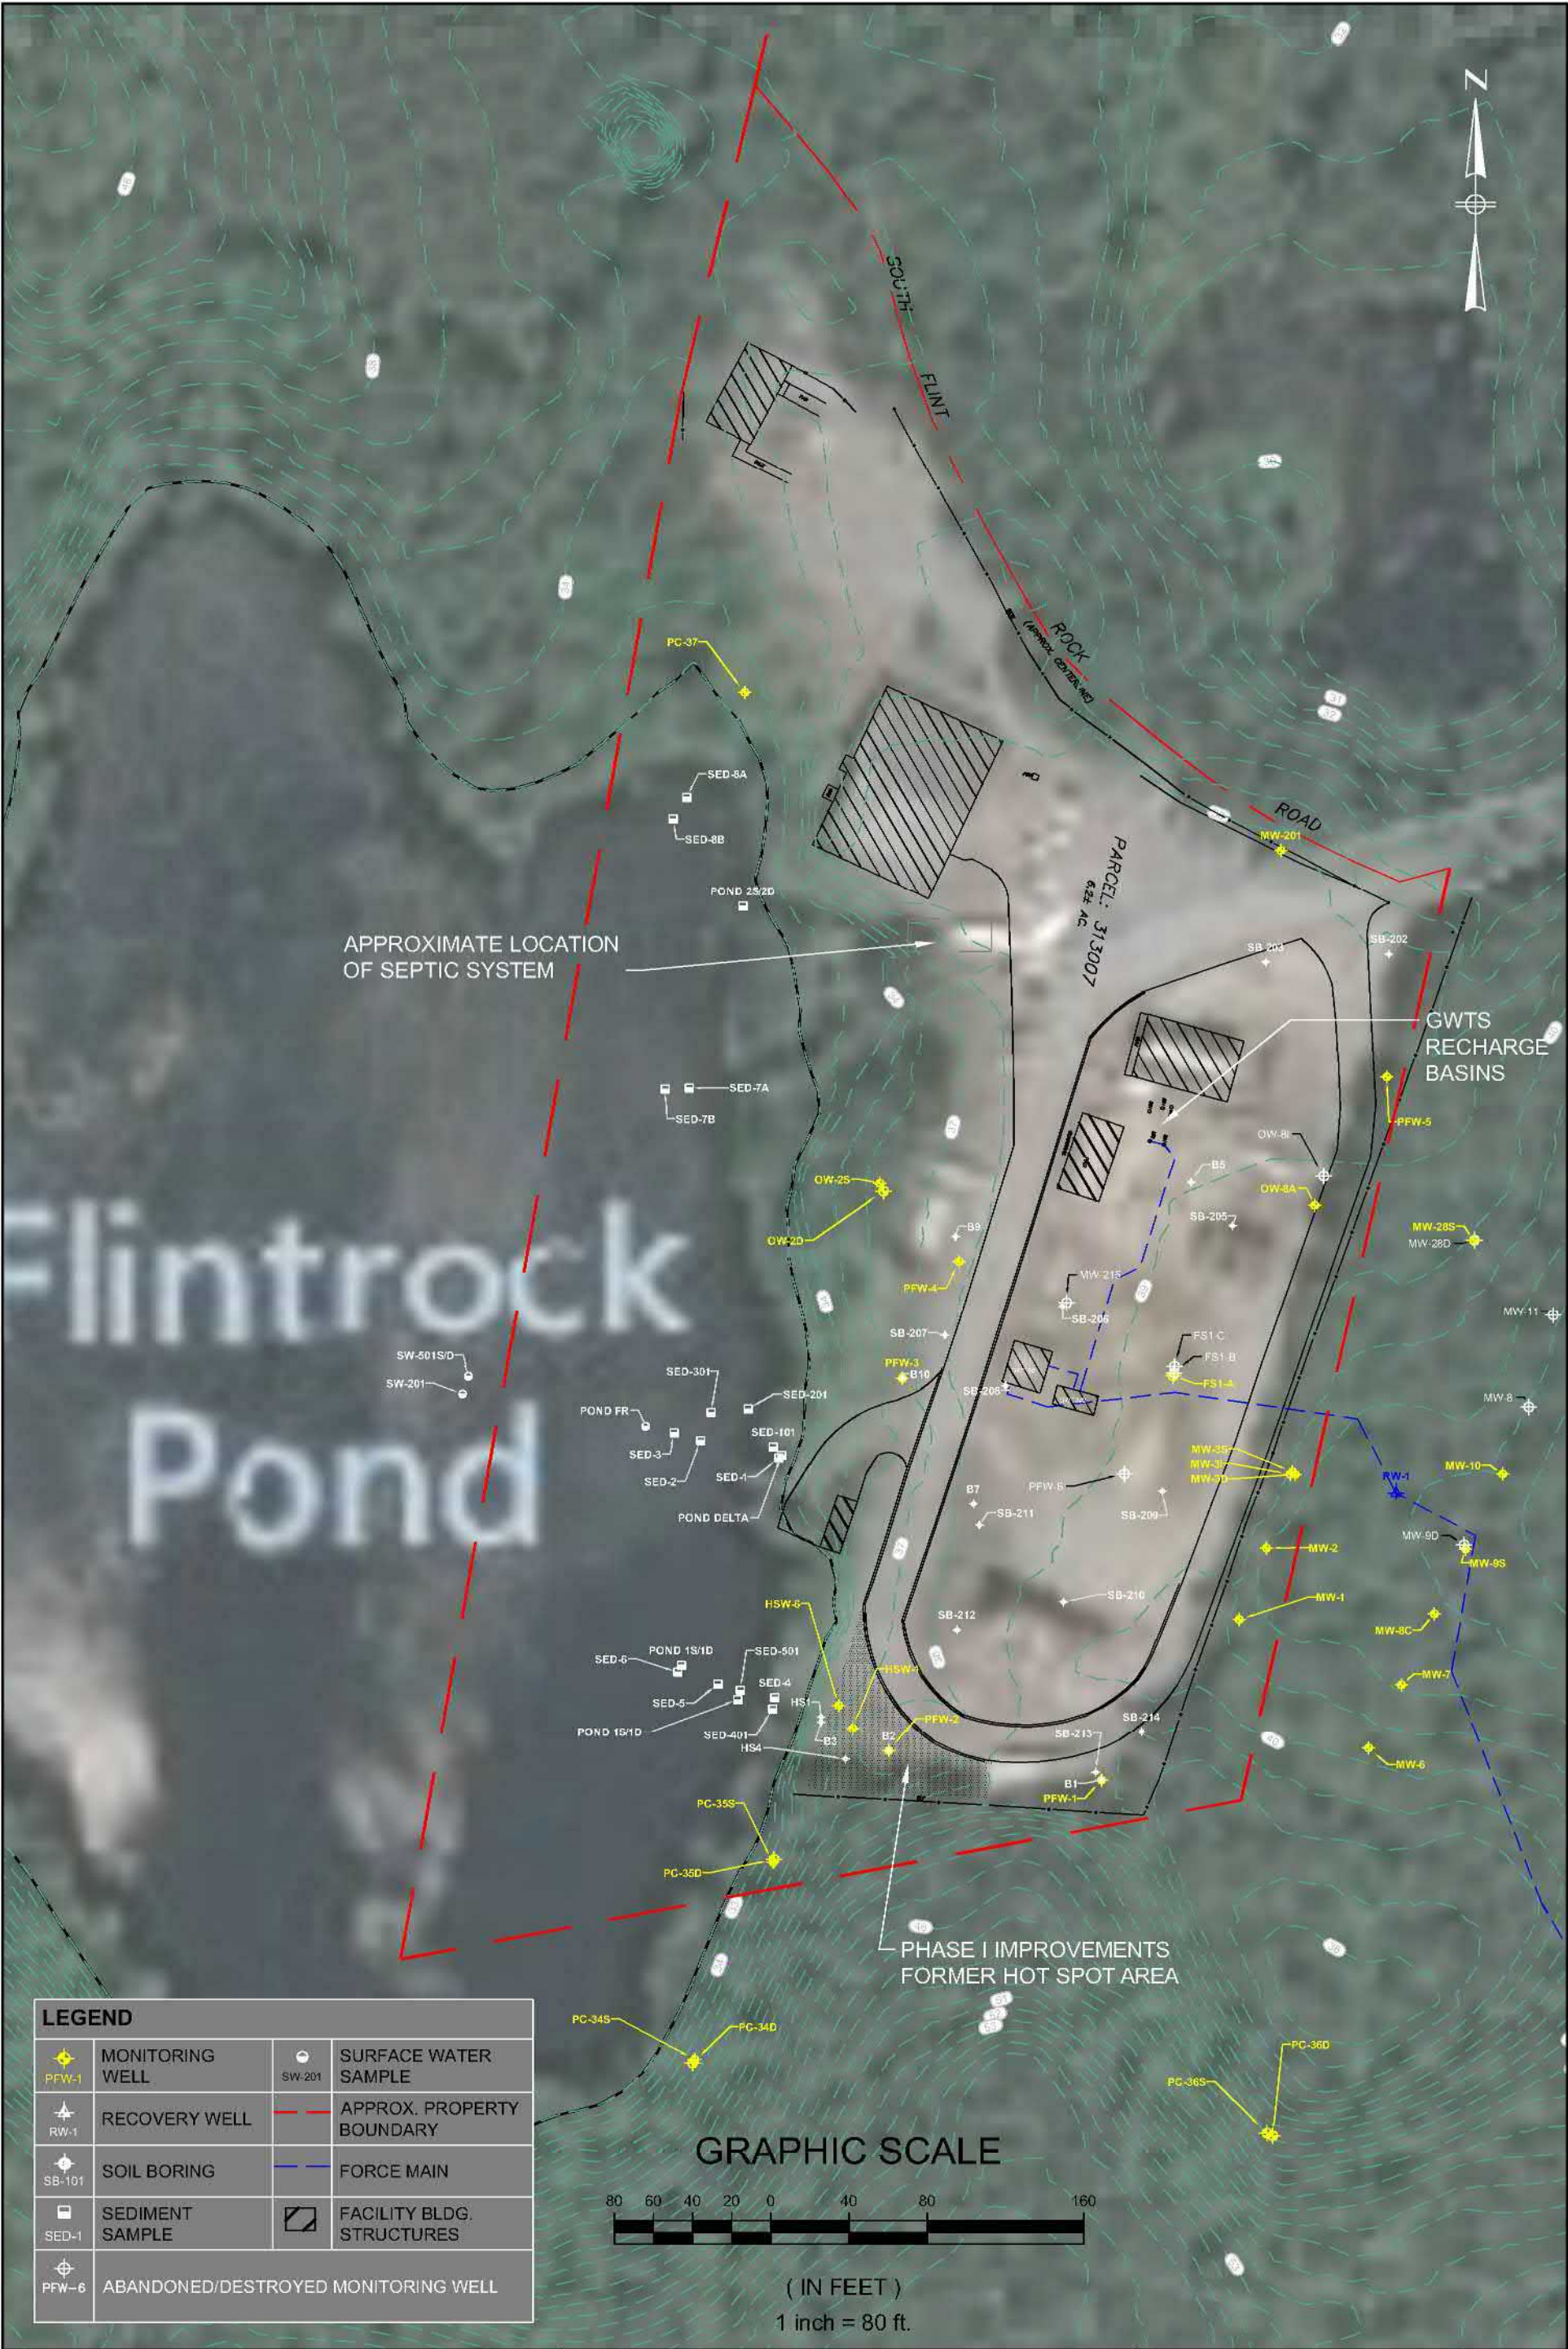

K:\6206 BARNSTABLE COUNTY\MCP LSP BASE SERVICES FMRLY 2018-2019 SERVICES\DRAWINGFILES\XREFS\GW CONTOUR\6206_EX_BASE_MM_2020-1.DWG



FIGURE 3 - SITE PLAN
Former Barnstable County Fire & Rescue Training Academy
155 South Flint Rock Road, Barnstable, MA

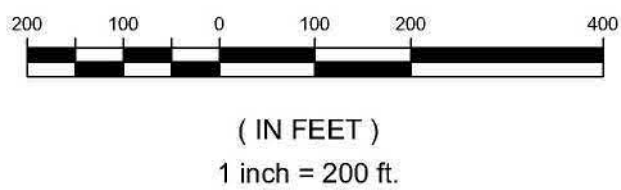

MassDEP - Bureau of Waste Site Cleanup

Phase 1 Site Assessment Map: 500 feet & 0.5 Mile Radii

FIGURE 4

Site Information:

BARNSTABLE COUNTY FIRE & RESCUE TRAINING ACADEMY
155 SOUTH FLINT ROCK ROAD BARNSTABLE, MA
4-000026179

NAD83 UTM Meters:

4614868mN, 393038mE (Zone: 19)


April 23, 2021

The information shown is the best available at the date of printing. However, it may be incomplete. The responsible party and LSP are ultimately responsible for ascertaining the true conditions surrounding the site. Metadata for data layers shown on this map can be found at:
<https://www.mass.gov/orgs/massgis-bureau-of-geographic-information>.



MassDEP

Commonwealth of Massachusetts
Department of Environmental Protection

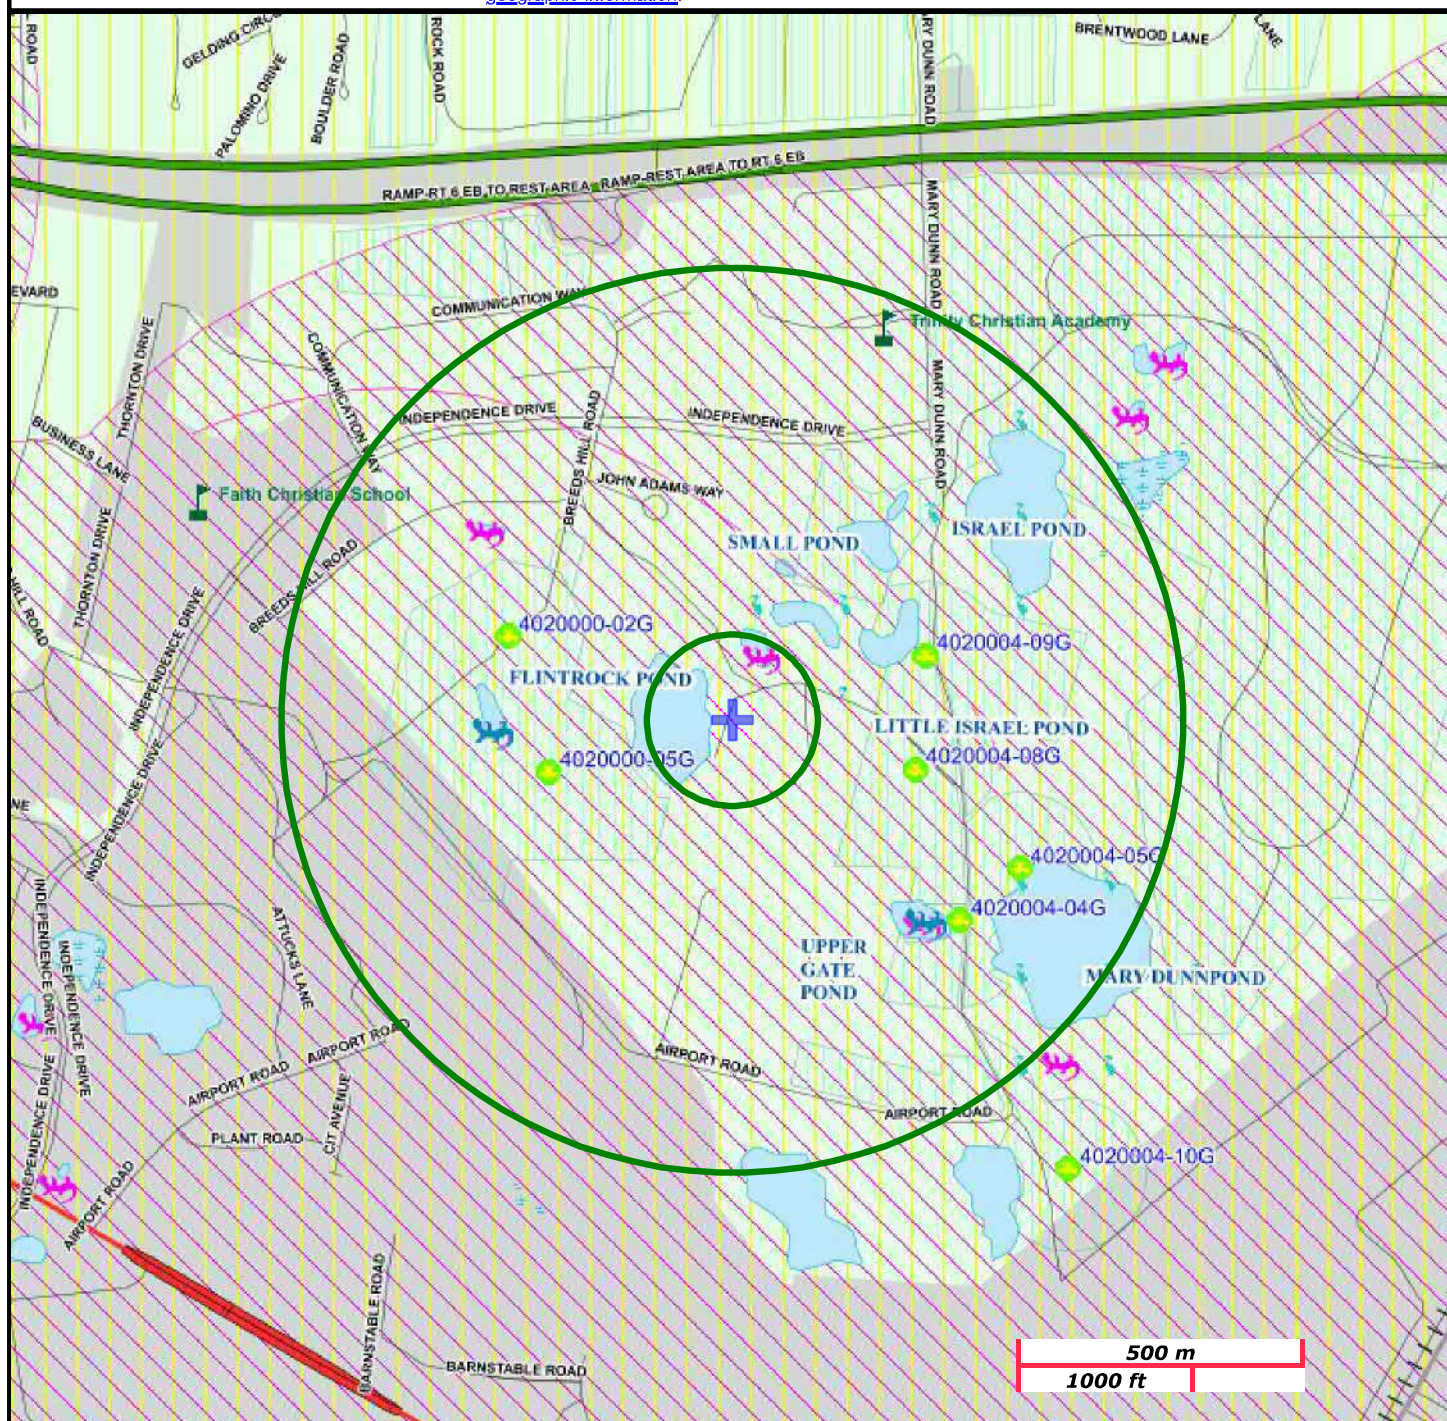

Roads: Limited Access, Divided, Other Hwy, Major Road, Minor Road, Track, Trail

Boundaries: Town, County, DEP Region; Train; Powerline; Pipeline; Aqueduct

Basins: Major, PWS; Streams: Perennial, Intermittent, Man Made Shore, Dam

Aquifers: Medium Yield, High Yield, EPA Sole Source

Non Potential Drinking Water Source Area: Medium, High (Yield)

PWS Protection Areas: Zone II, IWPA, Zone A

Hydrography: Open Water, PWS Reservoir, Tidal Flat


Wetlands: Freshwater, Saltwater, Cranberry Bog

FEMA 100yr Floodplain; Protected Open Space; ACEC

Est. Rare Wetland Wildlife Hab; Vernal Pool: Cert., Potential

Solid Waste Landfill; PWS: Com. GW, SW, Emerg., Non-Com.

Figure 5 - BFTA GWPTS#1 Influent and Midpoint PFAS Concentrations from 2015-2022

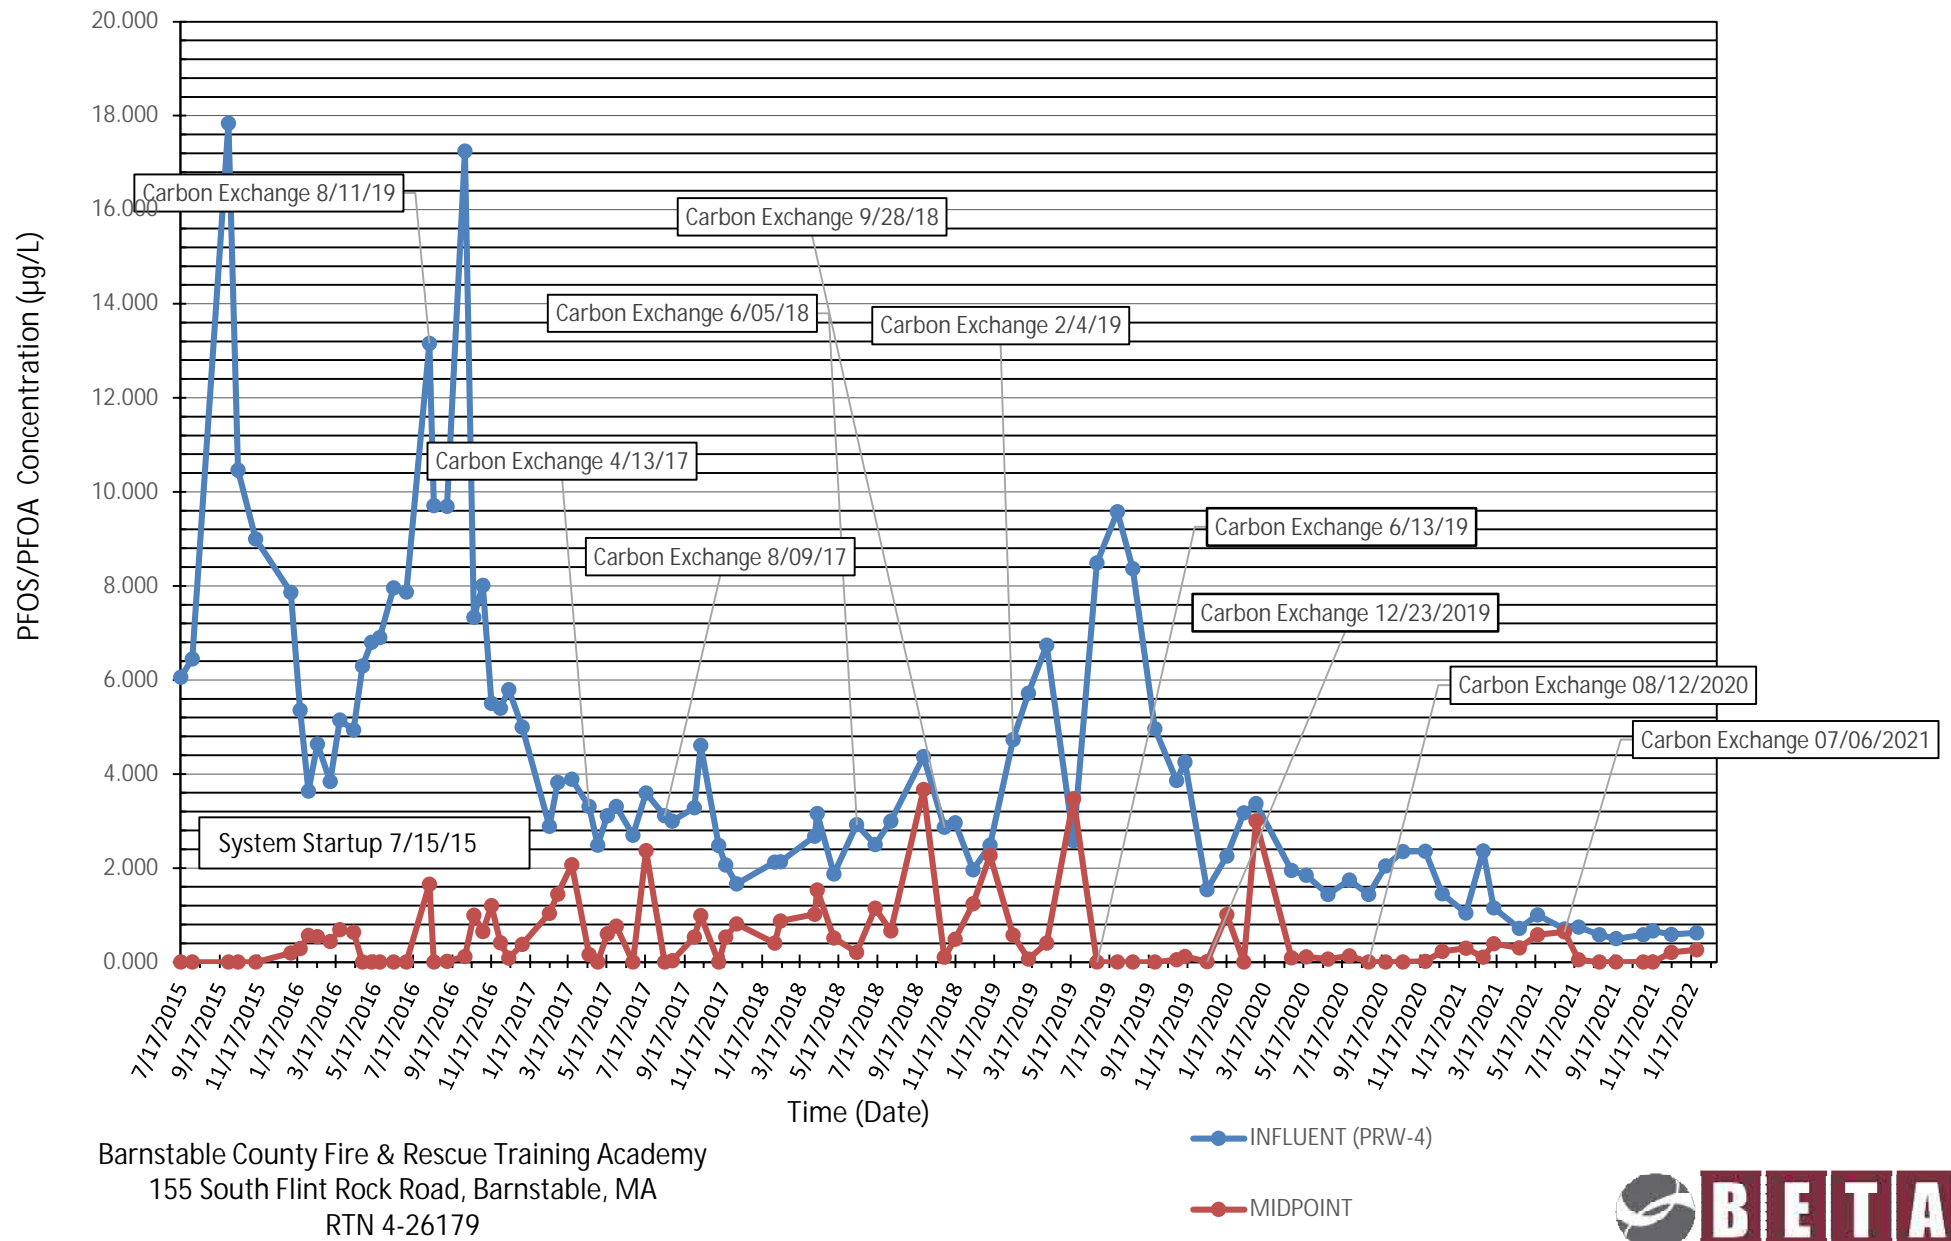


Notes:

1. Concentrations depicted represent the sum of the perfluorooctanesulfonic acid (PFOS) and the perfluorooctanic acid (PFOA) compounds in micrograms per liter (µg/L).
2. Concentration data points at 0 µg/L from Midpoint sample location, indicate a sample was not collected from the Midpoint location on that date or was detected below laboratory reporting limits.



Figure 6 - Σ PFAS Concentrations in PFW-1 from June 2018 - January 2022

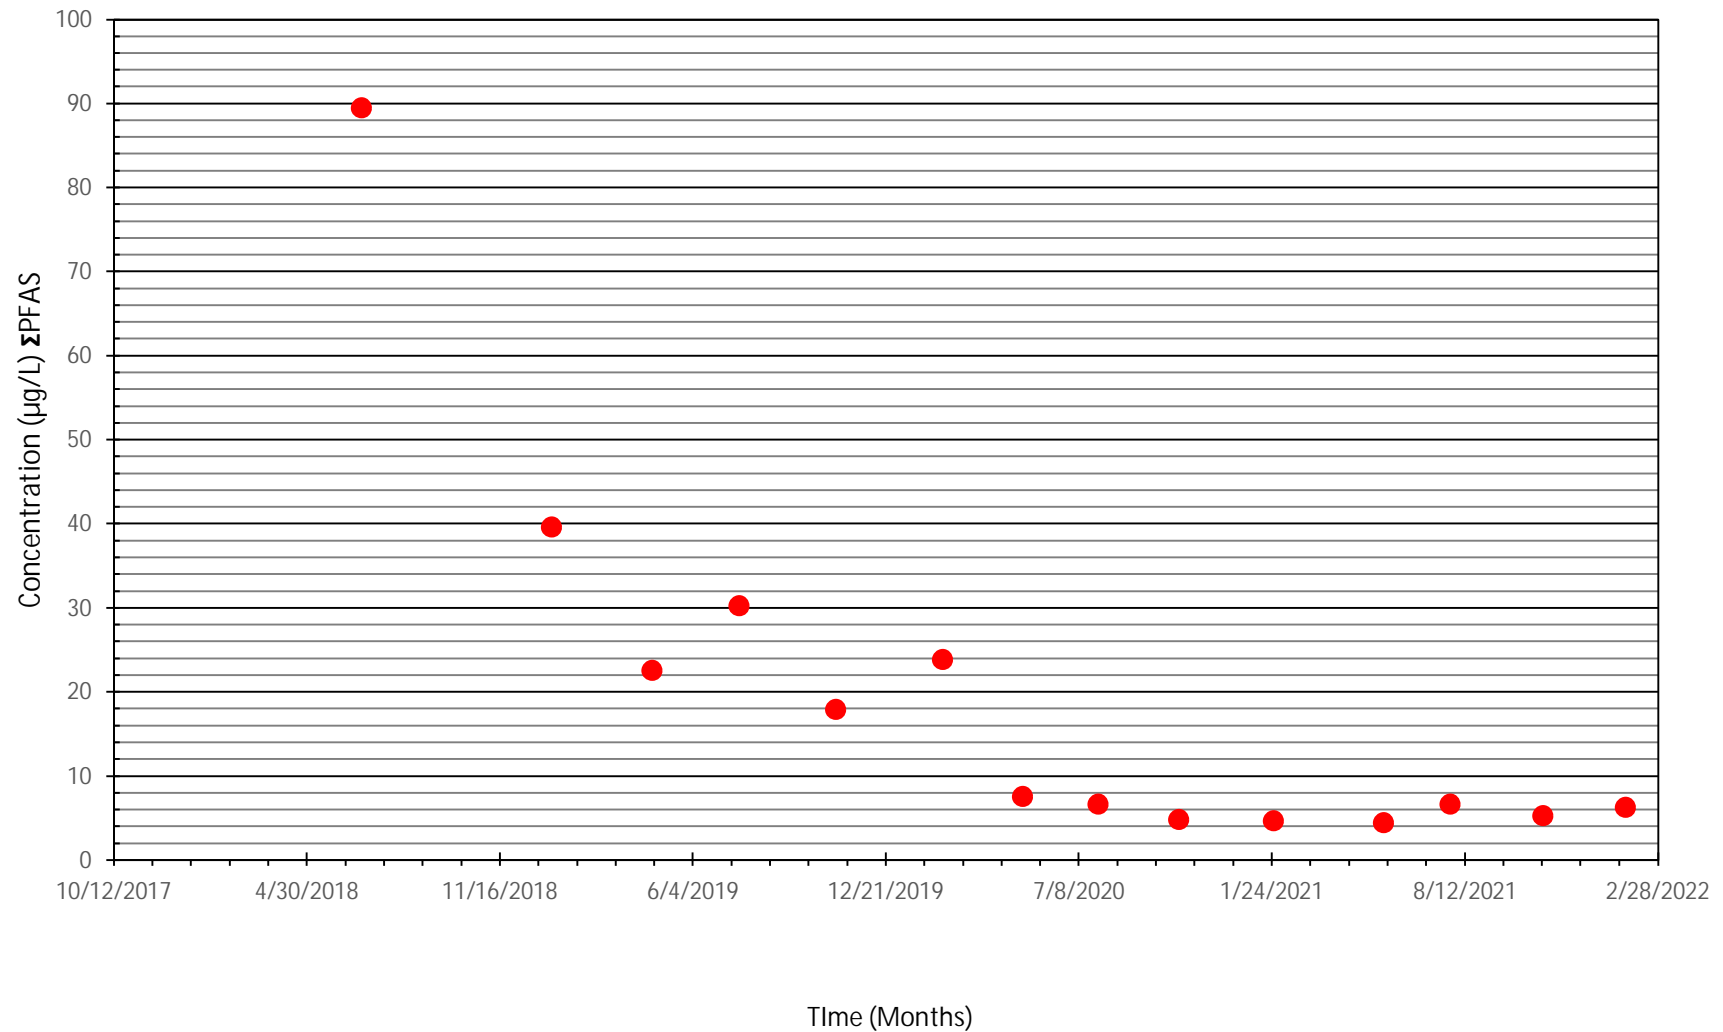


Barnstable County Fire & Rescue Training Academy
155 South Flint Rock Road, Barnstable, MA
RTN 4-26179



Notes:

1. Concentrations depicted represent the sum of the five (5) PFAS compounds, PFOS, PFOA, PFHpA, PFHxS, and PFNA from June 2018 to April 2019. Concentrations depicted from April 2019 to current graphical date represent the sum of the six (6) PFAS compounds PFOS, PFOA, PFHpA, PFHxS, PFNA, and PFDA.
2. Concentrations are in micrograms per liter (µg/L) or parts per billion (ppb).

Figure 7 - Σ PFAS Concentrations in OW-8A from January 2019 - January 2022

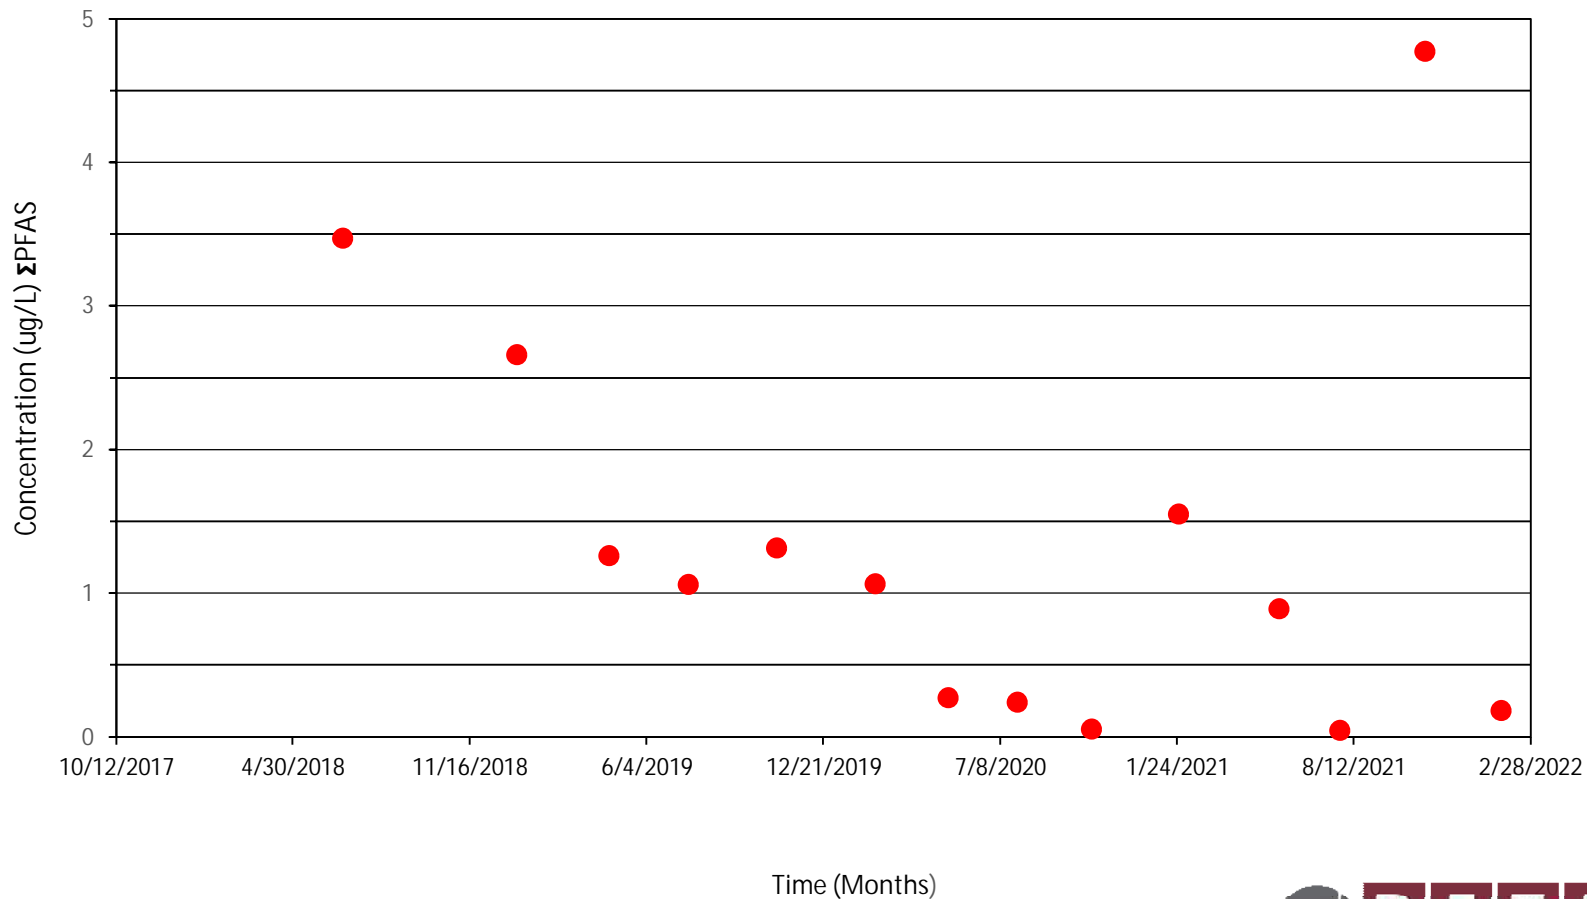


Barnstable County Fire & Rescue Training
Academy
155 South Flint Rock Road, Barnstable, MA
RTN 4-26179



Notes:

1. Concentrations depicted represent the sum of the the five (5) PFAS compounds, PFOS, PFOA, PFHpA, PFHxS, and PFNA from June 2018 to April 2019. Concentrations depicted from April 2019 to current graphical date represent the sum of the six (6) PFAS compounds: PFOS, PFOA, PFHpA, PFHxS, PFNA, and PFDA.
2. Concentrations are in in micrograms per liter (µg/L) or parts per billion (ppb) .

Figure 8 - ΣPFAS Concentrations in MW-12 and MW-22 from June 2018 - January 2022

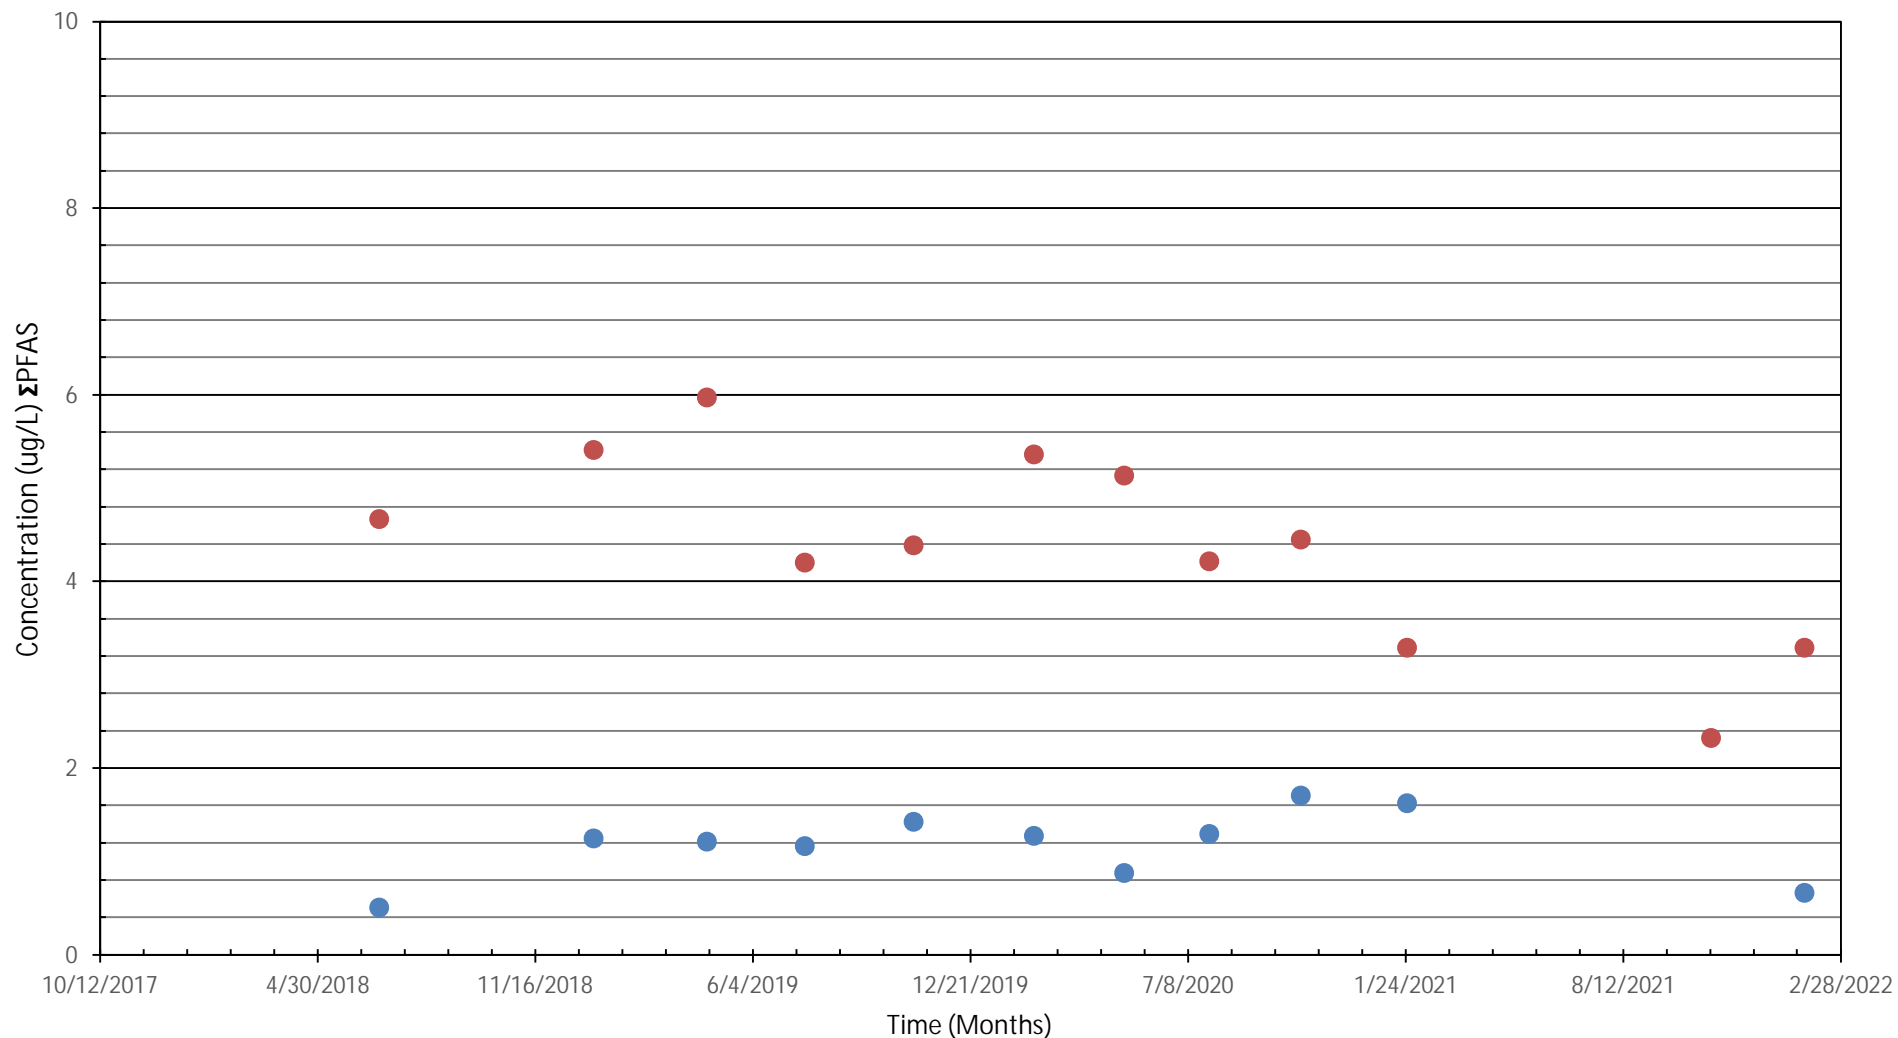

Barnstable County Fire & Rescue Training Academy
155 South Flint Rock Road, Barnstable, MA
RTN 4-26179


● MW-22 ● MW-12S



Notes:

1. Concentrations depicted represent the sum of the five (5) PFAS compounds, PFOS, PFOA, PFHpA, PFHxS, and PFNA from June 2018 to April 2019. Concentrations depicted from April 2019 to October 2019 represent the sum of the six (6) PFAS compounds PFOS, PFOA, PFHpA, PFHxS, PFNA, and PFDA.
2. Concentrations are in micrograms per liter (µg/L) or parts per billion (ppb).
3. Concentrations from May 2021 were not included due to sample naming issue and concentrations from July 2021 are not depicted because both wells were dry.

Figure 9A - ΣPFAS Concentrations in PC-6A from June 2018 - January 2022

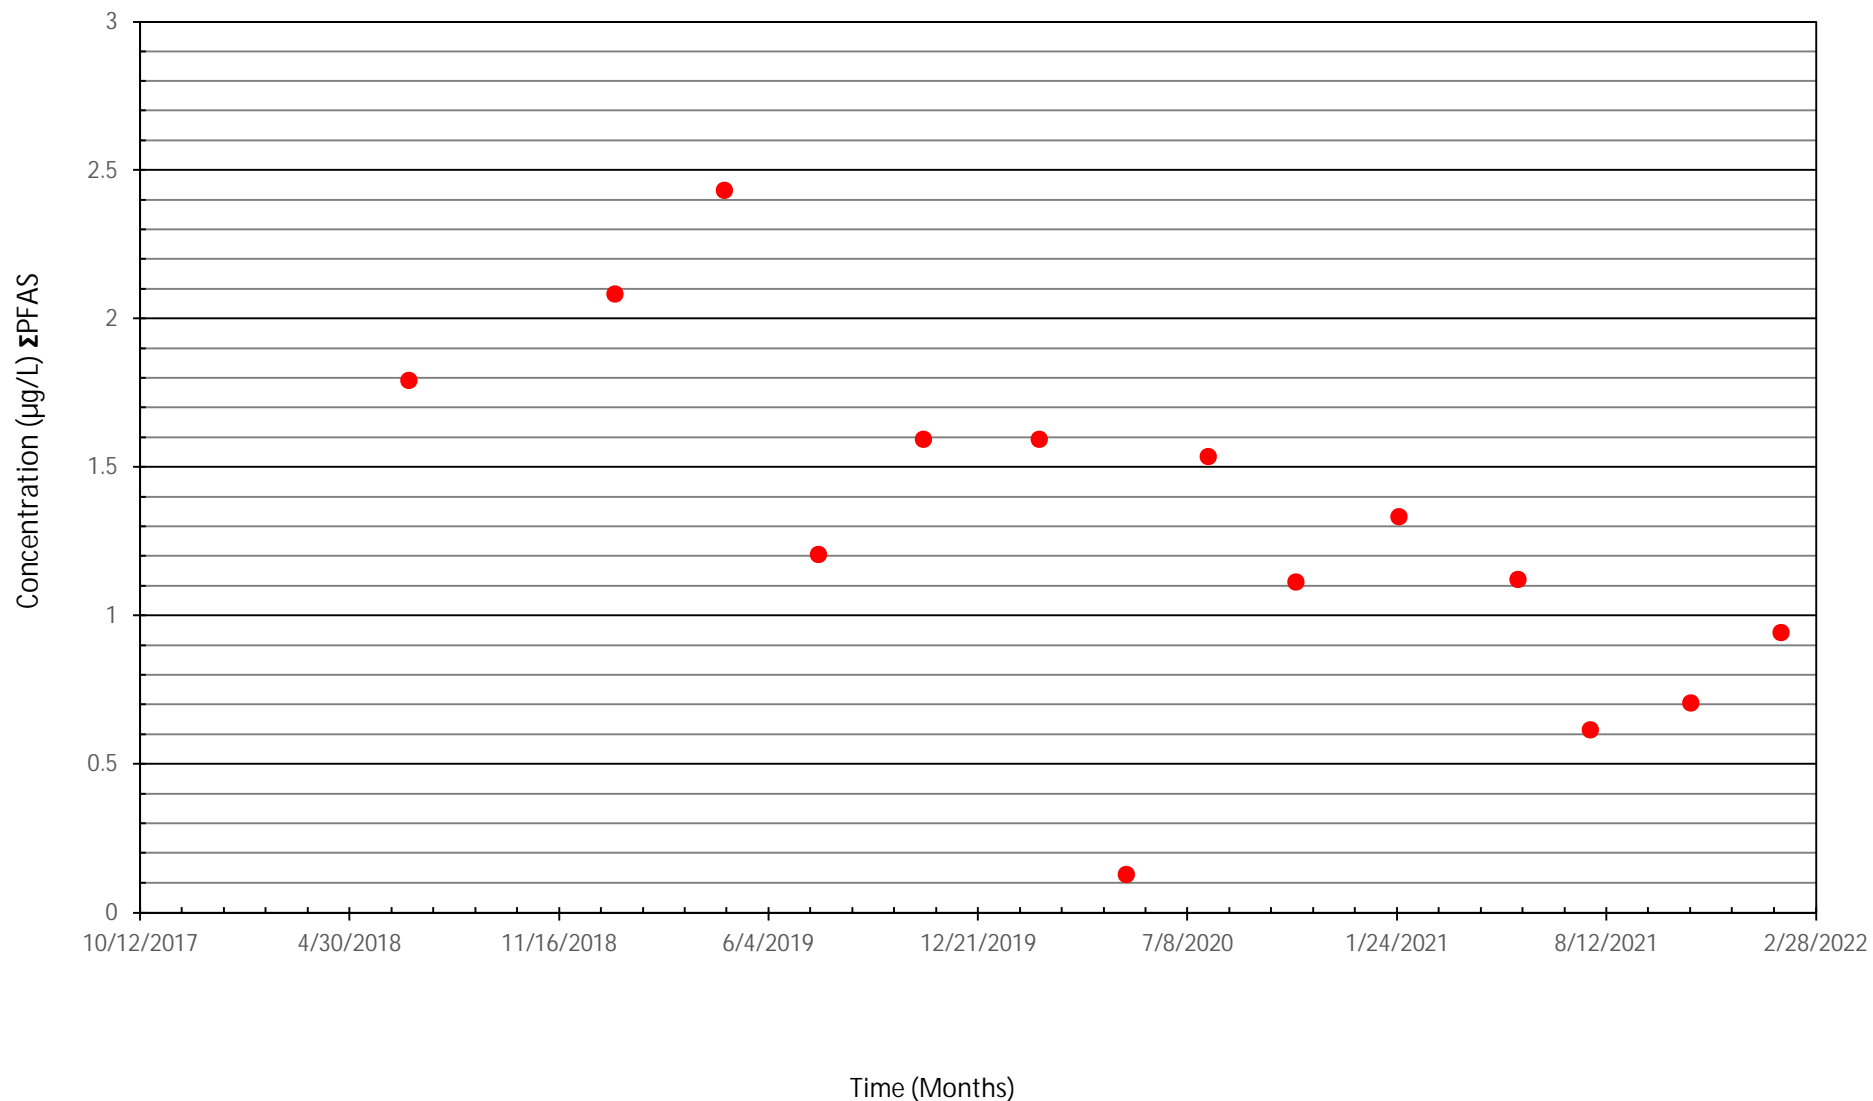

Barnstable County Fire & Rescue Training Academy
155 South Flint Rock Road, Barnstable, MA
RTN 4-26179


● PC-6A



Notes:

1. Concentrations depicted represent the sum of the the five (5) PFAS compounds, PFOS, PFOA, PFHpA, PFHxS, and PFNA from June 2018 to April 2019. Concentrations depicted from April 2019 to October 2019 represent the sum of the six (6) PFAS compounds PFOS, PFOA, PFHpA, PFHxS, PFNA, and PFDA.
2. Concentrations are in in micrograms per liter (µg/L) or parts per billion (ppb).

Figure 9B - Σ PFAS Concentrations in PC-11 from June 2018 - January 2022

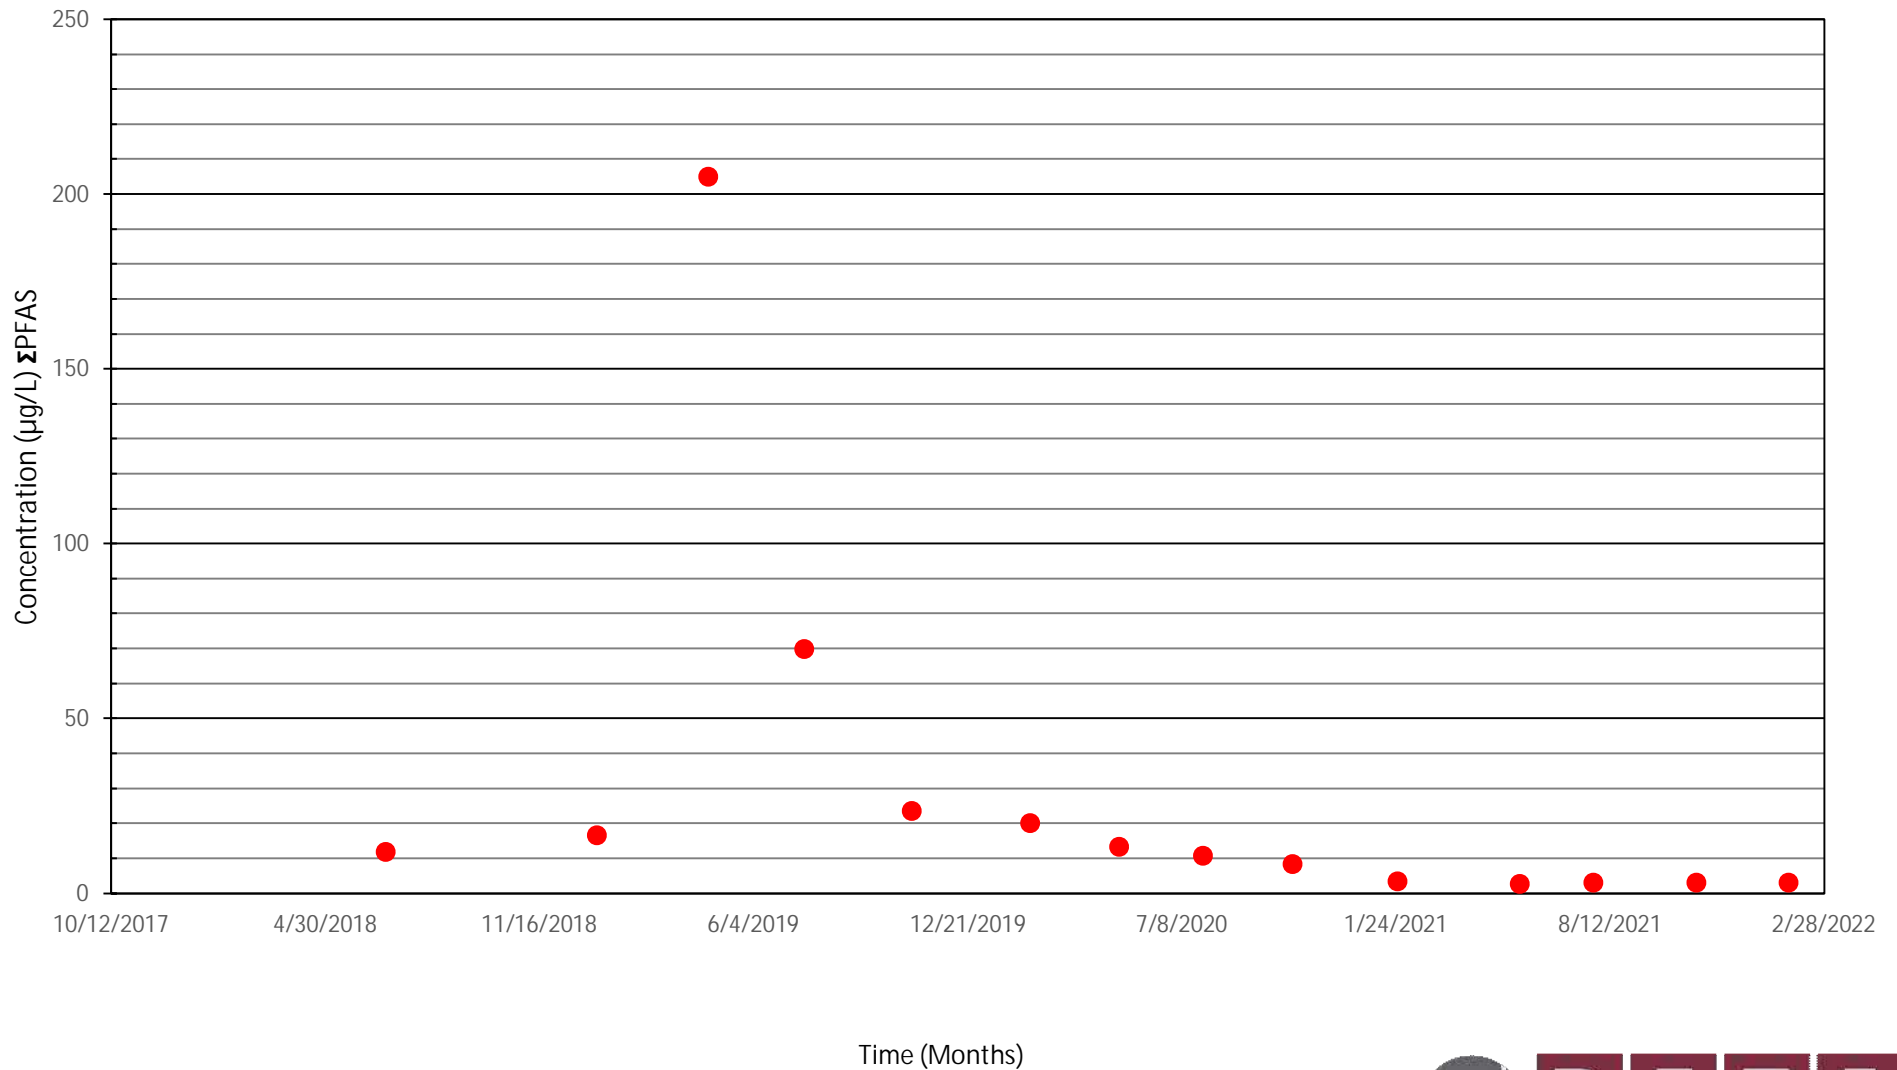

Barnstable County Fire & Rescue Training Academy
155 South Flint Rock Road, Barnstable, MA
RTN 4-26179


● PC-11



Notes:

1. Concentrations depicted represent the sum of the five (5) PFAS compounds, PFOS, PFOA, PFHpA, PFHxS, and PFNA from June 2018 to April 2019. Concentrations depicted from April 2019 to October 2019 represent the sum of the six (6) PFAS compounds PFOS, PFOA, PFHpA, PFHxS, PFNA, and PFDA.
2. Concentrations are in micrograms per liter (µg/L) or parts per billion (ppb).

Figure 9C - Σ PFAS Concentrations in PC-28 from January 2019 - January 2022

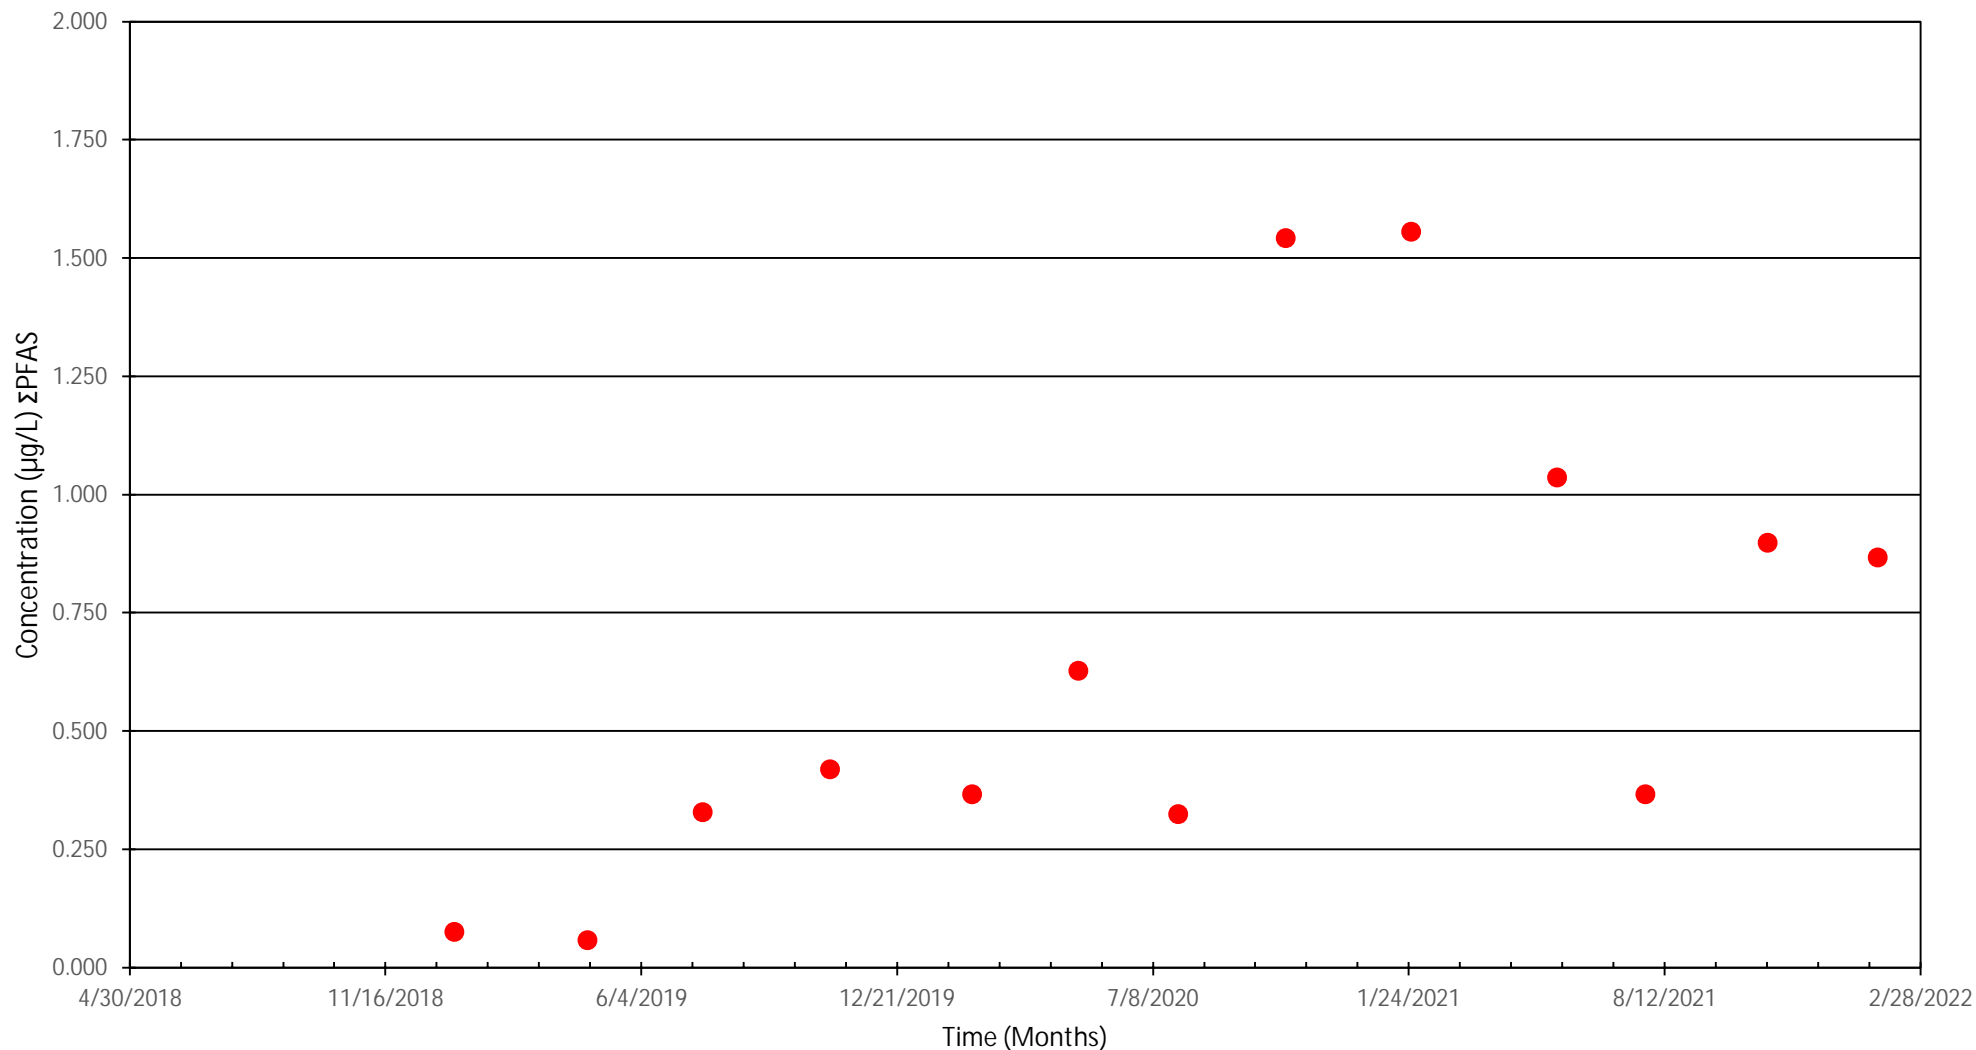


Barnstable County Fire & Rescue Training Academy
155 South Flint Rock Road, Barnstable, MA
RTN 4-26179



Notes:

1. Concentrations depicted represent the sum of the five (5) PFAS compounds, PFOS, PFOA, PFHpA, PFHxS, and PFNA from June 2018 to April 2019. Concentrations depicted from April 2019 to October 2019 represent the sum of the six (6) PFAS compounds: PFOS, PFOA, PFHpA, PFHxS, PFNA, and PFDA.
2. Concentrations are in micrograms per liter ($\mu\text{g/L}$) or parts per billion (ppb).

Figure 9D - ΣPFAS Concentrations in PC-30 from June 2018 - January 2022

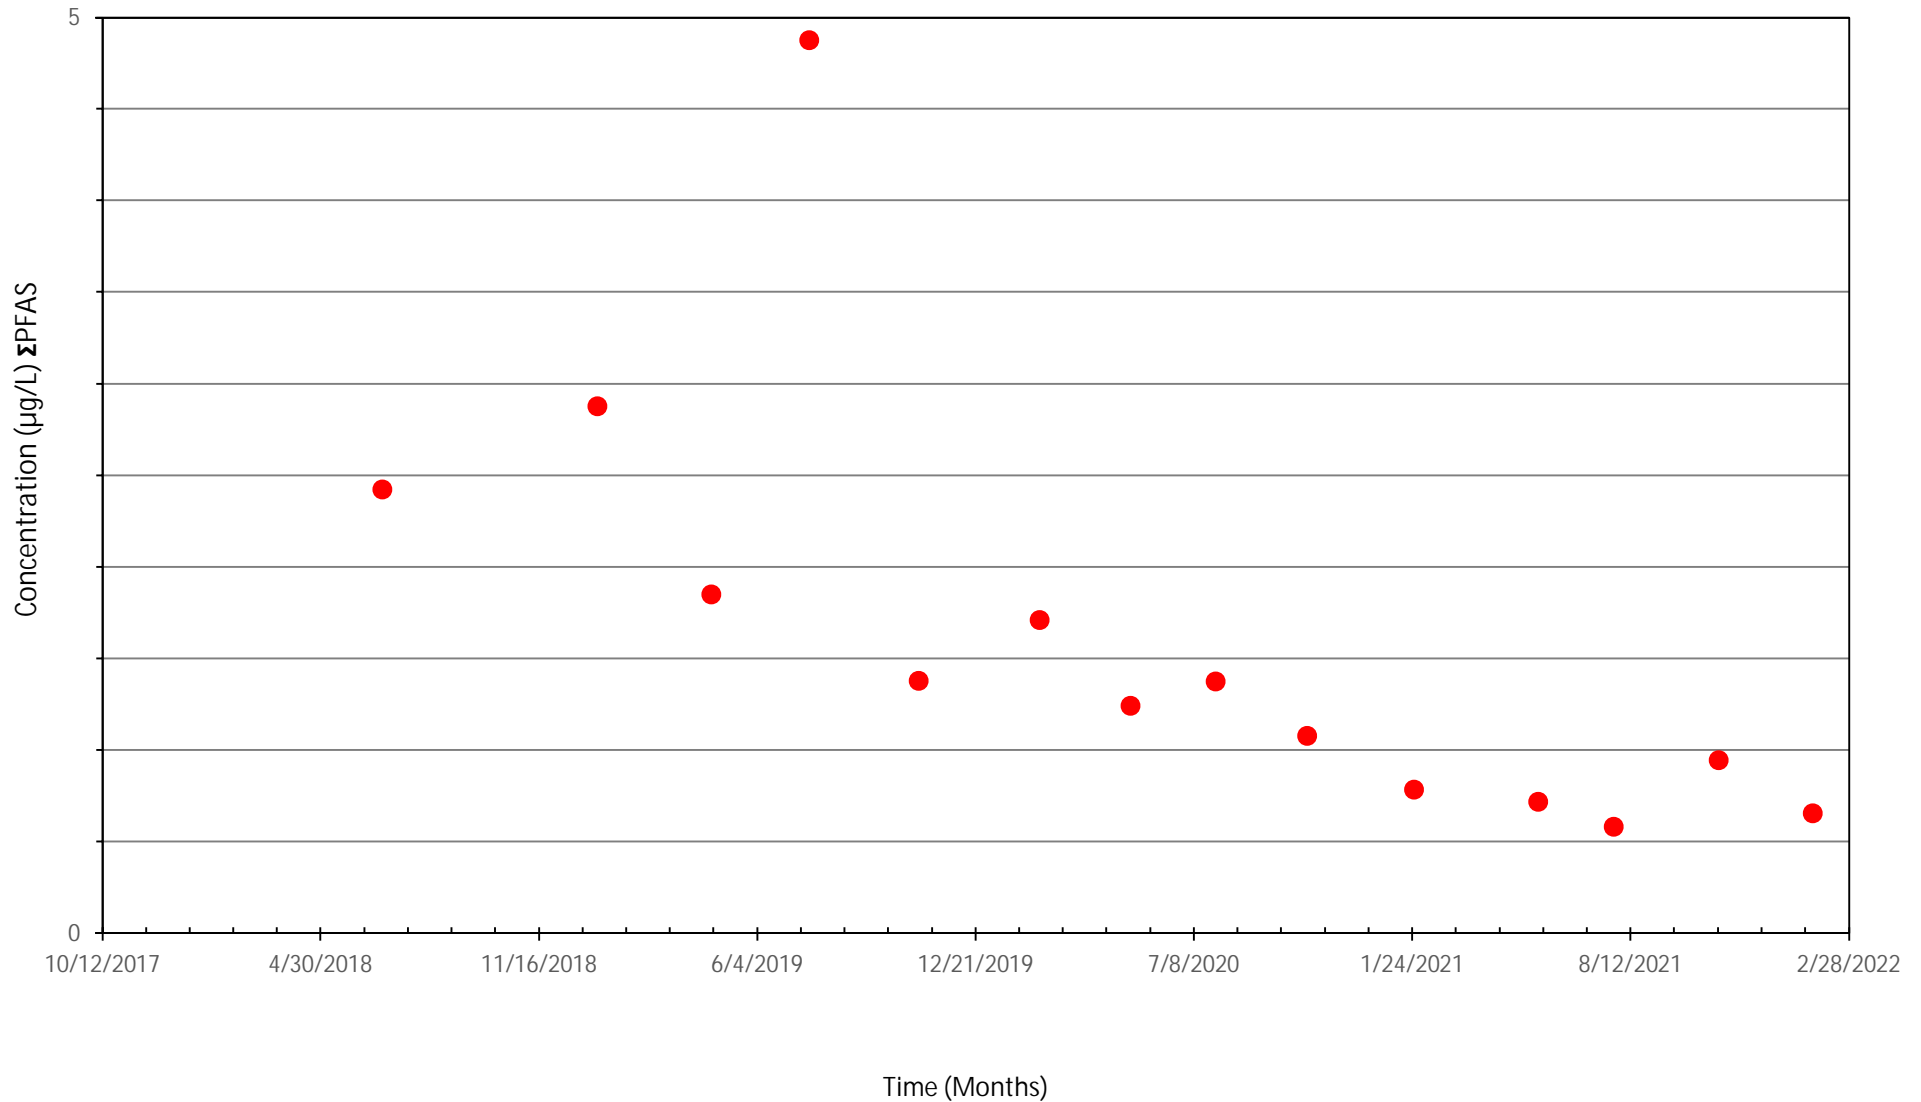

Barnstable County Fire & Rescue Training Academy
155 South Flint Rock Road, Barnstable, MA
RTN 4-26179


● PC-30



Notes:

1. Concentrations depicted represent the sum of the the five (5) PFAS compounds, PFOS, PFOA, PFHpA, PFHxS, and PFNA from June 2018 to April 2019. Concentrations depicted from April 2019 to the graphically represented date are represented as the sum of the six (6) PFAS compounds PFOS, PFOA, PFHpA, PFHxS, PFNA, and PFDA.
2. Concentrations are in in micrograms per liter (µg/L) or parts per billion (ppb).

K:\6206 BARNSTABLE COUNTY\MCP LSP BASE SERVICES FMRLY 2018-2019 SERVICES\DRAWINGFILES\XREFS\GW CONTOUR\6206_EX_BASE_PFA5.DWG

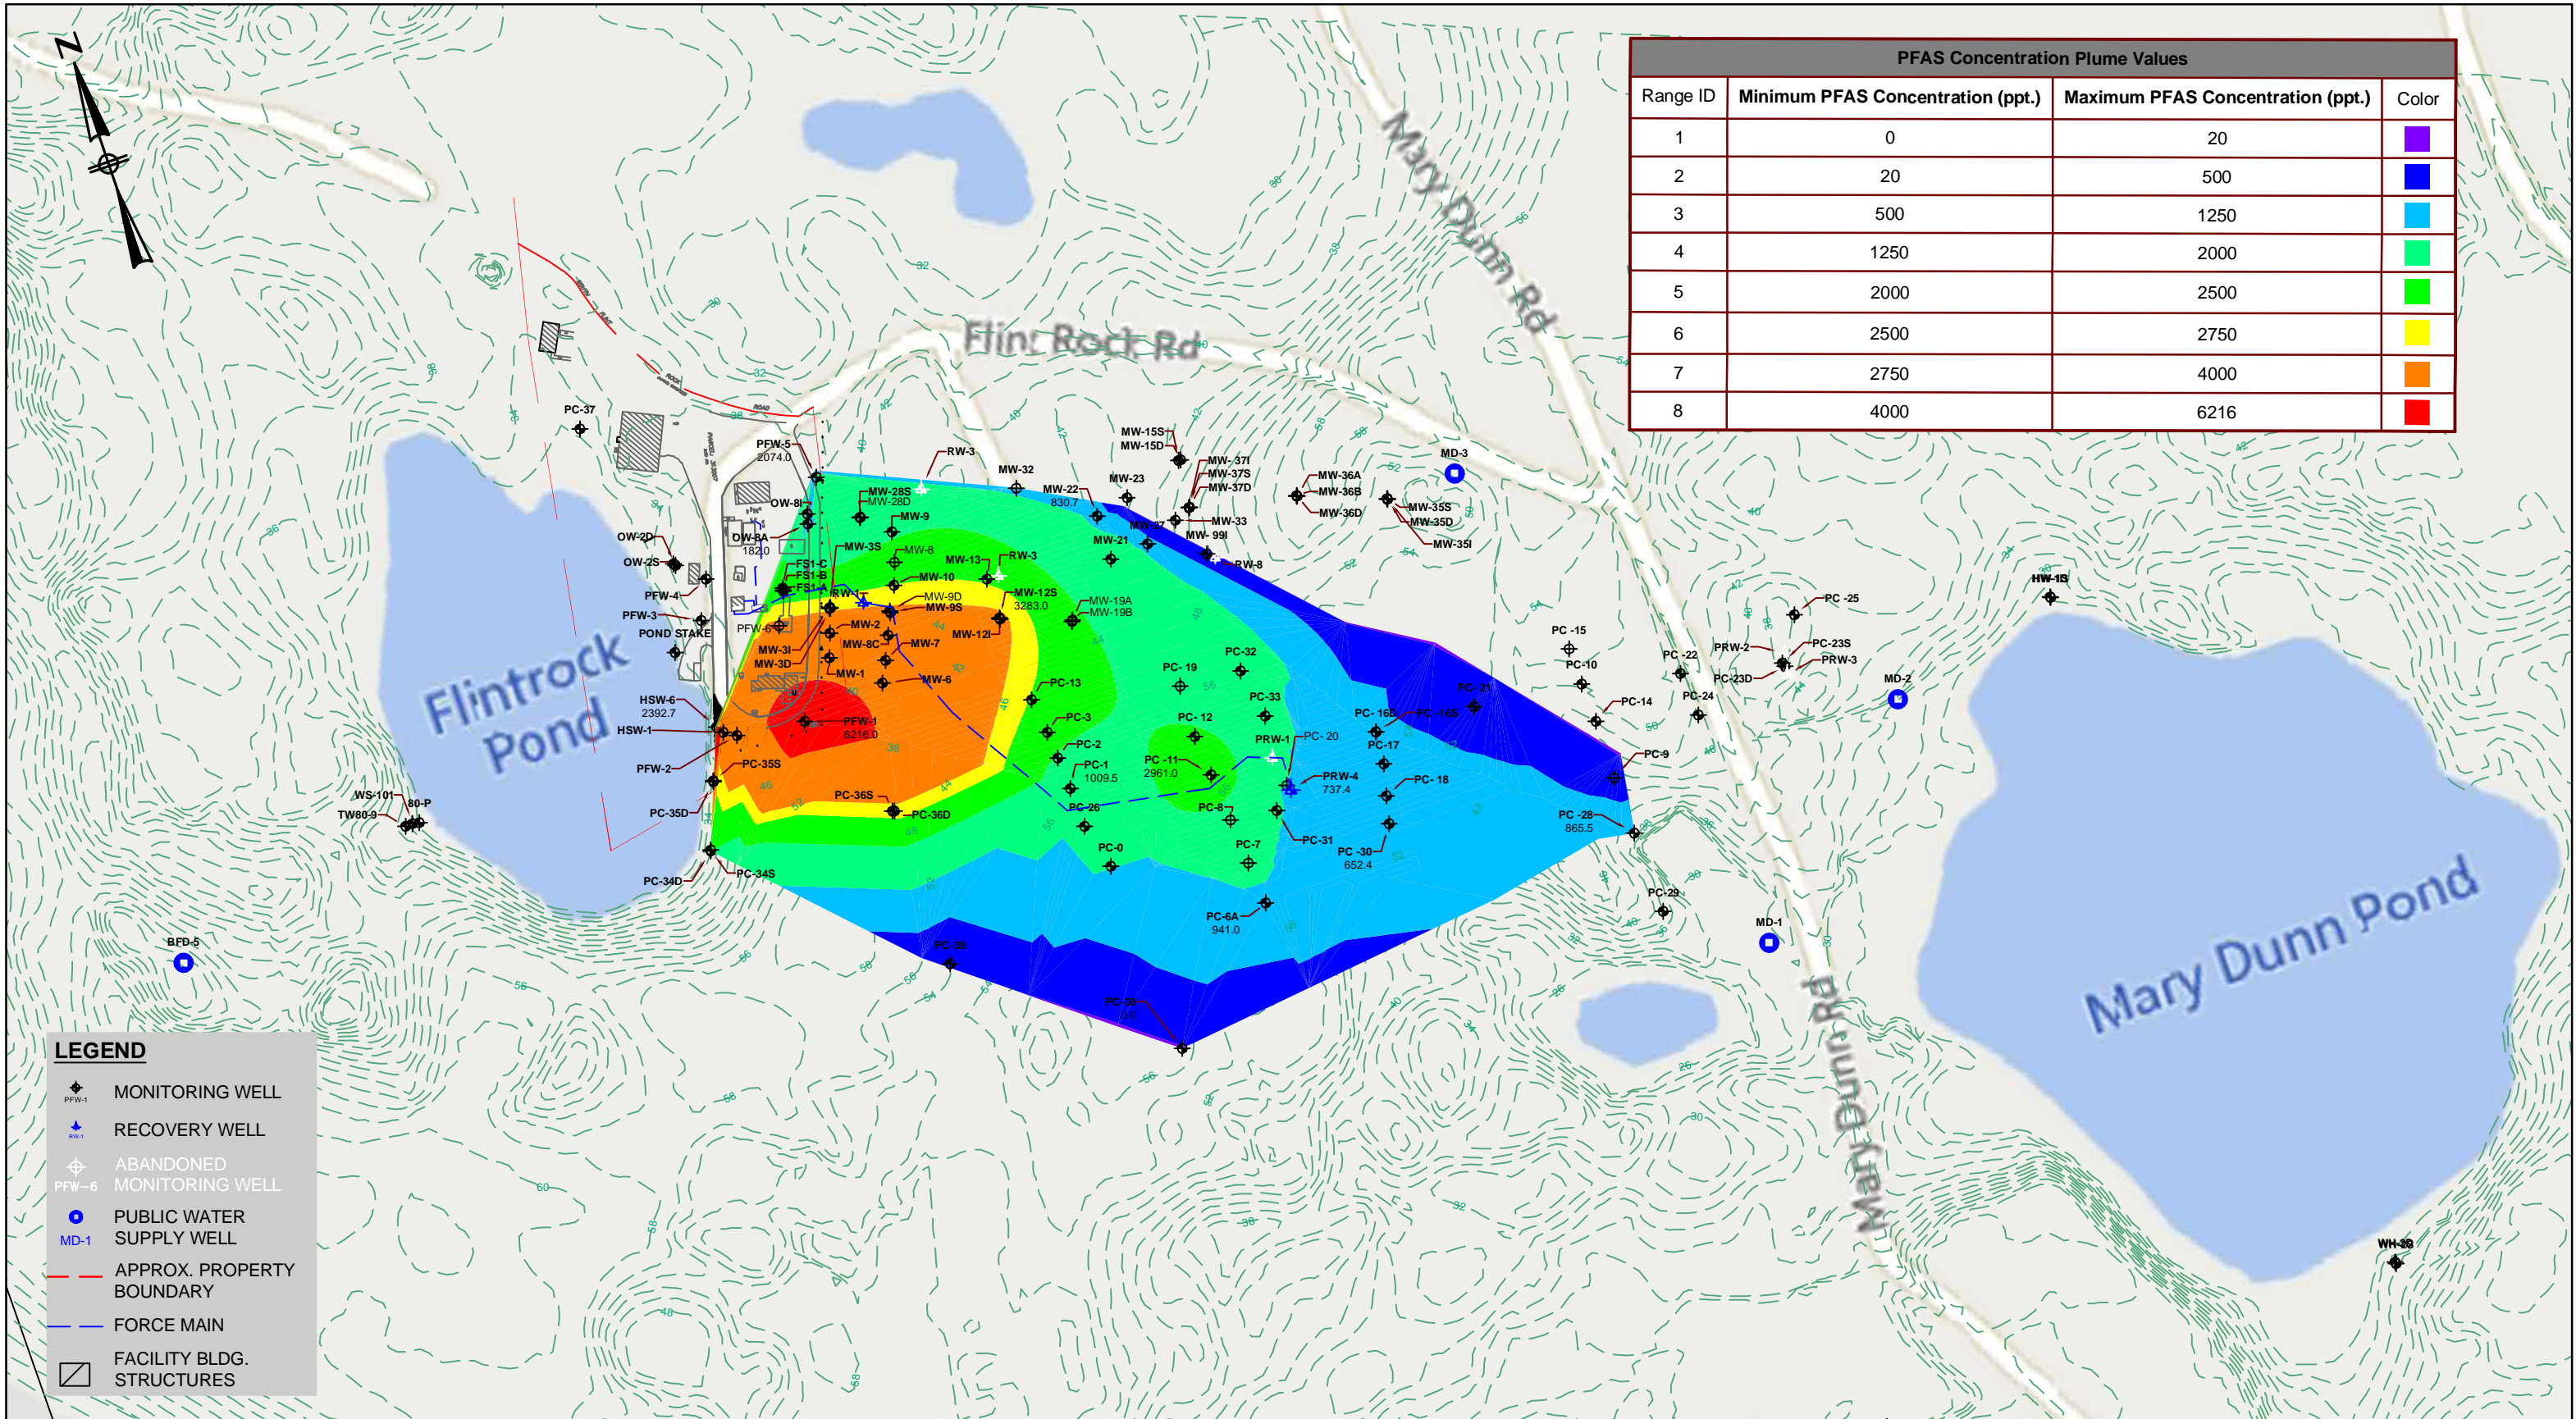

**FIGURE 10 - Groundwater PFAS Concentration Plume
January 2022**

**Barnstable County Fire & Rescue Training Academy
155 South Flint Rock Road, Barnstable, MA**

Plot Date: 04/29/2021


K:\6206 BARNSTABLE COUNTY\MCP LSP BASE SERVICES\FAIRLY 2018-2019 SERVICES\DRAWINGFILES\KREFS\GW CONTOUR\6206_EX_BASE_MM_2020-1.DWG



www.BETA-Inc.com

FIGURE 11
Groundwater Contour Map - January 2022
Barnstable County Fire & Rescue Training Academy
155 South Flint Rock Road, Barnstable, MA

Plot Date: 2022/02/03 Drawn By: MM



(IN FEET)
1 inch = 200 ft.

APPENDIX A

BWSC TRANSMITTAL FORM (UNSIGNED)



IRA REMEDIAL MONITORING REPORT

Pursuant to 310 CMR 40.0400 (SUBPART D)

Release Tracking Number

Remedial System or Monitoring Program: 1 of 2

4 - 26179

A. DESCRIPTION OF ACTIVE OPERATION AND MAINTENANCE ACTIVITY:

1. Type of Active Operation and Maintenance Activity: (check all that apply)

☒ a. Active Remedial System: (check all that apply)☐ i. NAPL Recovery☐ ii. Soil Vapor Extraction/Bioventing☐ iii. Vapor-phase Carbon Adsorption☒ iv. Groundwater Recovery☐ v. Dual/Multi-phase Extraction☒ vi. Aqueous-phase Carbon Adsorption☐ vii. Air Stripping☐ viii. Sparging/Biosparging☐ ix. Cat/Thermal Oxidation☐ x. Other Describe: _____☐ b. Active Exposure Pathway Elimination MeasureActive Exposure Pathway Mitigation System to address (check one): ☐ i. Indoor Air ☐ ii. Drinking Water☐ c. Application of Remedial Additives: (check all that apply)☐ i. To the Subsurface☐ ii. To Groundwater (Injection)☐ iii. To the Surface☐ d. Active Remedial Monitoring Program Without the Application of Remedial Additives: (check all that apply; Sections C, D and E are not required; attach supporting information, data, maps and/or sketches needed by checking Section G5)☐ i. Reactive Wall☐ ii. Natural Attenuation☐ iii. Other

Describe: _____

2. Mode of Operation: (check one)

☒ a. Continuous☐ b. Intermittent☐ c. Pulsed☐ d. One-time Event Only☐ e. Other: _____

3. System Effluent/Discharge: (check all that apply)

☐ a. Sanitary Sewer/POTW☒ b. Groundwater Re-infiltration/Re-injection: (check one)☐ i. Downgradient☒ ii. Upgradient☐ c. Vapor-phase Discharge to Ambient Air: (check one)☐ i. Off-gas Controls☐ ii. No Off-gas Controls☐ d. Drinking Water Supply☐ e. Surface Water (including Storm Drains)☐ f. Other Describe: _____**B. MONITORING FREQUENCY:**

1. Reporting period that is the subject of this submittal:

From: 1/1/2022

To: 1/31/2022

(mm/dd/yyyy)

(mm/dd/yyyy)

2. Number of monitoring events during the reporting period: (check one)

☐ a. System Startup: (if applicable)☐ i. Days 1, 3, 6, and then weekly thereafter, for the first month.☐ ii. Other Describe: _____☒ b. Post-system Startup (after first month) or Monitoring Program:☒ i. Monthly☐ ii. Quarterly☐ iii. Annually☐ iv. Other Describe: _____☒ 3. Check here to certify that the number of required monitoring events were conducted during the reporting period.**C. EFFLUENT/DISCHARGE REGULATION:** (check one to indicate how the effluent/discharge limits were established)☐ 1. NPDES: (check one)☐ a. Remediation General Permit☐ b. Individual Permit☐ c. Emergency Exclusion

Effective Date of Permit: _____

(mm/dd/yyyy)

☐ 2. MCP Performance Standard

MCP Citations(s): _____

☒ 3. DEP Approval Letter

Date of Letter: 11/16/2018

(mm/dd/yyyy)

☐ 4. Other Describe: _____



Massachusetts Department of Environmental Protection
Bureau of Waste Site Cleanup

IRA REMEDIAL MONITORING REPORT

Pursuant to 310 CMR 40.0400 (SUBPART D)

Remedial System or Monitoring Program: 1 of 2

BWSC105 -A

Release Tracking Number

4 - 26179

D. WASTEWATER TREATMENT PLANT OPERATOR: (check one)

☒ 1. Required due to Remedial Wastewater Treatment Plant in place for more than 30 days.

a. Name: TJMCGOFF

b. Grade: 4

c. License No: 15570

d. License Exp. Date: 12/31/2023

(mm/dd/yyyy)

☐ 2. Not Required

☐ 3. Not Applicable

E. STATUS OF ACTIVE REMEDIAL SYSTEM OR ACTIVE REMEDIAL MONITORING PROGRAM DURING REPORTING PERIOD: (check all that apply)

☒ 1. The Active Remedial System was functional one or more days during the Reporting Period.

a. Days System was Fully Functional: 29

b. GW Recovered (gals): 403137

c. NAPL Recovered (gals):

d. GW Discharged (gals): 403137

e. Avg. Soil Gas Recovery Rate (scfm):

f. Avg. Sparging Rate (scfm):

☐ 2. Remedial Additives: (check all that apply)

☐ a. No Remedial Additives applied during the Reporting Period.

☐ b. Enhanced Bioremediation Additives applied: (total quantity applied at the site for the current reporting period)

☐ i. Nitrogen/Phosphorus:

☐ ii. Peroxides:

Name of Additive	Date	Quantity	Units

Name of Additive	Date	Quantity	Units

☐ iii. Microorganisms:

☐ iv. Other:

Name of Additive	Date	Quantity	Units

Name of Additive	Date	Quantity	Units

☐ c. Chemical oxidation/reduction additives applied: (total quantity applied at the site for the current reporting period)

☐ i. Permanganates:

☐ ii. Peroxides:

Name of Additive	Date	Quantity	Units

Name of Additive	Date	Quantity	Units

☐ iii. Persulfates:

☐ iv. Other:

Name of Additive	Date	Quantity	Units

Name of Additive	Date	Quantity	Units



Massachusetts Department of Environmental Protection
Bureau of Waste Site Cleanup

BWSC105 -A

IRA REMEDIAL MONITORING REPORT

Pursuant to 310 CMR 40.0400 (SUBPART D)

Remedial System or Monitoring Program: of

Release Tracking Number

-

E. STATUS OF ACTIVE REMEDIAL SYSTEM OR ACTIVE REMEDIAL MONITORING PROGRAM DURING REPORTING PERIOD: (cont.)

☐ d. Other additives applied: (total quantity applied at the site for the current reporting period)

Name of Additive	Date	Quantity	Units	Name of Additive	Date	Quantity	Units

☐ e. Check here if any additional Remedial Additives were applied. Attach list of additional additives and include Name of Additive, Date Applied, Quantity Applied and Units (in gals. or lbs.)

F. SHUTDOWNS OF ACTIVE REMEDIAL SYSTEM OR ACTIVE REMEDIAL MONITORING PROGRAM: (check all that apply)

☒ 1. The Active Remedial System had unscheduled shutdowns on one or more occasions during the Reporting Period.

a. Number of Unscheduled Shutdowns: b. Total Number of Days of Unscheduled Shutdowns:

c. Reason(s) for Unscheduled Shutdowns: INCLEMENT WEATHER, POWER LOSS TO THE SYSTEM

☐ 2. The Active Remedial System had scheduled shutdowns on one or more occasions during the Reporting Period.

a. Number of Scheduled Shutdowns: b. Total Number of Days of Scheduled Shutdowns:

c. Reason(s) for Scheduled Shutdowns:

☐ 3. The Active Remedial System or Active Remedial Monitoring Program was permanently shutdown/discontinued during the Reporting Period.

a. Date of Final System or Monitoring Program Shutdown:
(mm/dd/yyyy)

☐ b. No Further Effluent Discharges.

☐ c. No Further Application of Remedial Additives planned; sufficient monitoring completed to demonstrate compliance with 310 CMR 40.0046.

☐ d. No Further Submittals Planned.

☐ e. Other: Describe:

G. SUMMARY STATEMENTS: (check all that apply for the current reporting period)

☒ 1. All Active Remedial System checks and effluent analyses required by the approved plan and/or permit were performed when applicable.

☒ 2. There were no significant problems or prolonged (>25% of reporting period) unscheduled shutdowns of the Active Remedial System.

☒ 3. The Active Remedial System or Active Remedial Monitoring Program operated in conformance with the MCP, and all applicable approval conditions and/or permits.

4. Indicate any Operational Problems or Notes:

☐ 5. Check here if additional/supporting Information, data, maps, and/or sketches are attached to the form.



Massachusetts Department of Environmental Protection
Bureau of Waste Site Cleanup

BWSC105 -B

IRA REMEDIAL MONITORING REPORT

MEASUREMENTS

Release Tracking Number

Pursuant to 310 CMR 40.0400 (SUBPART D)

4

26179

Remedial System or Monitoring Program:

1

of:

2

For each Point of Measurement, related to concentration indicate the highest concentration detected during the reporting period, of each oil, hazardous material and/or remedial additive.

For each Point of Measurement for pressure differentials, indicate the lowest pressure differential detected during the reporting period.

Point of Measurement	Date (mm/dd/yyyy)	Contaminant, Measurement and/or Indicator Parameter	Influent Concentration (where applicable)	Midpoint Concentration (where applicable)	(check one)	Check here, if ND/BDL	Permissible Concentration or Pressure Differential	Units	Within Permissible Limits? (Y/N)
					<input checked="" type="checkbox"/> Discharge <input type="checkbox"/> Ground Water Concentration <input type="checkbox"/> Pressure Differential				
SYSTEM	01/25/2022	PFAS	0.796	0.351		<input checked="" type="checkbox"/>	0.020	UG/L	YES

☐ Check here if any additional BWSC105 B, Measurements Form(s), are needed.



IRA REMEDIAL MONITORING REPORT

Pursuant to 310 CMR 40.0400 (SUBPART D)

Release Tracking Number

Remedial System or Monitoring Program: 2 of 2

4 - 26179

A. DESCRIPTION OF ACTIVE OPERATION AND MAINTENANCE ACTIVITY:

1. Type of Active Operation and Maintenance Activity: (check all that apply)

☒ a. Active Remedial System: (check all that apply)☐ i. NAPL Recovery☐ ii. Soil Vapor Extraction/Bioventing☐ iii. Vapor-phase Carbon Adsorption☒ iv. Groundwater Recovery☐ v. Dual/Multi-phase Extraction☒ vi. Aqueous-phase Carbon Adsorption☐ vii. Air Stripping☐ viii. Sparging/Biosparging☐ ix. Cat/Thermal Oxidation☐ x. Other Describe: _____☐ b. Active Exposure Pathway Elimination MeasureActive Exposure Pathway Mitigation System to address (check one): ☐ i. Indoor Air ☐ ii. Drinking Water☐ c. Application of Remedial Additives: (check all that apply)☐ i. To the Subsurface☐ ii. To Groundwater (Injection)☐ iii. To the Surface☐ d. Active Remedial Monitoring Program Without the Application of Remedial Additives: (check all that apply; Sections C, D and E are not required; attach supporting information, data, maps and/or sketches needed by checking Section G5)☐ i. Reactive Wall☐ ii. Natural Attenuation☐ iii. Other

Describe: _____

2. Mode of Operation: (check one)

☒ a. Continuous☐ b. Intermittent☐ c. Pulsed☐ d. One-time Event Only☐ e. Other: _____

3. System Effluent/Discharge: (check all that apply)

☐ a. Sanitary Sewer/POTW☒ b. Groundwater Re-infiltration/Re-injection: (check one)☐ i. Downgradient☒ ii. Upgradient☐ c. Vapor-phase Discharge to Ambient Air: (check one)☐ i. Off-gas Controls☐ ii. No Off-gas Controls☐ d. Drinking Water Supply☐ e. Surface Water (including Storm Drains)☐ f. Other Describe: _____**B. MONITORING FREQUENCY:**

1. Reporting period that is the subject of this submittal:

From: 1/1/2022

To: 1/31/2022

(mm/dd/yyyy)

(mm/dd/yyyy)

2. Number of monitoring events during the reporting period: (check one)

☐ a. System Startup: (if applicable)☐ i. Days 1, 3, 6, and then weekly thereafter, for the first month.☐ ii. Other Describe: _____☒ b. Post-system Startup (after first month) or Monitoring Program:☒ i. Monthly☐ ii. Quarterly☐ iii. Annually☐ iv. Other Describe: _____☒ 3. Check here to certify that the number of required monitoring events were conducted during the reporting period.**C. EFFLUENT/DISCHARGE REGULATION:** (check one to indicate how the effluent/discharge limits were established)☐ 1. NPDES: (check one)☐ a. Remediation General Permit☐ b. Individual Permit☐ c. Emergency Exclusion

Effective Date of Permit: _____

(mm/dd/yyyy)

☐ 2. MCP Performance Standard

MCP Citations(s): _____

☒ 3. DEP Approval Letter

Date of Letter: 11/16/2018

(mm/dd/yyyy)

☐ 4. Other Describe: _____



Massachusetts Department of Environmental Protection
Bureau of Waste Site Cleanup

IRA REMEDIAL MONITORING REPORT

Pursuant to 310 CMR 40.0400 (SUBPART D)

Remedial System or Monitoring Program: 2 of 2

BWSC105 -A

Release Tracking Number

4 - 26179

D. WASTEWATER TREATMENT PLANT OPERATOR: (check one)

☒ 1. Required due to Remedial Wastewater Treatment Plant in place for more than 30 days.

a. Name: TJMCGOFF

b. Grade: 4

c. License No: 15570

d. License Exp. Date: 12/31/2023

(mm/dd/yyyy)

☐ 2. Not Required

☐ 3. Not Applicable

E. STATUS OF ACTIVE REMEDIAL SYSTEM OR ACTIVE REMEDIAL MONITORING PROGRAM DURING REPORTING PERIOD: (check all that apply)

☒ 1. The Active Remedial System was functional one or more days during the Reporting Period.

a. Days System was Fully Functional: 29

b. GW Recovered (gals): 378868

c. NAPL Recovered (gals):

d. GW Discharged (gals): 378868

e. Avg. Soil Gas Recovery Rate (scfm):

f. Avg. Sparging Rate (scfm):

☐ 2. Remedial Additives: (check all that apply)

☐ a. No Remedial Additives applied during the Reporting Period.

☐ b. Enhanced Bioremediation Additives applied: (total quantity applied at the site for the current reporting period)

☐ i. Nitrogen/Phosphorus:

☐ ii. Peroxides:

Name of Additive	Date	Quantity	Units

Name of Additive	Date	Quantity	Units

☐ iii. Microorganisms:

☐ iv. Other:

Name of Additive	Date	Quantity	Units

Name of Additive	Date	Quantity	Units

☐ c. Chemical oxidation/reduction additives applied: (total quantity applied at the site for the current reporting period)

☐ i. Permanganates:

☐ ii. Peroxides:

Name of Additive	Date	Quantity	Units


Name of Additive	Date	Quantity	Units

☐ iii. Persulfates:

☐ iv. Other:

Name of Additive	Date	Quantity	Units

Name of Additive	Date	Quantity	Units



Massachusetts Department of Environmental Protection
Bureau of Waste Site Cleanup

BWSC105 -A

IRA REMEDIAL MONITORING REPORT

Pursuant to 310 CMR 40.0400 (SUBPART D)

Remedial System or Monitoring Program: of

Release Tracking Number

-

E. STATUS OF ACTIVE REMEDIAL SYSTEM OR ACTIVE REMEDIAL MONITORING PROGRAM DURING REPORTING PERIOD: (cont.)

☐ d. Other additives applied: (total quantity applied at the site for the current reporting period)

Name of Additive	Date	Quantity	Units	Name of Additive	Date	Quantity	Units

☐ e. Check here if any additional Remedial Additives were applied. Attach list of additional additives and include Name of Additive, Date Applied, Quantity Applied and Units (in gals. or lbs.)

F. SHUTDOWNS OF ACTIVE REMEDIAL SYSTEM OR ACTIVE REMEDIAL MONITORING PROGRAM: (check all that apply)

☒ 1. The Active Remedial System had unscheduled shutdowns on one or more occasions during the Reporting Period.

a. Number of Unscheduled Shutdowns: b. Total Number of Days of Unscheduled Shutdowns:

c. Reason(s) for Unscheduled Shutdowns: INCLEMENT WEATHER, POWER LOSS

☐ 2. The Active Remedial System had scheduled shutdowns on one or more occasions during the Reporting Period.

a. Number of Scheduled Shutdowns: b. Total Number of Days of Scheduled Shutdowns:

c. Reason(s) for Scheduled Shutdowns:

☐ 3. The Active Remedial System or Active Remedial Monitoring Program was permanently shutdown/discontinued during the Reporting Period.

a. Date of Final System or Monitoring Program Shutdown:
(mm/dd/yyyy)

☐ b. No Further Effluent Discharges.

☐ c. No Further Application of Remedial Additives planned; sufficient monitoring completed to demonstrate compliance with 310 CMR 40.0046.

☐ d. No Further Submittals Planned.

☐ e. Other: Describe:

G. SUMMARY STATEMENTS: (check all that apply for the current reporting period)

☒ 1. All Active Remedial System checks and effluent analyses required by the approved plan and/or permit were performed when applicable.

☒ 2. There were no significant problems or prolonged (>25% of reporting period) unscheduled shutdowns of the Active Remedial System.

☒ 3. The Active Remedial System or Active Remedial Monitoring Program operated in conformance with the MCP, and all applicable approval conditions and/or permits.

4. Indicate any Operational Problems or Notes:

INCLEMENT WEATHER ON JANUARY 29, 2022 CAUSED A POWER LOSS TO THE PROPERTY AND SYSTEM

☐ 5. Check here if additional/supporting Information, data, maps, and/or sketches are attached to the form.

**Massachusetts Department of Environmental Protection***Bureau of Waste Site Cleanup***IRA REMEDIAL MONITORING REPORT****MEASUREMENTS**

Pursuant to 310 CMR 40.0400 (SUBPART D)

Remedial System or Monitoring Program:

2

of:

2

BWSC105 -B

Release Tracking Number

4

26179

For each Point of Measurement, related to concentration indicate the highest concentration detected during the reporting period, of each oil, hazardous material and/or remedial additive.

For each Point of Measurement for pressure differentials, indicate the lowest pressure differential detected during the reporting period.

Point of Measurement	Date (mm/dd/yyyy)	Contaminant, Measurement and/or Indicator Parameter	Influent Concentration (where applicable)	Midpoint Concentration (where applicable)	(check one)	Check here, if ND/BDL	Permissible Concentration or Pressure Differential	Units	Within Permissible Limits? (Y/N)
					<input checked="" type="checkbox"/> Discharge <input type="checkbox"/> Ground Water Concentration <input type="checkbox"/> Pressure Differential				
SYSTEM	01/25/2022	PFAS	0.796	0.719	0.741	<input type="checkbox"/>	0.020	UG/L	YES

☐ Check here if any additional BWSC105 B, Measurements Form(s), are needed.

APPENDIX B

LABORATORY REPORTS/CERTIFICATES OF ANALYSIS



Your Project #: BFTA
Site#: 6206
Site Location: BARNSTABLE, MA
Your C.O.C. #: n/a

Attention: Mykel Mendes

Barnstable County
3195 Main Street
PO Box 427
Barnstable, MA
USA 02630

Report Date: 2022/02/08
Report #: R6995955
Version: 1 - Final

CERTIFICATE OF ANALYSIS

BUREAU VERITAS JOB #: C223621

Received: 2022/01/28, 12:49

Sample Matrix: Water
Samples Received: 16

Analyses	Quantity	Date	Date	Laboratory Method	Analytical Method
		Extracted	Analyzed		
PFAS in water by SPE/LCMS (1)	12	2022/02/03	2022/02/05	CAM SOP-00894	EPA 537 m
PFAS in water by SPE/LCMS (1)	2	2022/02/07	2022/02/07	CAM SOP-00894	EPA 537 m
PFAS in water by SPE/LCMS (1)	2	2022/02/07	2022/02/08	CAM SOP-00894	EPA 537 m

Remarks:

Bureau Veritas is accredited to ISO/IEC 17025 for specific parameters on scopes of accreditation. Unless otherwise noted, procedures used by Bureau Veritas are based upon recognized Provincial, Federal or US method compendia such as CCME, MELCC, EPA, APHA.

All work recorded herein has been done in accordance with procedures and practices ordinarily exercised by professionals in Bureau Veritas' profession using accepted testing methodologies, quality assurance and quality control procedures (except where otherwise agreed by the client and Bureau Veritas in writing). All data is in statistical control and has met quality control and method performance criteria unless otherwise noted. All method blanks are reported; unless indicated otherwise, associated sample data are not blank corrected. Where applicable, unless otherwise noted, Measurement Uncertainty has not been accounted for when stating conformity to the referenced standard.

Bureau Veritas liability is limited to the actual cost of the requested analyses, unless otherwise agreed in writing. There is no other warranty expressed or implied. Bureau Veritas has been retained to provide analysis of samples provided by the Client using the testing methodology referenced in this report. Interpretation and use of test results are the sole responsibility of the Client and are not within the scope of services provided by Bureau Veritas, unless otherwise agreed in writing. Bureau Veritas is not responsible for the accuracy or any data impacts, that result from the information provided by the customer or their agent.

Solid sample results, except biota, are based on dry weight unless otherwise indicated. Organic analyses are not recovery corrected except for isotope dilution methods.

Results relate to samples tested. When sampling is not conducted by Bureau Veritas, results relate to the supplied samples tested.

This Certificate shall not be reproduced except in full, without the written approval of the laboratory.

Reference Method suffix "m" indicates test methods incorporate validated modifications from specific reference methods to improve performance.

* RPDs calculated using raw data. The rounding of final results may result in the apparent difference.

(1) Per- and polyfluoroalkyl substances (PFAS) identified as surrogates on the certificate of analysis represent the extracted internal standard.



Your Project #: BFTA
Site#: 6206
Site Location: BARNSTABLE, MA
Your C.O.C. #: n/a

Attention: Mykel Mendes

Barnstable County
3195 Main Street
PO Box 427
Barnstable, MA
USA 02630

Report Date: 2022/02/08
Report #: R6995955
Version: 1 - Final

CERTIFICATE OF ANALYSIS

BUREAU VERITAS JOB #: C223621

Received: 2022/01/28, 12:49

Encryption Key

Please direct all questions regarding this Certificate of Analysis to your Project Manager.

Lori Dufour, Project Manager

Email: Lori.Dufour@bureauveritas.com

Phone# (905) 817-5700

=====

Bureau Veritas has procedures in place to guard against improper use of the electronic signature and have the required "signatories", as per ISO/IEC 17025, signing the reports.
For Service Group specific validation please refer to the Validation Signature Page.



Bureau Veritas Job #: C223621
Report Date: 2022/02/08

Barnstable County
Client Project #: BFTA
Site Location: BARNSTABLE, MA
Sampler Initials: MM

PERFLUOROALKYL SUBSTANCES (WATER)

Bureau Veritas ID		RSM903	RSM904	RSM905	RSM906	RSM907			
Sampling Date		2022/01/26 12:04	2022/01/26 10:00	2022/01/26 13:40	2022/01/26 01:04	2022/01/25 13:51			
COC Number		n/a	n/a	n/a	n/a	n/a			
	UNITS	PC-6A	PC-38	PC-28	PC-1	MW-22	RDL	MDL	QC Batch
Perfluorinated Compounds									
Perfluorobutanoic acid (PFBA)	ug/L	0.017	<0.0039	0.023	0.046	0.0068	0.020	0.0039	7815218
Perfluoropentanoic acid (PFPeA)	ug/L	0.049	<0.0067	0.065	0.20	0.027	0.020	0.0067	7815218
Perfluorohexanoic acid (PFHxA)	ug/L	0.050	<0.0053	0.065	0.16	0.046	0.020	0.0053	7815218
Perfluoroheptanoic acid (PFHpA)	ug/L	0.039	<0.0067	0.051	0.095	0.021	0.020	0.0067	7815218
Perfluorooctanoic acid (PFOA)	ug/L	0.029	<0.0050	0.026	0.066	0.094	0.020	0.0050	7815218
Perfluorononanoic acid (PFNA)	ug/L	0.041	<0.0051	0.028	0.031	0.0057	0.020	0.0051	7815218
Perfluorodecanoic acid (PFDA)	ug/L	0.010	<0.0039	0.0075	0.0075	<0.0039	0.020	0.0039	7815218
Perfluoroundecanoic acid (PFUnA)	ug/L	0.045	<0.0062	0.039	0.20	<0.0062	0.020	0.0062	7815218
Perfluorododecanoic acid (PFDoA)	ug/L	<0.0080	<0.0080	<0.0080	<0.0080	<0.0080	0.020	0.0080	7815218
Perfluorotridecanoic acid (PFTRDA)	ug/L	<0.0064	<0.0064	<0.0064	<0.0064	<0.0064	0.020	0.0064	7815218
Perfluorotetradecanoic acid (PFTEDA)	ug/L	<0.0068	<0.0068	<0.0068	<0.0068	<0.0068	0.020	0.0068	7815218
Perfluorobutanesulfonic acid (PFBS)	ug/L	<0.0056	<0.0056	0.0062	0.014	0.0069	0.020	0.0056	7815218
Perfluorohexanesulfonic acid (PFHxS)	ug/L	0.062	<0.0044	0.083	0.18	0.28	0.020	0.0044	7815218
Perfluoroheptanesulfonic acid PFHpS	ug/L	<0.0065	<0.0065	<0.0065	0.0076	<0.0065	0.020	0.0065	7815218
Perfluorooctanesulfonic acid (PFOS)	ug/L	0.76	<0.0057	0.67	0.63	0.43	0.020	0.0057	7815218
Perfluorodecanesulfonic acid (PFDS)	ug/L	<0.0064	<0.0064	<0.0064	<0.0064	<0.0064	0.020	0.0064	7815218
Perfluorooctane Sulfonamide (PFOSA)	ug/L	<0.0036	<0.0036	<0.0036	0.0038	0.011	0.020	0.0036	7815218
EtFOSA	ug/L	<0.0070	<0.0070	<0.0070	<0.0070	<0.0070	0.020	0.0070	7815218
MeFOSA	ug/L	<0.0078	<0.0078	<0.0078	<0.0078	<0.0078	0.020	0.0078	7815218
EtFOSE	ug/L	<0.0071	<0.0071	<0.0071	<0.0071	<0.0071	0.020	0.0071	7815218
MeFOSE	ug/L	<0.0070	<0.0070	<0.0070	<0.0070	<0.0070	0.020	0.0070	7815218
6:2 Fluorotelomer sulfonic acid	ug/L	0.013	0.0068	0.011	0.23	<0.0065	0.020	0.0065	7815218
8:2 Fluorotelomer sulfonic acid	ug/L	<0.0067	<0.0067	<0.0067	0.097	<0.0067	0.020	0.0067	7815218
Surrogate Recovery (%)									
13C2-6:2-Fluorotelomersulfonic Acid	%	111	103	110	102	103	N/A	N/A	7815218
13C2-8:2-Fluorotelomersulfonic Acid	%	107	105	99	102	100	N/A	N/A	7815218
13C2-Perfluorodecanoic acid	%	111	104	103	110	101	N/A	N/A	7815218
13C2-Perfluorododecanoic acid	%	97	96	93	97	92	N/A	N/A	7815218
13C2-Perfluorohexanoic acid	%	116	109	114	112	107	N/A	N/A	7815218
13C2-perfluorotetradecanoic acid	%	75	84	71	79	80	N/A	N/A	7815218
13C2-Perfluoroundecanoic acid	%	107	99	95	104	97	N/A	N/A	7815218
13C3-Perfluorobutanesulfonic acid	%	113	105	113	107	103	N/A	N/A	7815218
13C4-Perfluorobutanoic acid	%	114	105	112	105	102	N/A	N/A	7815218
RDL = Reportable Detection Limit QC Batch = Quality Control Batch N/A = Not Applicable									



**BUREAU
VERITAS**

Bureau Veritas Job #: C223621

Report Date: 2022/02/08

Barnstable County

Client Project #: BFTA

Site Location: BARNSTABLE, MA

Sampler Initials: MM

PERFLUOROALKYL SUBSTANCES (WATER)

Bureau Veritas ID		RSM903	RSM904	RSM905	RSM906	RSM907			
Sampling Date		2022/01/26 12:04	2022/01/26 10:00	2022/01/26 13:40	2022/01/26 01:04	2022/01/25 13:51			
COC Number		n/a	n/a	n/a	n/a	n/a			
	UNITS	PC-6A	PC-38	PC-28	PC-1	MW-22	RDL	MDL	QC Batch
13C4-Perfluoroheptanoic acid	%	117	107	112	109	106	N/A	N/A	7815218
13C4-Perfluorooctanesulfonic acid	%	107	104	110	111	104	N/A	N/A	7815218
13C4-Perfluorooctanoic acid	%	116	107	112	111	104	N/A	N/A	7815218
13C5-Perfluorononanoic acid	%	112	104	105	108	101	N/A	N/A	7815218
13C5-Perfluoropentanoic acid	%	115	107	113	108	103	N/A	N/A	7815218
13C8-Perfluorooctane Sulfonamide	%	100	90	75	92	88	N/A	N/A	7815218
18O2-Perfluorohexanesulfonic acid	%	113	107	113	107	104	N/A	N/A	7815218
D3-MeFOSA	%	83	79	69	66	67	N/A	N/A	7815218
D5-EtFOSA	%	81	85	65	66	67	N/A	N/A	7815218
D7-MeFOSE	%	95	84	71	88	81	N/A	N/A	7815218
D9-EtFOSE	%	92	85	70	88	83	N/A	N/A	7815218
RDL = Reportable Detection Limit QC Batch = Quality Control Batch N/A = Not Applicable									



Bureau Veritas Job #: C223621
Report Date: 2022/02/08

Barnstable County
Client Project #: BFTA
Site Location: BARNSTABLE, MA
Sampler Initials: MM

PERFLUOROALKYL SUBSTANCES (WATER)

Bureau Veritas ID		RSM908			RSM909	RSM910			
Sampling Date		2022/01/25 14:22			2022/01/25 12:38	2022/01/25 12:33			
COC Number		n/a			n/a	n/a			
	UNITS	RINSATE 1	RDL	MDL	DUPLICATE	PFW-1	RDL	MDL	QC Batch
Perfluorinated Compounds									
Perfluorobutanoic acid (PFBA)	ug/L	<0.0039	0.020	0.0039	0.24	0.24	0.020	0.0039	7815218
Perfluoropentanoic acid (PFPeA)	ug/L	<0.0067	0.020	0.0067	0.94	0.96	0.020	0.0067	7815218
Perfluorohexanoic acid (PFHxA)	ug/L	<0.0053	0.020	0.0053	0.73	0.72	0.020	0.0053	7815218
Perfluoroheptanoic acid (PFHpA)	ug/L	<0.0067	0.020	0.0067	0.40	0.39	0.020	0.0067	7815218
Perfluorooctanoic acid (PFOA)	ug/L	<0.0050	0.020	0.0050	0.27	0.27	0.020	0.0050	7815218
Perfluorononanoic acid (PFNA)	ug/L	<0.0051	0.020	0.0051	0.12	0.12	0.020	0.0051	7815218
Perfluorodecanoic acid (PFDA)	ug/L	<0.0039	0.020	0.0039	0.038	0.036	0.020	0.0039	7815218
Perfluoroundecanoic acid (PFUnA)	ug/L	<0.0062	0.020	0.0062	0.23	0.29	0.020	0.0062	7815218
Perfluorododecanoic acid (PFDoA)	ug/L	<0.0080	0.020	0.0080	<0.0080	<0.0080	0.020	0.0080	7815218
Perfluorotridecanoic acid (PFTRDA)	ug/L	<0.0064	0.020	0.0064	<0.0064	<0.0064	0.020	0.0064	7815218
Perfluorotetradecanoic acid (PFTEDA)	ug/L	<0.0068	0.020	0.0068	<0.0068	<0.0068	0.020	0.0068	7815218
Perfluorobutanesulfonic acid (PFBS)	ug/L	<0.0056	0.020	0.0056	0.079	0.074	0.020	0.0056	7815218
Perfluorohexanesulfonic acid (PFHxS)	ug/L	<0.0044	0.020	0.0044	1.1	1.0	0.20	0.044	7815218
Perfluoroheptanesulfonic acid (PFHpS)	ug/L	<0.0065	0.020	0.0065	0.031	0.030	0.020	0.0065	7815218
Perfluorooctanesulfonic acid (PFOS)	ug/L	<0.0057	0.020	0.0057	4.8	4.4	0.20	0.057	7815218
Perfluorodecanesulfonic acid (PFDS)	ug/L	<0.0064	0.020	0.0064	<0.0064	<0.0064	0.020	0.0064	7815218
Perfluorooctane Sulfonamide (PFOSA)	ug/L	<0.0036	0.020	0.0036	0.0066	0.0077	0.020	0.0036	7815218
EtFOSA	ug/L	<0.0070	0.020	0.0070	<0.0070	<0.0070	0.020	0.0070	7815218
MeFOSA	ug/L	<0.0078	0.020	0.0078	<0.0078	<0.0078	0.020	0.0078	7815218
EtFOSE	ug/L	<0.0071	0.020	0.0071	<0.0071	<0.0071	0.020	0.0071	7815218
MeFOSE	ug/L	<0.0070	0.020	0.0070	<0.0070	<0.0070	0.020	0.0070	7815218
6:2 Fluorotelomer sulfonic acid	ug/L	<0.0065	0.020	0.0065	1.3	1.2	0.20	0.065	7815218
8:2 Fluorotelomer sulfonic acid	ug/L	<0.0067	0.020	0.0067	0.76	0.72	0.020	0.0067	7815218
Surrogate Recovery (%)									
13C2-6:2-Fluorotelomersulfonic Acid	%	111	N/A	N/A	104	108	N/A	N/A	7815218
13C2-8:2-Fluorotelomersulfonic Acid	%	103	N/A	N/A	80	73	N/A	N/A	7815218
13C2-Perfluorodecanoic acid	%	105	N/A	N/A	84	81	N/A	N/A	7815218
13C2-Perfluorododecanoic acid	%	97	N/A	N/A	74	71	N/A	N/A	7815218
13C2-Perfluorohexanoic acid	%	112	N/A	N/A	95	86	N/A	N/A	7815218
13C2-perfluorotetradecanoic acid	%	90	N/A	N/A	75	64	N/A	N/A	7815218
13C2-Perfluoroundecanoic acid	%	101	N/A	N/A	76	73	N/A	N/A	7815218
13C3-Perfluorobutanesulfonic acid	%	108	N/A	N/A	92	85	N/A	N/A	7815218
13C4-Perfluorobutanoic acid	%	110	N/A	N/A	93	85	N/A	N/A	7815218
RDL = Reportable Detection Limit QC Batch = Quality Control Batch N/A = Not Applicable									



Bureau Veritas Job #: C223621
Report Date: 2022/02/08

Barnstable County
Client Project #: BFTA
Site Location: BARNSTABLE, MA
Sampler Initials: MM

PERFLUOROALKYL SUBSTANCES (WATER)

Bureau Veritas ID		RSM908			RSM909	RSM910			
Sampling Date		2022/01/25 14:22			2022/01/25 12:38	2022/01/25 12:33			
COC Number		n/a			n/a	n/a			
	UNITS	RINSATE 1	RDL	MDL	DUPLICATE	PFW-1	RDL	MDL	QC Batch
13C4-Perfluoroheptanoic acid	%	111	N/A	N/A	94	87	N/A	N/A	7815218
13C4-Perfluorooctanesulfonic acid	%	106	N/A	N/A	101	102	N/A	N/A	7815218
13C4-Perfluorooctanoic acid	%	110	N/A	N/A	94	86	N/A	N/A	7815218
13C5-Perfluorononanoic acid	%	107	N/A	N/A	90	82	N/A	N/A	7815218
13C5-Perfluoropentanoic acid	%	110	N/A	N/A	93	83	N/A	N/A	7815218
13C8-Perfluorooctane Sulfonamide	%	92	N/A	N/A	75	74	N/A	N/A	7815218
18O2-Perfluorohexanesulfonic acid	%	107	N/A	N/A	105	107	N/A	N/A	7815218
D3-MeFOSA	%	84	N/A	N/A	72	65	N/A	N/A	7815218
D5-EtFOSA	%	85	N/A	N/A	73	63	N/A	N/A	7815218
D7-MeFOSE	%	88	N/A	N/A	73	71	N/A	N/A	7815218
D9-EtFOSE	%	86	N/A	N/A	75	67	N/A	N/A	7815218
RDL = Reportable Detection Limit QC Batch = Quality Control Batch N/A = Not Applicable									



Bureau Veritas Job #: C223621
Report Date: 2022/02/08

Barnstable County
Client Project #: BFTA
Site Location: BARNSTABLE, MA
Sampler Initials: MM

PERFLUOROALKYL SUBSTANCES (WATER)

Bureau Veritas ID		RSM911			RSM912			RSM913			
Sampling Date		2022/01/25 11:36			2022/01/25 13:00			2022/01/25 10:30			
COC Number		n/a			n/a			n/a			
	UNITS	PFW-5	RDL	MDL	HSW-6	RDL	MDL	OW-8A	RDL	MDL	QC Batch
Perfluorinated Compounds											
Perfluorobutanoic acid (PFBA)	ug/L	0.17	0.020	0.0039	0.16	0.020	0.0039	0.0048	0.020	0.0039	7815218
Perfluoropentanoic acid (PFPeA)	ug/L	0.54	0.020	0.0067	0.69	0.020	0.0067	0.021	0.020	0.0067	7815218
Perfluorohexanoic acid (PFHxA)	ug/L	0.54	0.020	0.0053	0.58	0.020	0.0053	0.018	0.020	0.0053	7815218
Perfluoroheptanoic acid (PFHpA)	ug/L	0.24	0.020	0.0067	0.16	0.020	0.0067	0.012	0.020	0.0067	7815218
Perfluorooctanoic acid (PFOA)	ug/L	0.15	0.020	0.0050	0.17	0.020	0.0050	0.011	0.020	0.0050	7815218
Perfluorononanoic acid (PFNA)	ug/L	0.0086	0.020	0.0051	0.046	0.020	0.0051	<0.0051	0.020	0.0051	7815218
Perfluorodecanoic acid (PFDA)	ug/L	0.0054	0.020	0.0039	0.0067	0.020	0.0039	<0.0039	0.020	0.0039	7815218
Perfluoroundecanoic acid (PFUnA)	ug/L	0.019	0.020	0.0062	0.051	0.020	0.0062	<0.0062	0.020	0.0062	7815218
Perfluorododecanoic acid (PFDoA)	ug/L	<0.0080	0.020	0.0080	<0.0080	0.020	0.0080	<0.0080	0.020	0.0080	7815218
Perfluorotridecanoic acid (PFTRDA)	ug/L	<0.0064	0.020	0.0064	<0.0064	0.020	0.0064	<0.0064	0.020	0.0064	7815218
Perfluorotetradecanoic acid (PFTEDA)	ug/L	<0.0068	0.020	0.0068	<0.0068	0.020	0.0068	<0.0068	0.020	0.0068	7815218
Perfluorobutanesulfonic acid (PFBS)	ug/L	0.10	0.020	0.0056	0.046	0.020	0.0056	<0.0056	0.020	0.0056	7815218
Perfluorohexanesulfonic acid (PFHxS)	ug/L	1.3	0.20	0.044	0.41	0.020	0.0044	0.039	0.020	0.0044	7815218
Perfluoroheptanesulfonic acid PFHpS	ug/L	<0.0065	0.020	0.0065	0.0091	0.020	0.0065	<0.0065	0.020	0.0065	7815218
Perfluorooctanesulfonic acid (PFOS)	ug/L	0.37	0.020	0.0057	1.6	0.20	0.057	0.12	0.020	0.0057	7815218
Perfluorodecanesulfonic acid (PFDS)	ug/L	<0.0064	0.020	0.0064	<0.0064	0.020	0.0064	<0.0064	0.020	0.0064	7815218
Perfluorooctane Sulfonamide (PFOSA)	ug/L	0.030	0.020	0.0036	<0.0036	0.020	0.0036	<0.0036	0.020	0.0036	7815218
EtFOSA	ug/L	<0.0070	0.020	0.0070	<0.0070	0.020	0.0070	<0.0070	0.020	0.0070	7815218
MeFOSA	ug/L	<0.0078	0.020	0.0078	<0.0078	0.020	0.0078	<0.0078	0.020	0.0078	7815218
EtFOSE	ug/L	<0.0071	0.020	0.0071	<0.0071	0.020	0.0071	<0.0071	0.020	0.0071	7815218
MeFOSE	ug/L	<0.0070	0.020	0.0070	<0.0070	0.020	0.0070	<0.0070	0.020	0.0070	7815218
6:2 Fluorotelomer sulfonic acid	ug/L	0.091	0.020	0.0065	0.88	0.020	0.0065	0.011	0.020	0.0065	7815218
8:2 Fluorotelomer sulfonic acid	ug/L	0.033	0.020	0.0067	0.090	0.020	0.0067	<0.0067	0.020	0.0067	7815218
Surrogate Recovery (%)											
13C2-6:2-Fluorotelomersulfonic Acid	%	100	N/A	N/A	94	N/A	N/A	124	N/A	N/A	7815218
13C2-8:2-Fluorotelomersulfonic Acid	%	97	N/A	N/A	93	N/A	N/A	107	N/A	N/A	7815218
13C2-Perfluorodecanoic acid	%	100	N/A	N/A	98	N/A	N/A	114	N/A	N/A	7815218
13C2-Perfluorododecanoic acid	%	93	N/A	N/A	91	N/A	N/A	100	N/A	N/A	7815218
13C2-Perfluorohexanoic acid	%	108	N/A	N/A	104	N/A	N/A	130	N/A	N/A	7815218
13C2-perfluorotetradecanoic acid	%	70	N/A	N/A	90	N/A	N/A	88	N/A	N/A	7815218
13C2-Perfluoroundecanoic acid	%	95	N/A	N/A	90	N/A	N/A	101	N/A	N/A	7815218
13C3-Perfluorobutanesulfonic acid	%	106	N/A	N/A	103	N/A	N/A	126	N/A	N/A	7815218
13C4-Perfluorobutanoic acid	%	102	N/A	N/A	100	N/A	N/A	127	N/A	N/A	7815218
RDL = Reportable Detection Limit											
QC Batch = Quality Control Batch											
N/A = Not Applicable											



BUREAU
VERITAS

Bureau Veritas Job #: C223621

Report Date: 2022/02/08

Barnstable County

Client Project #: BFTA

Site Location: BARNSTABLE, MA

Sampler Initials: MM

PERFLUOROALKYL SUBSTANCES (WATER)

Bureau Veritas ID		RSM911			RSM912			RSM913			
Sampling Date		2022/01/25 11:36			2022/01/25 13:00			2022/01/25 10:30			
COC Number		n/a			n/a			n/a			
	UNITS	PFW-5	RDL	MDL	HSW-6	RDL	MDL	OW-8A	RDL	MDL	QC Batch
13C4-Perfluoroheptanoic acid	%	108	N/A	N/A	105	N/A	N/A	128	N/A	N/A	7815218
13C4-Perfluorooctanesulfonic acid	%	104	N/A	N/A	104	N/A	N/A	115	N/A	N/A	7815218
13C4-Perfluorooctanoic acid	%	107	N/A	N/A	104	N/A	N/A	126	N/A	N/A	7815218
13C5-Perfluorononanoic acid	%	104	N/A	N/A	100	N/A	N/A	119	N/A	N/A	7815218
13C5-Perfluoropentanoic acid	%	104	N/A	N/A	102	N/A	N/A	127	N/A	N/A	7815218
13C8-Perfluorooctane Sulfonamide	%	92	N/A	N/A	91	N/A	N/A	102	N/A	N/A	7815218
18O2-Perfluorohexanesulfonic acid	%	106	N/A	N/A	101	N/A	N/A	124	N/A	N/A	7815218
D3-MeFOSA	%	75	N/A	N/A	81	N/A	N/A	87	N/A	N/A	7815218
D5-EtFOSA	%	76	N/A	N/A	80	N/A	N/A	89	N/A	N/A	7815218
D7-MeFOSE	%	89	N/A	N/A	85	N/A	N/A	95	N/A	N/A	7815218
D9-EtFOSE	%	85	N/A	N/A	78	N/A	N/A	98	N/A	N/A	7815218
RDL = Reportable Detection Limit QC Batch = Quality Control Batch N/A = Not Applicable											



PERFLUOROALKYL SUBSTANCES (WATER)

Bureau Veritas ID		RSM914				RSM941			
Sampling Date		2022/01/25 14:25				2022/01/26 14:05			
COC Number		n/a				n/a			
	UNITS	MW-12S	RDL	MDL	QC Batch	RINSATE 2	RDL	MDL	QC Batch
Perfluorinated Compounds									
Perfluorobutanoic acid (PFBA)	ug/L	0.032	0.020	0.0039	7815218	<0.0039	0.020	0.0039	7819567
Perfluoropentanoic acid (PFPeA)	ug/L	0.10	0.020	0.0067	7815218	<0.0067	0.020	0.0067	7819567
Perfluorohexanoic acid (PFHxA)	ug/L	0.11	0.020	0.0053	7815218	<0.0053	0.020	0.0053	7819567
Perfluoroheptanoic acid (PFHpA)	ug/L	0.063	0.020	0.0067	7815218	<0.0067	0.020	0.0067	7819567
Perfluorooctanoic acid (PFOA)	ug/L	0.10	0.020	0.0050	7815218	<0.0050	0.020	0.0050	7819567
Perfluorononanoic acid (PFNA)	ug/L	0.027	0.020	0.0051	7815218	<0.0051	0.020	0.0051	7819567
Perfluorodecanoic acid (PFDA)	ug/L	0.0047	0.020	0.0039	7815218	<0.0039	0.020	0.0039	7819567
Perfluoroundecanoic acid (PFUnA)	ug/L	0.016	0.020	0.0062	7815218	<0.0062	0.020	0.0062	7819567
Perfluorododecanoic acid (PFDoA)	ug/L	<0.0080	0.020	0.0080	7815218	<0.0080	0.020	0.0080	7819567
Perfluorotridecanoic acid (PFTrDA)	ug/L	<0.0064	0.020	0.0064	7815218	<0.0064	0.020	0.0064	7819567
Perfluorotetradecanoic acid (PFTEDA)	ug/L	<0.0068	0.020	0.0068	7815218	<0.0068	0.020	0.0068	7819567
Perfluorobutanesulfonic acid (PFBS)	ug/L	0.013	0.020	0.0056	7815218	<0.0056	0.020	0.0056	7819567
Perfluorohexanesulfonic acid (PFHxS)	ug/L	0.39	0.020	0.0044	7815218	<0.0044	0.020	0.0044	7819567
Perfluoroheptanesulfonic acid (PFHpS)	ug/L	0.010	0.020	0.0065	7815218	<0.0065	0.020	0.0065	7819567
Perfluorooctanesulfonic acid (PFOS)	ug/L	0.95	0.20	0.057	7815218	<0.0057	0.020	0.0057	7819567
Perfluorodecanesulfonic acid (PFDS)	ug/L	<0.0064	0.020	0.0064	7815218	<0.0064	0.020	0.0064	7819567
Perfluorooctane Sulfonamide (PFOSA)	ug/L	0.19	0.020	0.0036	7815218	<0.0036	0.020	0.0036	7819567
EtFOSA	ug/L	<0.0070	0.020	0.0070	7815218	<0.0070	0.020	0.0070	7819567
MeFOSA	ug/L	<0.0078	0.020	0.0078	7815218	<0.0078	0.020	0.0078	7819567
EtFOSE	ug/L	<0.0071	0.020	0.0071	7815218	<0.0071	0.020	0.0071	7819567
MeFOSE	ug/L	<0.0070	0.020	0.0070	7815218	<0.0070	0.020	0.0070	7819567
6:2 Fluorotelomer sulfonic acid	ug/L	0.022	0.020	0.0065	7815218	<0.0065	0.020	0.0065	7819567
8:2 Fluorotelomer sulfonic acid	ug/L	<0.0067	0.020	0.0067	7815218	<0.0067	0.020	0.0067	7819567
Surrogate Recovery (%)									
13C2-6:2-Fluorotelomersulfonic Acid	%	92	N/A	N/A	7815218	101	N/A	N/A	7819567
13C2-8:2-Fluorotelomersulfonic Acid	%	89	N/A	N/A	7815218	97	N/A	N/A	7819567
13C2-Perfluorodecanoic acid	%	85	N/A	N/A	7815218	95	N/A	N/A	7819567
13C2-Perfluorododecanoic acid	%	55	N/A	N/A	7815218	86	N/A	N/A	7819567
13C2-Perfluorohexanoic acid	%	97	N/A	N/A	7815218	98	N/A	N/A	7819567
13C2-perfluorotetradecanoic acid	%	22 (1)	N/A	N/A	7815218	75	N/A	N/A	7819567
13C2-Perfluoroundecanoic acid	%	73	N/A	N/A	7815218	95	N/A	N/A	7819567
RDL = Reportable Detection Limit QC Batch = Quality Control Batch N/A = Not Applicable (1) Extracted internal standard analyte recovery was below the defined lower control limit (LCL) which may result in increased variability of the associated native analyte result (PFTEDA, PFTrDA).									



Bureau Veritas Job #: C223621
Report Date: 2022/02/08

Barnstable County
Client Project #: BFTA
Site Location: BARNSTABLE, MA
Sampler Initials: MM

PERFLUOROALKYL SUBSTANCES (WATER)

Bureau Veritas ID		RSM914				RSM941			
Sampling Date		2022/01/25 14:25				2022/01/26 14:05			
COC Number		n/a				n/a			
	UNITS	MW-12S	RDL	MDL	QC Batch	RINSATE 2	RDL	MDL	QC Batch
13C3-Perfluorobutanesulfonic acid	%	93	N/A	N/A	7815218	94	N/A	N/A	7819567
13C4-Perfluorobutanoic acid	%	92	N/A	N/A	7815218	94	N/A	N/A	7819567
13C4-Perfluoroheptanoic acid	%	96	N/A	N/A	7815218	98	N/A	N/A	7819567
13C4-Perfluorooctanesulfonic acid	%	101	N/A	N/A	7815218	92	N/A	N/A	7819567
13C4-Perfluorooctanoic acid	%	95	N/A	N/A	7815218	98	N/A	N/A	7819567
13C5-Perfluorononanoic acid	%	91	N/A	N/A	7815218	100	N/A	N/A	7819567
13C5-Perfluoropentanoic acid	%	94	N/A	N/A	7815218	97	N/A	N/A	7819567
13C8-Perfluorooctane Sulfonamide	%	80	N/A	N/A	7815218	82	N/A	N/A	7819567
18O2-Perfluorohexanesulfonic acid	%	95	N/A	N/A	7815218	89	N/A	N/A	7819567
D3-MeFOSA	%	73	N/A	N/A	7815218	65	N/A	N/A	7819567
D5-EtFOSA	%	74	N/A	N/A	7815218	69	N/A	N/A	7819567
D7-MeFOSE	%	77	N/A	N/A	7815218	71	N/A	N/A	7819567
D9-EtFOSE	%	75	N/A	N/A	7815218	75	N/A	N/A	7819567
RDL = Reportable Detection Limit QC Batch = Quality Control Batch N/A = Not Applicable									



Bureau Veritas Job #: C223621
Report Date: 2022/02/08

Barnstable County
Client Project #: BFTA
Site Location: BARNSTABLE, MA
Sampler Initials: MM

PERFLUOROALKYL SUBSTANCES (WATER)

Bureau Veritas ID		RSM942			RSM943	RSM944			
Sampling Date		2022/01/26 11:07			2022/01/26 12:20	2022/01/26 10:30			
COC Number		n/a			n/a	n/a			
	UNITS	PC-11	RDL	MDL	PC-30	PC-16D	RDL	MDL	QC Batch
Perfluorinated Compounds									
Perfluorobutanoic acid (PFBA)	ug/L	0.030	0.020	0.0039	0.017	0.018	0.020	0.0039	7819567
Perfluoropentanoic acid (PFPeA)	ug/L	0.11	0.020	0.0067	0.045	0.045	0.020	0.0067	7819567
Perfluorohexanoic acid (PFHxA)	ug/L	0.12	0.020	0.0053	0.054	0.034	0.020	0.0053	7819567
Perfluoroheptanoic acid (PFHpA)	ug/L	0.060	0.020	0.0067	0.035	0.025	0.020	0.0067	7819567
Perfluorooctanoic acid (PFOA)	ug/L	0.040	0.020	0.0050	0.025	0.018	0.020	0.0050	7819567
Perfluorononanoic acid (PFNA)	ug/L	0.063	0.020	0.0051	0.034	0.026	0.020	0.0051	7819567
Perfluorodecanoic acid (PFDA)	ug/L	0.018	0.020	0.0039	0.0064	<0.0039	0.020	0.0039	7819567
Perfluoroundecanoic acid (PFUnA)	ug/L	0.12	0.020	0.0062	0.017	<0.0062	0.020	0.0062	7819567
Perfluorododecanoic acid (PFDoA)	ug/L	<0.0080	0.020	0.0080	<0.0080	<0.0080	0.020	0.0080	7819567
Perfluorotridecanoic acid (PFTrDA)	ug/L	<0.0064	0.020	0.0064	<0.0064	<0.0064	0.020	0.0064	7819567
Perfluorotetradecanoic acid (PFTEDA)	ug/L	<0.0068	0.020	0.0068	<0.0068	<0.0068	0.020	0.0068	7819567
Perfluorobutanesulfonic acid (PFBS)	ug/L	0.011	0.020	0.0056	<0.0056	<0.0056	0.020	0.0056	7819567
Perfluorohexanesulfonic acid (PFHxS)	ug/L	0.16	0.020	0.0044	0.072	0.055	0.020	0.0044	7819567
Perfluoroheptanesulfonic acid (PFHpS)	ug/L	<0.0065	0.020	0.0065	<0.0065	<0.0065	0.020	0.0065	7819567
Perfluorooctanesulfonic acid (PFOS)	ug/L	1.9	0.20	0.057	0.48	0.30	0.020	0.0057	7819567
Perfluorodecanesulfonic acid (PFDS)	ug/L	<0.0064	0.020	0.0064	<0.0064	<0.0064	0.020	0.0064	7819567
Perfluorooctane Sulfonamide (PFOSA)	ug/L	0.0062	0.020	0.0036	<0.0036	<0.0036	0.020	0.0036	7819567
EtFOSA	ug/L	<0.0070	0.020	0.0070	<0.0070	<0.0070	0.020	0.0070	7819567
MeFOSA	ug/L	<0.0078	0.020	0.0078	<0.0078	<0.0078	0.020	0.0078	7819567
EtFOSE	ug/L	<0.0071	0.020	0.0071	<0.0071	<0.0071	0.020	0.0071	7819567
MeFOSE	ug/L	<0.0070	0.020	0.0070	<0.0070	<0.0070	0.020	0.0070	7819567
6:2 Fluorotelomer sulfonic acid	ug/L	0.090	0.020	0.0065	0.013	0.0096	0.020	0.0065	7819567
8:2 Fluorotelomer sulfonic acid	ug/L	0.17	0.020	0.0067	<0.0067	<0.0067	0.020	0.0067	7819567
Surrogate Recovery (%)									
13C2-6:2-Fluorotelomersulfonic Acid	%	103	N/A	N/A	97	99	N/A	N/A	7819567
13C2-8:2-Fluorotelomersulfonic Acid	%	92	N/A	N/A	79	81	N/A	N/A	7819567
13C2-Perfluorodecanoic acid	%	97	N/A	N/A	85	85	N/A	N/A	7819567
13C2-Perfluorododecanoic acid	%	88	N/A	N/A	79	78	N/A	N/A	7819567
13C2-Perfluorohexanoic acid	%	100	N/A	N/A	94	97	N/A	N/A	7819567
13C2-perfluorotetradecanoic acid	%	74	N/A	N/A	57	34 (1)	N/A	N/A	7819567
RDL = Reportable Detection Limit									
QC Batch = Quality Control Batch									
N/A = Not Applicable									
(1) Extracted internal standard analyte recovery was below the defined lower control limit (LCL). Laboratory spiked water resulted in satisfactory recovery of the extracted internal standard analyte. When considered together, these QC data suggest that matrix interferences may be increasing the variability of the associated native analyte result (PFTEDA, PFTrDA).									



Bureau Veritas Job #: C223621
Report Date: 2022/02/08

Barnstable County
Client Project #: BFTA
Site Location: BARNSTABLE, MA
Sampler Initials: MM

PERFLUOROALKYL SUBSTANCES (WATER)

Bureau Veritas ID		RSM942			RSM943	RSM944			
Sampling Date		2022/01/26 11:07			2022/01/26 12:20	2022/01/26 10:30			
COC Number		n/a			n/a	n/a			
	UNITS	PC-11	RDL	MDL	PC-30	PC-16D	RDL	MDL	QC Batch
13C2-Perfluoroundecanoic acid	%	91	N/A	N/A	81	81	N/A	N/A	7819567
13C3-Perfluorobutanesulfonic acid	%	93	N/A	N/A	91	90	N/A	N/A	7819567
13C4-Perfluorobutanoic acid	%	95	N/A	N/A	90	89	N/A	N/A	7819567
13C4-Perfluoroheptanoic acid	%	100	N/A	N/A	93	96	N/A	N/A	7819567
13C4-Perfluorooctanesulfonic acid	%	91	N/A	N/A	82	80	N/A	N/A	7819567
13C4-Perfluorooctanoic acid	%	101	N/A	N/A	93	95	N/A	N/A	7819567
13C5-Perfluorononanoic acid	%	99	N/A	N/A	89	89	N/A	N/A	7819567
13C5-Perfluoropentanoic acid	%	98	N/A	N/A	91	93	N/A	N/A	7819567
13C8-Perfluorooctane Sulfonamide	%	88	N/A	N/A	78	79	N/A	N/A	7819567
18O2-Perfluorohexanesulfonic acid	%	92	N/A	N/A	89	89	N/A	N/A	7819567
D3-MeFOSA	%	70	N/A	N/A	65	65	N/A	N/A	7819567
D5-EtFOSA	%	77	N/A	N/A	67	64	N/A	N/A	7819567
D7-MeFOSE	%	79	N/A	N/A	72	70	N/A	N/A	7819567
D9-EtFOSE	%	77	N/A	N/A	72	73	N/A	N/A	7819567
RDL = Reportable Detection Limit QC Batch = Quality Control Batch N/A = Not Applicable									



Bureau Veritas Job #: C223621
Report Date: 2022/02/08

Barnstable County
Client Project #: BFTA
Site Location: BARNSTABLE, MA
Sampler Initials: MM

TEST SUMMARY

Bureau Veritas ID: RSM903
Sample ID: PC-6A
Matrix: Water

Collected: 2022/01/26
Shipped:
Received: 2022/01/28

Test Description	Instrumentation	Batch	Extracted	Date Analyzed	Analyst
PFAS in water by SPE/LCMS	LCMS	7815218	2022/02/03	2022/02/05	Xinhe Xing (Helena)

Bureau Veritas ID: RSM904
Sample ID: PC-38
Matrix: Water

Collected: 2022/01/26
Shipped:
Received: 2022/01/28

Test Description	Instrumentation	Batch	Extracted	Date Analyzed	Analyst
PFAS in water by SPE/LCMS	LCMS	7815218	2022/02/03	2022/02/05	Xinhe Xing (Helena)

Bureau Veritas ID: RSM905
Sample ID: PC-28
Matrix: Water

Collected: 2022/01/26
Shipped:
Received: 2022/01/28

Test Description	Instrumentation	Batch	Extracted	Date Analyzed	Analyst
PFAS in water by SPE/LCMS	LCMS	7815218	2022/02/03	2022/02/05	Xinhe Xing (Helena)

Bureau Veritas ID: RSM906
Sample ID: PC-1
Matrix: Water

Collected: 2022/01/26
Shipped:
Received: 2022/01/28

Test Description	Instrumentation	Batch	Extracted	Date Analyzed	Analyst
PFAS in water by SPE/LCMS	LCMS	7815218	2022/02/03	2022/02/05	Xinhe Xing (Helena)

Bureau Veritas ID: RSM907
Sample ID: MW-22
Matrix: Water

Collected: 2022/01/25
Shipped:
Received: 2022/01/28

Test Description	Instrumentation	Batch	Extracted	Date Analyzed	Analyst
PFAS in water by SPE/LCMS	LCMS	7815218	2022/02/03	2022/02/05	Xinhe Xing (Helena)

Bureau Veritas ID: RSM908
Sample ID: RINSATE 1
Matrix: Water

Collected: 2022/01/25
Shipped:
Received: 2022/01/28

Test Description	Instrumentation	Batch	Extracted	Date Analyzed	Analyst
PFAS in water by SPE/LCMS	LCMS	7815218	2022/02/03	2022/02/05	Xinhe Xing (Helena)

Bureau Veritas ID: RSM909
Sample ID: DUPLICATE
Matrix: Water

Collected: 2022/01/25
Shipped:
Received: 2022/01/28

Test Description	Instrumentation	Batch	Extracted	Date Analyzed	Analyst
PFAS in water by SPE/LCMS	LCMS	7815218	2022/02/03	2022/02/05	Xinhe Xing (Helena)



Bureau Veritas Job #: C223621
Report Date: 2022/02/08

Barnstable County
Client Project #: BFTA
Site Location: BARNSTABLE, MA
Sampler Initials: MM

TEST SUMMARY

Bureau Veritas ID: RSM910
Sample ID: PFW-1
Matrix: Water

Collected: 2022/01/25
Shipped:
Received: 2022/01/28

Test Description	Instrumentation	Batch	Extracted	Date Analyzed	Analyst
PFAS in water by SPE/LCMS	LCMS	7815218	2022/02/03	2022/02/05	Xinhe Xing (Helena)

Bureau Veritas ID: RSM911
Sample ID: PFW-5
Matrix: Water

Collected: 2022/01/25
Shipped:
Received: 2022/01/28

Test Description	Instrumentation	Batch	Extracted	Date Analyzed	Analyst
PFAS in water by SPE/LCMS	LCMS	7815218	2022/02/03	2022/02/05	Xinhe Xing (Helena)

Bureau Veritas ID: RSM912
Sample ID: HSW-6
Matrix: Water

Collected: 2022/01/25
Shipped:
Received: 2022/01/28

Test Description	Instrumentation	Batch	Extracted	Date Analyzed	Analyst
PFAS in water by SPE/LCMS	LCMS	7815218	2022/02/03	2022/02/05	Xinhe Xing (Helena)

Bureau Veritas ID: RSM913
Sample ID: OW-8A
Matrix: Water

Collected: 2022/01/25
Shipped:
Received: 2022/01/28

Test Description	Instrumentation	Batch	Extracted	Date Analyzed	Analyst
PFAS in water by SPE/LCMS	LCMS	7815218	2022/02/03	2022/02/05	Xinhe Xing (Helena)

Bureau Veritas ID: RSM914
Sample ID: MW-12S
Matrix: Water

Collected: 2022/01/25
Shipped:
Received: 2022/01/28

Test Description	Instrumentation	Batch	Extracted	Date Analyzed	Analyst
PFAS in water by SPE/LCMS	LCMS	7815218	2022/02/03	2022/02/05	Xinhe Xing (Helena)

Bureau Veritas ID: RSM941
Sample ID: RINSATE 2
Matrix: Water

Collected: 2022/01/26
Shipped:
Received: 2022/01/28

Test Description	Instrumentation	Batch	Extracted	Date Analyzed	Analyst
PFAS in water by SPE/LCMS	LCMS	7819567	2022/02/07	2022/02/07	Lovelpreet Thind

Bureau Veritas ID: RSM942
Sample ID: PC-11
Matrix: Water

Collected: 2022/01/26
Shipped:
Received: 2022/01/28

Test Description	Instrumentation	Batch	Extracted	Date Analyzed	Analyst
PFAS in water by SPE/LCMS	LCMS	7819567	2022/02/07	2022/02/07	Lovelpreet Thind



Bureau Veritas Job #: C223621
Report Date: 2022/02/08

Barnstable County
Client Project #: BFTA
Site Location: BARNSTABLE, MA
Sampler Initials: MM

TEST SUMMARY

Bureau Veritas ID: RSM943
Sample ID: PC-30
Matrix: Water

Collected: 2022/01/26
Shipped:
Received: 2022/01/28

Test Description	Instrumentation	Batch	Extracted	Date Analyzed	Analyst
PFAS in water by SPE/LCMS	LCMS	7819567	2022/02/07	2022/02/08	Lovelpreet Thind

Bureau Veritas ID: RSM944
Sample ID: PC-16D
Matrix: Water

Collected: 2022/01/26
Shipped:
Received: 2022/01/28

Test Description	Instrumentation	Batch	Extracted	Date Analyzed	Analyst
PFAS in water by SPE/LCMS	LCMS	7819567	2022/02/07	2022/02/08	Lovelpreet Thind



Bureau Veritas Job #: C223621
Report Date: 2022/02/08

Barnstable County
Client Project #: BFTA
Site Location: BARNSTABLE, MA
Sampler Initials: MM

GENERAL COMMENTS

Sample RSM909 [DUPLICATE] : Per- and polyfluoroalkyl substances (PFAS): Due to high concentrations of the target analytes, a reduced sample volume was extracted and analyzed. Detection limits were adjusted accordingly.

Sample RSM910 [PFW-1] : Per- and polyfluoroalkyl substances (PFAS): Due to high concentrations of the target analytes, a reduced sample volume was extracted and analyzed. Detection limits were adjusted accordingly.

Sample RSM911 [PFW-5] : Per- and polyfluoroalkyl substances (PFAS): Due to high concentrations of the target analytes, a reduced sample volume was extracted and analyzed. Detection limits were adjusted accordingly.

Sample RSM912 [HSW-6] : Per- and polyfluoroalkyl substances (PFAS): Due to high concentrations of the target analytes, a reduced sample volume was extracted and analyzed. Detection limits were adjusted accordingly.

Sample RSM914 [MW-12S] : Per- and polyfluoroalkyl substances (PFAS): Due to high concentrations of the target analytes, a reduced sample volume was extracted and analyzed. Detection limits were adjusted accordingly.

Sample RSM942 [PC-11] : Per- and polyfluoroalkyl substances (PFAS): Due to high concentrations of the target analytes, a reduced sample volume was extracted and analyzed. Detection limits were adjusted accordingly.

Results relate only to the items tested.

BUREAU
VERITAS

Bureau Veritas Job #: C223621

Report Date: 2022/02/08

Barnstable County

Client Project #: BFTA

Site Location: BARNSTABLE, MA

Sampler Initials: MM

QUALITY ASSURANCE REPORT

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	% Recovery	UNITS	QC Limits
7815218	XIN	Spiked Blank	13C2-6:2-Fluorotelomersulfonic Acid	2022/02/05		115	%	50 - 150
			13C2-8:2-Fluorotelomersulfonic Acid	2022/02/05		104	%	50 - 150
			13C2-Perfluorodecanoic acid	2022/02/05		109	%	50 - 150
			13C2-Perfluorododecanoic acid	2022/02/05		102	%	50 - 150
			13C2-Perfluorohexanoic acid	2022/02/05		115	%	50 - 150
			13C2-perfluorotetradecanoic acid	2022/02/05		98	%	50 - 150
			13C2-Perfluoroundecanoic acid	2022/02/05		107	%	50 - 150
			13C3-Perfluorobutanesulfonic acid	2022/02/05		112	%	50 - 150
			13C4-Perfluorobutanoic acid	2022/02/05		112	%	50 - 150
			13C4-Perfluoroheptanoic acid	2022/02/05		113	%	50 - 150
			13C4-Perfluorooctanesulfonic acid	2022/02/05		112	%	50 - 150
			13C4-Perfluorooctanoic acid	2022/02/05		115	%	50 - 150
			13C5-Perfluorononanoic acid	2022/02/05		112	%	50 - 150
			13C5-Perfluoropentanoic acid	2022/02/05		115	%	50 - 150
			13C8-Perfluorooctane Sulfonamide	2022/02/05		98	%	50 - 150
			18O2-Perfluorohexanesulfonic acid	2022/02/05		113	%	50 - 150
			D3-MeFOSA	2022/02/05		81	%	50 - 150
			D5-EtFOSA	2022/02/05		84	%	50 - 150
			D7-MeFOSE	2022/02/05		93	%	50 - 150
			D9-EtFOSE	2022/02/05		94	%	50 - 150
			Perfluorobutanoic acid (PFBA)	2022/02/05		113	%	70 - 130
			Perfluoropentanoic acid (PFPeA)	2022/02/05		113	%	70 - 130
			Perfluorohexanoic acid (PFHxA)	2022/02/05		108	%	70 - 130
			Perfluoroheptanoic acid (PFHpA)	2022/02/05		112	%	70 - 130
			Perfluorooctanoic acid (PFOA)	2022/02/05		113	%	70 - 130
			Perfluorononanoic acid (PFNA)	2022/02/05		113	%	70 - 130
			Perfluorodecanoic acid (PFDA)	2022/02/05		111	%	70 - 130
			Perfluoroundecanoic acid (PFUnA)	2022/02/05		108	%	70 - 130
			Perfluorododecanoic acid (PFDoA)	2022/02/05		116	%	70 - 130
			Perfluorotridecanoic acid (PFTRDA)	2022/02/05		118	%	70 - 130
			Perfluorotetradecanoic acid (PFTEDA)	2022/02/05		111	%	70 - 130
			Perfluorobutanesulfonic acid (PFBS)	2022/02/05		112	%	70 - 130
			Perfluorohexanesulfonic acid (PFHxS)	2022/02/05		113	%	70 - 130
			Perfluoroheptanesulfonic acid (PFHpS)	2022/02/05		109	%	70 - 130
			Perfluorooctanesulfonic acid (PFOS)	2022/02/05		111	%	70 - 130
			Perfluorodecanesulfonic acid (PFDS)	2022/02/05		106	%	70 - 130
			Perfluorooctane Sulfonamide (PFOSA)	2022/02/05		115	%	70 - 130
			EtFOSA	2022/02/05		112	%	70 - 130
			MeFOSA	2022/02/05		114	%	70 - 130
			EtFOSE	2022/02/05		109	%	70 - 130
			MeFOSE	2022/02/05		109	%	70 - 130
			6:2 Fluorotelomer sulfonic acid	2022/02/05		111	%	70 - 130
			8:2 Fluorotelomer sulfonic acid	2022/02/05		115	%	70 - 130
7815218	XIN	Spiked Blank DUP	13C2-6:2-Fluorotelomersulfonic Acid	2022/02/05		115	%	50 - 150
			13C2-8:2-Fluorotelomersulfonic Acid	2022/02/05		113	%	50 - 150
			13C2-Perfluorodecanoic acid	2022/02/05		111	%	50 - 150
			13C2-Perfluorododecanoic acid	2022/02/05		102	%	50 - 150
			13C2-Perfluorohexanoic acid	2022/02/05		117	%	50 - 150
			13C2-perfluorotetradecanoic acid	2022/02/05		98	%	50 - 150
			13C2-Perfluoroundecanoic acid	2022/02/05		105	%	50 - 150
			13C3-Perfluorobutanesulfonic acid	2022/02/05		115	%	50 - 150



BUREAU
VERITAS

Bureau Veritas Job #: C223621

Report Date: 2022/02/08

Barnstable County

Client Project #: BFTA

Site Location: BARNSTABLE, MA

Sampler Initials: MM

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	% Recovery	UNITS	QC Limits
7815218	XIN	RPD	13C4-Perfluorobutanoic acid	2022/02/05		117	%	50 - 150
			13C4-Perfluoroheptanoic acid	2022/02/05		116	%	50 - 150
			13C4-Perfluorooctanesulfonic acid	2022/02/05		116	%	50 - 150
			13C4-Perfluorooctanoic acid	2022/02/05		115	%	50 - 150
			13C5-Perfluorononanoic acid	2022/02/05		113	%	50 - 150
			13C5-Perfluoropentanoic acid	2022/02/05		118	%	50 - 150
			13C8-Perfluorooctane Sulfonamide	2022/02/05		97	%	50 - 150
			18O2-Perfluorohexanesulfonic acid	2022/02/05		116	%	50 - 150
			D3-MeFOSA	2022/02/05		81	%	50 - 150
			D5-EtFOSA	2022/02/05		80	%	50 - 150
			D7-MeFOSE	2022/02/05		90	%	50 - 150
			D9-EtFOSE	2022/02/05		93	%	50 - 150
			Perfluorobutanoic acid (PFBA)	2022/02/05		110	%	70 - 130
			Perfluoropentanoic acid (PFPeA)	2022/02/05		109	%	70 - 130
			Perfluorohexanoic acid (PFHxA)	2022/02/05		107	%	70 - 130
			Perfluoroheptanoic acid (PFHpA)	2022/02/05		108	%	70 - 130
			Perfluorooctanoic acid (PFOA)	2022/02/05		111	%	70 - 130
			Perfluorononanoic acid (PFNA)	2022/02/05		110	%	70 - 130
			Perfluorodecanoic acid (PFDA)	2022/02/05		108	%	70 - 130
			Perfluoroundecanoic acid (PFUnA)	2022/02/05		110	%	70 - 130
			Perfluorododecanoic acid (PFDoA)	2022/02/05		110	%	70 - 130
			Perfluorotridecanoic acid (PFTRDA)	2022/02/05		111	%	70 - 130
			Perfluorotetradecanoic acid(PFTEDA)	2022/02/05		106	%	70 - 130
			Perfluorobutanesulfonic acid (PFBS)	2022/02/05		110	%	70 - 130
			Perfluorohexanesulfonic acid(PFHxS)	2022/02/05		111	%	70 - 130
			Perfluoroheptanesulfonic acid PFHpS	2022/02/05		106	%	70 - 130
			Perfluorooctanesulfonic acid (PFOS)	2022/02/05		107	%	70 - 130
			Perfluorodecanesulfonic acid (PFDS)	2022/02/05		101	%	70 - 130
			Perfluorooctane Sulfonamide (PFOSA)	2022/02/05		112	%	70 - 130
			EtFOSA	2022/02/05		103	%	70 - 130
			MeFOSA	2022/02/05		102	%	70 - 130
			EtFOSE	2022/02/05		107	%	70 - 130
			MeFOSE	2022/02/05		110	%	70 - 130
			6:2 Fluorotelomer sulfonic acid	2022/02/05		109	%	70 - 130
			8:2 Fluorotelomer sulfonic acid	2022/02/05		108	%	70 - 130
			Perfluorobutanoic acid (PFBA)	2022/02/05	3.1		%	30
			Perfluoropentanoic acid (PFPeA)	2022/02/05	3.3		%	30
			Perfluorohexanoic acid (PFHxA)	2022/02/05	0.90		%	30
			Perfluoroheptanoic acid (PFHpA)	2022/02/05	3.4		%	30
			Perfluorooctanoic acid (PFOA)	2022/02/05	2.0		%	30
			Perfluorononanoic acid (PFNA)	2022/02/05	2.4		%	30
			Perfluorodecanoic acid (PFDA)	2022/02/05	2.7		%	30
			Perfluoroundecanoic acid (PFUnA)	2022/02/05	1.9		%	30
			Perfluorododecanoic acid (PFDoA)	2022/02/05	5.4		%	30
			Perfluorotridecanoic acid (PFTRDA)	2022/02/05	5.7		%	30
			Perfluorotetradecanoic acid(PFTEDA)	2022/02/05	4.2		%	30
			Perfluorobutanesulfonic acid (PFBS)	2022/02/05	2.0		%	30
			Perfluorohexanesulfonic acid(PFHxS)	2022/02/05	1.5		%	30
			Perfluoroheptanesulfonic acid PFHpS	2022/02/05	2.5		%	30
			Perfluorooctanesulfonic acid (PFOS)	2022/02/05	4.3		%	30
			Perfluorodecanesulfonic acid (PFDS)	2022/02/05	5.1		%	30



Bureau Veritas Job #: C223621
Report Date: 2022/02/08

Barnstable County
Client Project #: BFTA
Site Location: BARNSTABLE, MA
Sampler Initials: MM

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	% Recovery	UNITS	QC Limits
7815218	XIN	Method Blank	Perfluorooctane Sulfonamide (PFOSA)	2022/02/05	2.7		%	30
			EtFOSA	2022/02/05	8.0		%	30
			MeFOSA	2022/02/05	11		%	30
			EtFOSE	2022/02/05	2.1		%	30
			MeFOSE	2022/02/05	0.56		%	30
			6:2 Fluorotelomer sulfonic acid	2022/02/05	1.1		%	30
			8:2 Fluorotelomer sulfonic acid	2022/02/05	6.8		%	30
			13C2-6:2-Fluorotelomersulfonic Acid	2022/02/05		106	%	50 - 150
			13C2-8:2-Fluorotelomersulfonic Acid	2022/02/05		99	%	50 - 150
			13C2-Perfluorodecanoic acid	2022/02/05		102	%	50 - 150
			13C2-Perfluorododecanoic acid	2022/02/05		94	%	50 - 150
			13C2-Perfluorohexanoic acid	2022/02/05		110	%	50 - 150
			13C2-perfluorotetradecanoic acid	2022/02/05		89	%	50 - 150
			13C2-Perfluoroundecanoic acid	2022/02/05		97	%	50 - 150
			13C3-Perfluorobutanesulfonic acid	2022/02/05		106	%	50 - 150
			13C4-Perfluorobutanoic acid	2022/02/05		108	%	50 - 150
			13C4-Perfluoroheptanoic acid	2022/02/05		109	%	50 - 150
			13C4-Perfluorooctanesulfonic acid	2022/02/05		102	%	50 - 150
			13C4-Perfluorooctanoic acid	2022/02/05		107	%	50 - 150
			13C5-Perfluorononanoic acid	2022/02/05		102	%	50 - 150
			13C5-Perfluoropentanoic acid	2022/02/05		107	%	50 - 150
			13C8-Perfluorooctane Sulfonamide	2022/02/05		89	%	50 - 150
			18O2-Perfluorohexanesulfonic acid	2022/02/05		104	%	50 - 150
			D3-MeFOSA	2022/02/05		70	%	50 - 150
			D5-EtFOSA	2022/02/05		66	%	50 - 150
			D7-MeFOSE	2022/02/05		83	%	50 - 150
			D9-EtFOSE	2022/02/05		82	%	50 - 150
			Perfluorobutanoic acid (PFBA)	2022/02/05	<0.0039		ug/L	
			Perfluoropentanoic acid (PFPeA)	2022/02/05	<0.0067		ug/L	
			Perfluorohexanoic acid (PFHxA)	2022/02/05	<0.0053		ug/L	
			Perfluoroheptanoic acid (PFHpA)	2022/02/05	<0.0067		ug/L	
			Perfluorooctanoic acid (PFOA)	2022/02/05	<0.0050		ug/L	
			Perfluorononanoic acid (PFNA)	2022/02/05	<0.0051		ug/L	
			Perfluorodecanoic acid (PFDA)	2022/02/05	<0.0039		ug/L	
			Perfluoroundecanoic acid (PFUnA)	2022/02/05	<0.0062		ug/L	
			Perfluorododecanoic acid (PFDoA)	2022/02/05	<0.0080		ug/L	
			Perfluorotridecanoic acid (PFTRDA)	2022/02/05	<0.0064		ug/L	
			Perfluorotetradecanoic acid(PFTEDA)	2022/02/05	<0.0068		ug/L	
			Perfluorobutanesulfonic acid (PFBS)	2022/02/05	<0.0056		ug/L	
			Perfluorohexanesulfonic acid(PFHxS)	2022/02/05	<0.0044		ug/L	
			Perfluoroheptanesulfonic acid PFHpS	2022/02/05	<0.0065		ug/L	
			Perfluorooctanesulfonic acid (PFOS)	2022/02/05	<0.0057		ug/L	
			Perfluorodecanesulfonic acid (PFDS)	2022/02/05	<0.0064		ug/L	
			Perfluorooctane Sulfonamide (PFOSA)	2022/02/05	<0.0036		ug/L	
			EtFOSA	2022/02/05	<0.0070		ug/L	
			MeFOSA	2022/02/05	<0.0078		ug/L	
			EtFOSE	2022/02/05	<0.0071		ug/L	
			MeFOSE	2022/02/05	<0.0070		ug/L	
			6:2 Fluorotelomer sulfonic acid	2022/02/05	<0.0065		ug/L	
			8:2 Fluorotelomer sulfonic acid	2022/02/05	<0.0067		ug/L	
7819567	LOV	Spiked Blank	13C2-6:2-Fluorotelomersulfonic Acid	2022/02/07		102	%	50 - 150



BUREAU
VERITAS

Bureau Veritas Job #: C223621

Report Date: 2022/02/08

Barnstable County

Client Project #: BFTA

Site Location: BARNSTABLE, MA

Sampler Initials: MM

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	% Recovery	UNITS	QC Limits
7819567	LOV	Spiked Blank DUP	13C2-8:2-Fluorotelomersulfonic Acid	2022/02/07		100	%	50 - 150
			13C2-Perfluorodecanoic acid	2022/02/07		105	%	50 - 150
			13C2-Perfluorododecanoic acid	2022/02/07		96	%	50 - 150
			13C2-Perfluorohexanoic acid	2022/02/07		103	%	50 - 150
			13C2-perfluorotetradecanoic acid	2022/02/07		92	%	50 - 150
			13C2-Perfluoroundecanoic acid	2022/02/07		100	%	50 - 150
			13C3-Perfluorobutanesulfonic acid	2022/02/07		100	%	50 - 150
			13C4-Perfluorobutanoic acid	2022/02/07		99	%	50 - 150
			13C4-Perfluoroheptanoic acid	2022/02/07		101	%	50 - 150
			13C4-Perfluorooctanesulfonic acid	2022/02/07		99	%	50 - 150
			13C4-Perfluorooctanoic acid	2022/02/07		105	%	50 - 150
			13C5-Perfluorononanoic acid	2022/02/07		106	%	50 - 150
			13C5-Perfluoropentanoic acid	2022/02/07		102	%	50 - 150
			13C8-Perfluorooctane Sulfonamide	2022/02/07		92	%	50 - 150
			18O2-Perfluorohexanesulfonic acid	2022/02/07		97	%	50 - 150
			D3-MeFOSA	2022/02/07		67	%	50 - 150
			D5-EtFOSA	2022/02/07		66	%	50 - 150
			D7-MeFOSE	2022/02/07		84	%	50 - 150
			D9-EtFOSE	2022/02/07		86	%	50 - 150
			Perfluorobutanoic acid (PFBA)	2022/02/07		97	%	70 - 130
			Perfluoropentanoic acid (PFPeA)	2022/02/07		99	%	70 - 130
			Perfluorohexanoic acid (PFHxA)	2022/02/07		98	%	70 - 130
			Perfluoroheptanoic acid (PFHpA)	2022/02/07		100	%	70 - 130
			Perfluorooctanoic acid (PFOA)	2022/02/07		98	%	70 - 130
			Perfluorononanoic acid (PFNA)	2022/02/07		96	%	70 - 130
			Perfluorodecanoic acid (PFDA)	2022/02/07		98	%	70 - 130
			Perfluoroundecanoic acid (PFUnA)	2022/02/07		96	%	70 - 130
			Perfluorododecanoic acid (PFDoA)	2022/02/07		98	%	70 - 130
			Perfluorotridecanoic acid (PFTRDA)	2022/02/07		99	%	70 - 130
			Perfluorotetradecanoic acid(PFTEDA)	2022/02/07		101	%	70 - 130
			Perfluorobutanesulfonic acid (PFBS)	2022/02/07		98	%	70 - 130
			Perfluorohexanesulfonic acid(PFHxS)	2022/02/07		99	%	70 - 130
			Perfluoroheptanesulfonic acid PFHpS	2022/02/07		93	%	70 - 130
			Perfluorooctanesulfonic acid (PFOS)	2022/02/07		103	%	70 - 130
			Perfluorodecanesulfonic acid (PFDS)	2022/02/07		86	%	70 - 130
			Perfluorooctane Sulfonamide (PFOSA)	2022/02/07		100	%	70 - 130
			EtFOSA	2022/02/07		101	%	70 - 130
			MeFOSA	2022/02/07		98	%	70 - 130
			EtFOSE	2022/02/07		99	%	70 - 130
			MeFOSE	2022/02/07		96	%	70 - 130
			6:2 Fluorotelomer sulfonic acid	2022/02/07		99	%	70 - 130
			8:2 Fluorotelomer sulfonic acid	2022/02/07		95	%	70 - 130
			13C2-6:2-Fluorotelomersulfonic Acid	2022/02/07		102	%	50 - 150
			13C2-8:2-Fluorotelomersulfonic Acid	2022/02/07		97	%	50 - 150
			13C2-Perfluorodecanoic acid	2022/02/07		100	%	50 - 150
			13C2-Perfluorododecanoic acid	2022/02/07		95	%	50 - 150
			13C2-Perfluorohexanoic acid	2022/02/07		100	%	50 - 150
			13C2-perfluorotetradecanoic acid	2022/02/07		91	%	50 - 150
			13C2-Perfluoroundecanoic acid	2022/02/07		96	%	50 - 150
			13C3-Perfluorobutanesulfonic acid	2022/02/07		96	%	50 - 150
			13C4-Perfluorobutanoic acid	2022/02/07		97	%	50 - 150



BUREAU
VERITAS

Bureau Veritas Job #: C223621

Report Date: 2022/02/08

Barnstable County

Client Project #: BFTA

Site Location: BARNSTABLE, MA

Sampler Initials: MM

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	% Recovery	UNITS	QC Limits
7819567	LOV	RPD	13C4-Perfluoroheptanoic acid	2022/02/07		99	%	50 - 150
			13C4-Perfluorooctanesulfonic acid	2022/02/07		96	%	50 - 150
			13C4-Perfluorooctanoic acid	2022/02/07		101	%	50 - 150
			13C5-Perfluorononanoic acid	2022/02/07		103	%	50 - 150
			13C5-Perfluoropentanoic acid	2022/02/07		100	%	50 - 150
			13C8-Perfluorooctane Sulfonamide	2022/02/07		88	%	50 - 150
			18O2-Perfluorohexanesulfonic acid	2022/02/07		93	%	50 - 150
			D3-MeFOSA	2022/02/07		67	%	50 - 150
			D5-EtFOSA	2022/02/07		70	%	50 - 150
			D7-MeFOSE	2022/02/07		82	%	50 - 150
			D9-EtFOSE	2022/02/07		81	%	50 - 150
			Perfluorobutanoic acid (PFBA)	2022/02/07		96	%	70 - 130
			Perfluoropentanoic acid (PFPeA)	2022/02/07		99	%	70 - 130
			Perfluorohexanoic acid (PFHxA)	2022/02/07		96	%	70 - 130
			Perfluoroheptanoic acid (PFHpA)	2022/02/07		98	%	70 - 130
			Perfluorooctanoic acid (PFOA)	2022/02/07		99	%	70 - 130
			Perfluorononanoic acid (PFNA)	2022/02/07		96	%	70 - 130
			Perfluorodecanoic acid (PFDA)	2022/02/07		97	%	70 - 130
			Perfluoroundecanoic acid (PFUnA)	2022/02/07		98	%	70 - 130
			Perfluorododecanoic acid (PFDoA)	2022/02/07		97	%	70 - 130
			Perfluorotridecanoic acid (PFTRDA)	2022/02/07		99	%	70 - 130
			Perfluorotetradecanoic acid(PFTEDA)	2022/02/07		101	%	70 - 130
			Perfluorobutanesulfonic acid (PFBS)	2022/02/07		96	%	70 - 130
			Perfluorohexanesulfonic acid(PFHxS)	2022/02/07		99	%	70 - 130
			Perfluoroheptanesulfonic acid PFHpS	2022/02/07		94	%	70 - 130
			Perfluorooctanesulfonic acid (PFOS)	2022/02/07		103	%	70 - 130
			Perfluorodecanesulfonic acid (PFDS)	2022/02/07		90	%	70 - 130
			Perfluorooctane Sulfonamide (PFOSA)	2022/02/07		103	%	70 - 130
			EtFOSA	2022/02/07		97	%	70 - 130
			MeFOSA	2022/02/07		101	%	70 - 130
			EtFOSE	2022/02/07		96	%	70 - 130
			MeFOSE	2022/02/07		93	%	70 - 130
			6:2 Fluorotelomer sulfonic acid	2022/02/07		95	%	70 - 130
			8:2 Fluorotelomer sulfonic acid	2022/02/07		93	%	70 - 130
			Perfluorobutanoic acid (PFBA)	2022/02/07	1.4		%	30
			Perfluoropentanoic acid (PFPeA)	2022/02/07	0.10		%	30
			Perfluorohexanoic acid (PFHxA)	2022/02/07	1.3		%	30
			Perfluoroheptanoic acid (PFHpA)	2022/02/07	2.1		%	30
			Perfluorooctanoic acid (PFOA)	2022/02/07	0.23		%	30
			Perfluorononanoic acid (PFNA)	2022/02/07	0.35		%	30
			Perfluorodecanoic acid (PFDA)	2022/02/07	1.3		%	30
			Perfluoroundecanoic acid (PFUnA)	2022/02/07	1.8		%	30
			Perfluorododecanoic acid (PFDoA)	2022/02/07	1.3		%	30
			Perfluorotridecanoic acid (PFTRDA)	2022/02/07	0.39		%	30
			Perfluorotetradecanoic acid(PFTEDA)	2022/02/07	0.18		%	30
			Perfluorobutanesulfonic acid (PFBS)	2022/02/07	1.3		%	30
			Perfluorohexanesulfonic acid(PFHxS)	2022/02/07	0.021		%	30
			Perfluoroheptanesulfonic acid PFHpS	2022/02/07	0.49		%	30
			Perfluorooctanesulfonic acid (PFOS)	2022/02/07	0.19		%	30
			Perfluorodecanesulfonic acid (PFDS)	2022/02/07	4.3		%	30
			Perfluorooctane Sulfonamide (PFOSA)	2022/02/07	3.1		%	30



Bureau Veritas Job #: C223621
Report Date: 2022/02/08

Barnstable County
Client Project #: BFTA
Site Location: BARNSTABLE, MA
Sampler Initials: MM

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC	Batch	Init	QC Type	Parameter	Date Analyzed	Value	% Recovery	UNITS	QC Limits
7819567	LOV	Method Blank	EtFOSA	2022/02/07	4.6			%	30
			MeFOSA	2022/02/07	3.4			%	30
			EtFOSE	2022/02/07	2.4			%	30
			MeFOSE	2022/02/07	2.9			%	30
			6:2 Fluorotelomer sulfonic acid	2022/02/07	4.1			%	30
			8:2 Fluorotelomer sulfonic acid	2022/02/07	2.4			%	30
			13C2-6:2-Fluorotelomersulfonic Acid	2022/02/07		105		%	50 - 150
			13C2-8:2-Fluorotelomersulfonic Acid	2022/02/07		94		%	50 - 150
			13C2-Perfluorodecanoic acid	2022/02/07		97		%	50 - 150
			13C2-Perfluorododecanoic acid	2022/02/07		91		%	50 - 150
			13C2-Perfluorohexanoic acid	2022/02/07		100		%	50 - 150
			13C2-perfluorotetradecanoic acid	2022/02/07		87		%	50 - 150
			13C2-Perfluoroundecanoic acid	2022/02/07		93		%	50 - 150
			13C3-Perfluorobutanesulfonic acid	2022/02/07		95		%	50 - 150
			13C4-Perfluorobutanoic acid	2022/02/07		96		%	50 - 150
			13C4-Perfluoroheptanoic acid	2022/02/07		97		%	50 - 150
			13C4-Perfluorooctanesulfonic acid	2022/02/07		98		%	50 - 150
			13C4-Perfluorooctanoic acid	2022/02/07		100		%	50 - 150
			13C5-Perfluorononanoic acid	2022/02/07		100		%	50 - 150
			13C5-Perfluoropentanoic acid	2022/02/07		99		%	50 - 150
			13C8-Perfluorooctane Sulfonamide	2022/02/07		90		%	50 - 150
			18O2-Perfluorohexanesulfonic acid	2022/02/07		92		%	50 - 150
			D3-MeFOSA	2022/02/07		75		%	50 - 150
			D5-EtFOSA	2022/02/07		74		%	50 - 150
			D7-MeFOSE	2022/02/07		76		%	50 - 150
			D9-EtFOSE	2022/02/07		75		%	50 - 150
			Perfluorobutanoic acid (PFBA)	2022/02/07	<0.0039			ug/L	
			Perfluoropentanoic acid (PFPeA)	2022/02/07	<0.0067			ug/L	
			Perfluorohexanoic acid (PFHxA)	2022/02/07	<0.0053			ug/L	
			Perfluoroheptanoic acid (PFHpA)	2022/02/07	<0.0067			ug/L	
			Perfluorooctanoic acid (PFOA)	2022/02/07	<0.0050			ug/L	
			Perfluorononanoic acid (PFNA)	2022/02/07	<0.0051			ug/L	
			Perfluorodecanoic acid (PFDA)	2022/02/07	<0.0039			ug/L	
			Perfluoroundecanoic acid (PFUnA)	2022/02/07	<0.0062			ug/L	
			Perfluorododecanoic acid (PFDoA)	2022/02/07	<0.0080			ug/L	
			Perfluorotridecanoic acid (PFTRDA)	2022/02/07	<0.0064			ug/L	
			Perfluorotetradecanoic acid(PFTEDA)	2022/02/07	<0.0068			ug/L	
			Perfluorobutanesulfonic acid (PFBS)	2022/02/07	<0.0056			ug/L	
			Perfluorohexanesulfonic acid(PFHxS)	2022/02/07	<0.0044			ug/L	
			Perfluoroheptanesulfonic acid PFHpS	2022/02/07	<0.0065			ug/L	
			Perfluorooctanesulfonic acid (PFOS)	2022/02/07	<0.0057			ug/L	
			Perfluorodecanesulfonic acid (PFDS)	2022/02/07	<0.0064			ug/L	
			Perfluorooctane Sulfonamide (PFOSA)	2022/02/07	<0.0036			ug/L	
			EtFOSA	2022/02/07	<0.0070			ug/L	
			MeFOSA	2022/02/07	<0.0078			ug/L	
			EtFOSE	2022/02/07	<0.0071			ug/L	
			MeFOSE	2022/02/07	<0.0070			ug/L	
			6:2 Fluorotelomer sulfonic acid	2022/02/07	<0.0065			ug/L	



Bureau Veritas Job #: C223621
Report Date: 2022/02/08

Barnstable County
Client Project #: BFTA
Site Location: BARNSTABLE, MA
Sampler Initials: MM

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC	Batch	Init	QC Type	Parameter	Date Analyzed	Value	% Recovery	UNITS	QC Limits
				8:2 Fluorotelomer sulfonic acid	2022/02/07	<0.0067		ug/L	
Duplicate: Paired analysis of a separate portion of the same sample. Used to evaluate the variance in the measurement.									
Spiked Blank: A blank matrix sample to which a known amount of the analyte, usually from a second source, has been added. Used to evaluate method accuracy.									
Method Blank: A blank matrix containing all reagents used in the analytical procedure. Used to identify laboratory contamination.									
Surrogate: A pure or isotopically labeled compound whose behavior mirrors the analytes of interest. Used to evaluate extraction efficiency.									



Bureau Veritas Job #: C223621
Report Date: 2022/02/08

Barnstable County
Client Project #: BFTA
Site Location: BARNSTABLE, MA
Sampler Initials: MM

VALIDATION SIGNATURE PAGE

The analytical data and all QC contained in this report were reviewed and validated by:

A handwritten signature in black ink, appearing to read "Colm McNamara", written over a horizontal line.

Colm McNamara, Senior Analyst, Liquid Chromatography

Bureau Veritas has procedures in place to guard against improper use of the electronic signature and have the required "signatories", as per ISO/IEC 17025, signing the reports. For Service Group specific validation please refer to the Validation Signature Page.

Invoice Information			Report Information (if differs from Invoice)			Project Information		
Company: Barnstable County			Company: BETA Group			Quotation #:		
Contact Name: Steve Tebo/Pruella Ellis			Contact Name: Roger Thibault			P.O. #/ AFER:		
Street Address: PO Box 427 3kg5 Mainst			Street Address:			Project #: Barnstable 6206		
City: Barnstable	Prov: MA	Postal Code:	City:	Prov:	Postal Code:	Site #: BFTA		
Phone:			Phone: 401-333-2282			Site Location: Barnstable, MA USA		
Email: pellis@barnstablecounty.org			Email: rthibault@beta-inc.com			Province:		
Copies: ctebo@barnstablecounty.org			Copies: mmendes@beta-inc.com			Sampled By: Mykel Mendes		

Regulatory Criteria												Regular Turnaround Time (TAT)											
<input type="checkbox"/> Table 1 <input type="checkbox"/> Res/Park <input type="checkbox"/> Med/Fine <input type="checkbox"/> Table 2 <input type="checkbox"/> Ind/Comm <input type="checkbox"/> Course <input type="checkbox"/> Table 3 <input type="checkbox"/> Agr/other <input type="checkbox"/> For RSC <input type="checkbox"/> Table _____				<input type="checkbox"/> CCME <input type="checkbox"/> Reg 406, Table: <input type="checkbox"/> Reg 558* <input type="checkbox"/> Sanitary Sewer Bylaw *min 3 day TAT <input type="checkbox"/> Storm Sewer Bylaw <input type="checkbox"/> MISA Municipality <input type="checkbox"/> PWQO Other:								<input type="checkbox"/> 5 to 7 Day <input type="checkbox"/> 10 Day Rush Turnaround Time (TAT) Surcharges apply <input type="checkbox"/> Same Day <input type="checkbox"/> 1 Day <input type="checkbox"/> 2 Day <input type="checkbox"/> 3 Day <input type="checkbox"/> 4 Day											
Include Criteria on Certificate of Analysis (check if yes): <input type="checkbox"/>												Date Required: YY MM DD											

SAMPLES MUST BE KEPT COOL (<10°C) FROM TIME OF SAMPLING UNTIL DELIVERY TO BUREAU VERITAS

Sample Identification		Date Sampled			Time (24hr)		Matrix	TEST PARAMETERS												# OF CONTAINERS SUBMITTED	HOLD - DO NOT ANALYZE	Comments
		YY	MM	DD	HH	MM		FIELD FILTERED	FIELD PRESERVED	LAB FILTRATION REQUIRED	BTEX / F1	F2 - F4	VOCs	Reg 153 metals and inorganics	Reg 153 CPMS metals	Reg 153 metals (Mn, Cr VI, ICPMAS metals, HWS - 6)	USEPA 537 m					
1	PC-6A	22	01	26	12	04	GW								X			2				
2	PC-38	22	01	26	10	00									X			2				
3	PC-28	22	01	26	13	40									X			2				
4	PC-1	22	01	26	01	04									X			2				
5	MW-22	22	01	25	13	51									X			2				
6	Rinsate 1	22	01	25	14	22	AQ								X			2				
7	Duplicate	22	01	25	12	38									X			2				
8	PFW-1	22	01	25	12	33									X			2				
9	PFW-5	22	01	25	11	36									X			2				
10	HWS-6	22	01	25	13	00									X			2				
11	OW-8A	22	01	25	16	30	↓								X			2				
12	MW-125	22	01	25	14	25	GW								X			2				

*UNLESS OTHERWISE AGREED TO IN WRITING, WORK SUBMITTED ON THIS CHAIN OF CUSTODY IS SUBJECT TO BUREAU VERITAS STANDARD TERMS AND CONDITIONS. SIGNING OF THIS CHAIN OF CUSTODY DOCUMENT IS ACKNOWLEDGMENT AND ACCEPTANCE OF OUR TERMS AND CONDITIONS WHICH ARE AVAILABLE FOR VIEWING AT WWW.BVNA.COM/TERMS-AND-CONDITIONS OR BY CALLING THE LABORATORY LISTED ABOVE TO OBTAIN A COPY.

LAB USE ONLY			Yes			No			°C			LAB USE ONLY			Yes			No			°C			Temperature reading by:
Seal present	<input checked="" type="checkbox"/>		1	2	3	Seal present	<input checked="" type="checkbox"/>		1	2	3	Seal present	<input checked="" type="checkbox"/>		1	2	3	Seal present	<input checked="" type="checkbox"/>		1	2	3	
Seal intact	<input checked="" type="checkbox"/>					Seal intact	<input checked="" type="checkbox"/>					Seal intact	<input checked="" type="checkbox"/>					Seal intact	<input checked="" type="checkbox"/>					
Cooling media present	<input checked="" type="checkbox"/>					Cooling media present	<input checked="" type="checkbox"/>					Cooling media present	<input checked="" type="checkbox"/>					Cooling media present	<input checked="" type="checkbox"/>					

Relinquished by: (Signature/ Print)						Received by: (Signature/ Print)						Special Instructions					
YY		MM		DD HH MM		YY		MM		DD HH MM		YY		MM		DD HH MM	
Mykel Mendes						Ray Masani						2022 01 28 12 49					



www.BVNA.com

6740 Campobello Road, Mississauga, Ontario L5N 2L8
Phone: 905-817-5700 Fax: 905-817-5779 Toll Free: 800-563-6266

CHAIN OF CUSTODY RECORD

ENV COC - 00014v2

Page 2 of 2

Invoice Information				Report Information (if differs from invoice)				Project Information				LAB USE ONLY - PLACE STICKER HERE						
Invoice to (requires report) 20				Report Information (if differs from invoice)				Project Information										
Company:	Barnstable County			Company:	BETA Group			Quotation #:										
Contact Name:	Priscilla Ellis / Steve Tob			Contact Name:	Roger Thibault			P.O. #/ AFER:										
Street Address:	3195 Main St			Street Address:				Project #:	6206									
City:	Prov:	MA	Postal Code:	City:	Lincoln	Prov:	RI	Postal Code:	Site #:	BETA								
Phone:				Phone:				Site Location:	Barnstable, MA			Rush Confirmation #:						
Email:	pellis@barnstablecounty.ma.gov			Email:	rthibault@beta-inc.com			Site Location Province:										
Copies:	stebo@barnstablecounty.ma.gov			Copies:	mmendes@beta-inc.com			Sampled By:	Mykel Mendes									
Regulatory Criteria																		
<input type="checkbox"/> Table 1 <input type="checkbox"/> Res/Park <input type="checkbox"/> Med/Fine <input type="checkbox"/> CCME <input type="checkbox"/> Reg 406, Table: <input type="checkbox"/> Reg 558* <input type="checkbox"/> Sanitary Sewer Bylaw <input type="checkbox"/> *min 3 day TAT <input type="checkbox"/> Storm Sewer Bylaw <input type="checkbox"/> MISA <input type="checkbox"/> PWQO <input type="checkbox"/> Other: <input type="checkbox"/> Include Criteria on Certificate of Analysis (check if yes): <input type="checkbox"/>																		
SAMPLES MUST BE KEPT COOL (<10°C) FROM TIME OF SAMPLING UNTIL DELIVERY TO BUREAU VERITAS																		
Sample Identification				Date Sampled		Time (24hr)		Matrix										
				YY	MM	DD	HH	MM										
1	Pinsale 2			22	01	26	14	05	AQ									
2	PC-11			22	01	26	11	07	GW									
3	PC-30			22	01	26	12	20	GW									
4	PC-16D			22	01	26	16	30	GW									
5																		
6																		
7																		
8																		
9																		
10																		
11																		
12																		
*UNLESS OTHERWISE AGREED TO IN WRITING, WORK SUBMITTED ON THIS CHAIN OF CUSTODY IS SUBJECT TO BUREAU VERITAS STANDARD TERMS AND CONDITIONS. SIGNING OF THIS CHAIN OF CUSTODY DOCUMENT IS ACKNOWLEDGMENT AND ACCEPTANCE OF OUR TERMS AND CONDITIONS WHICH ARE AVAILABLE FOR VIEWING AT WWW.BVNA.COM/TERMS-AND-CONDITIONS OR BY CALLING THE LABORATORY LISTED ABOVE TO OBTAIN A COPY																		
LAB USE ONLY				LAB USE ONLY				LAB USE ONLY				LAB USE ONLY						
Seal present				Seal present				Seal present				Seal present						
Seal intact				Seal intact				Seal intact				Seal intact						
Cooling media present				Cooling media present				Cooling media present				Cooling media present						
Relinquished by: (Signature/ Print)				Received by: (Signature/ Print)				Special Instructions										
Mykel Mendes				See Page 1														
22 01 27 10 15																		



Your Project #: BFTA
Site Location: BARNSTABLE, MA
Your C.O.C. #: n/a

Attention: Steven Tebo

Barnstable County
3195 Main Street
PO Box 427
Barnstable, MA
USA 02630

Report Date: 2022/02/15
Report #: R7006209
Version: 1 - Final

CERTIFICATE OF ANALYSIS

BUREAU VERITAS JOB #: C223630

Received: 2022/01/28, 12:49

Sample Matrix: Water
Samples Received: 5

Analyses	Quantity	Date	Date	Laboratory Method	Analytical Method
		Extracted	Analyzed		
Low level PFOS and PFOA by SPE/LCMS (1)	1	2022/02/07	2022/02/10	CAM SOP-00894	EPA 537 m
Low level PFOS and PFOA by SPE/LCMS (1)	4	2022/02/07	2022/02/09	CAM SOP-00894	EPA 537 m

Remarks:

Bureau Veritas is accredited to ISO/IEC 17025 for specific parameters on scopes of accreditation. Unless otherwise noted, procedures used by Bureau Veritas are based upon recognized Provincial, Federal or US method compendia such as CCME, MELCC, EPA, APHA.

All work recorded herein has been done in accordance with procedures and practices ordinarily exercised by professionals in Bureau Veritas' profession using accepted testing methodologies, quality assurance and quality control procedures (except where otherwise agreed by the client and Bureau Veritas in writing). All data is in statistical control and has met quality control and method performance criteria unless otherwise noted. All method blanks are reported; unless indicated otherwise, associated sample data are not blank corrected. Where applicable, unless otherwise noted, Measurement Uncertainty has not been accounted for when stating conformity to the referenced standard.

Bureau Veritas liability is limited to the actual cost of the requested analyses, unless otherwise agreed in writing. There is no other warranty expressed or implied. Bureau Veritas has been retained to provide analysis of samples provided by the Client using the testing methodology referenced in this report. Interpretation and use of test results are the sole responsibility of the Client and are not within the scope of services provided by Bureau Veritas, unless otherwise agreed in writing. Bureau Veritas is not responsible for the accuracy or any data impacts, that result from the information provided by the customer or their agent.

Solid sample results, except biota, are based on dry weight unless otherwise indicated. Organic analyses are not recovery corrected except for isotope dilution methods.

Results relate to samples tested. When sampling is not conducted by Bureau Veritas, results relate to the supplied samples tested.

This Certificate shall not be reproduced except in full, without the written approval of the laboratory.

Reference Method suffix "m" indicates test methods incorporate validated modifications from specific reference methods to improve performance.

* RPDs calculated using raw data. The rounding of final results may result in the apparent difference.

(1) Per- and polyfluoroalkyl substances (PFAS) identified as surrogates on the certificate of analysis represent the extracted internal standard.



Your Project #: BFTA
Site Location: BARNSTABLE, MA
Your C.O.C. #: n/a

Attention: Steven Tebo

Barnstable County
3195 Main Street
PO Box 427
Barnstable, MA
USA 02630

Report Date: 2022/02/15
Report #: R7006209
Version: 1 - Final

CERTIFICATE OF ANALYSIS

BUREAU VERITAS JOB #: C223630

Received: 2022/01/28, 12:49

Encryption Key

Please direct all questions regarding this Certificate of Analysis to your Project Manager.

Lori Dufour, Project Manager

Email: Lori.Dufour@bureauveritas.com

Phone# (905) 817-5700

=====

Bureau Veritas has procedures in place to guard against improper use of the electronic signature and have the required "signatories", as per ISO/IEC 17025, signing the reports.
For Service Group specific validation please refer to the Validation Signature Page.



Bureau Veritas Job #: C223630
Report Date: 2022/02/15

Barnstable County
Client Project #: BFTA
Site Location: BARNSTABLE, MA
Sampler Initials: MM

RESULTS OF ANALYSES OF WATER

Bureau Veritas ID		RSM962			RSM963			
Sampling Date		2022/01/25 14:45			2022/01/25 14:50			
COC Number		n/a			n/a			
	UNITS	INFLUENT (PRW-4)	RDL	MDL	SYSTEM#1 MIDPOINT	RDL	MDL	QC Batch
Perfluorinated Compounds								
Perfluorobutanoic acid (PFBA)	ng/L	20	2.0	0.67	11	2.0	0.67	7820838
Perfluoropentanoic acid (PFPeA)	ng/L	68	2.0	0.52	33	2.0	0.52	7820838
Perfluorohexanoic acid (PFHxA)	ng/L	70	2.0	0.70	36	2.0	0.70	7820838
Perfluoroheptanoic acid (PFHpA)	ng/L	37	2.0	0.51	21	2.0	0.51	7820838
Perfluorooctanoic acid (PFOA)	ng/L	23	2.0	0.49	12	2.0	0.49	7820838
Perfluorononanoic acid (PFNA)	ng/L	20	2.0	0.80	9.5	2.0	0.80	7820838
Perfluorodecanoic acid (PFDA)	ng/L	5.5	2.0	0.64	2.4	2.0	0.64	7820838
Perfluoroundecanoic acid (PFUnA)	ng/L	47	2.0	0.77	18	2.0	0.77	7820838
Perfluorododecanoic acid (PFDoA)	ng/L	<2.0	2.0	0.59	<2.0	2.0	0.59	7820838
Perfluorotridecanoic acid (PFTRDA)	ng/L	<2.0	2.0	0.48	<2.0	2.0	0.48	7820838
Perfluorotetradecanoic acid (PFTEDA)	ng/L	<2.0	2.0	0.37	<2.0	2.0	0.37	7820838
Perfluorobutanesulfonic acid (PFBS)	ng/L	9.2	2.0	0.47	4.2	2.0	0.47	7820838
Perfluoropentanesulfonic acid (PFPeS)	ng/L	15	2.0	0.73	6.1	2.0	0.73	7820838
Perfluorohexanesulfonic acid (PFHxS)	ng/L	110	2.0	5.3	56	2.0	0.53	7820838
Perfluoroheptanesulfonic acid (PFHpS)	ng/L	3.0	2.0	0.57	<2.0	2.0	0.57	7820838
Perfluorooctanesulfonic acid (PFOS)	ng/L	600	2.0	4.3	250	2.0	4.3	7820838
Perfluorooctane Sulfonamide (PFOSA)	ng/L	<4.0	4.0	0.81	<4.0	4.0	0.81	7820838
6:2 Fluorotelomer sulfonic acid	ng/L	51	4.0	0.59	25	4.0	0.59	7820838
8:2 Fluorotelomer sulfonic acid	ng/L	53	4.0	0.75	26	4.0	0.75	7820838
Surrogate Recovery (%)								
13C2-6:2-Fluorotelomersulfonic Acid	%	70	N/A	N/A	90	N/A	N/A	7820838
13C2-8:2-Fluorotelomersulfonic Acid	%	64	N/A	N/A	78	N/A	N/A	7820838
13C2-Perfluorodecanoic acid	%	61	N/A	N/A	86	N/A	N/A	7820838
13C2-Perfluorododecanoic acid	%	49 (1)	N/A	N/A	74	N/A	N/A	7820838
13C2-Perfluorohexanoic acid	%	72	N/A	N/A	98	N/A	N/A	7820838
13C2-perfluorotetradecanoic acid	%	47 (2)	N/A	N/A	51	N/A	N/A	7820838
RDL = Reportable Detection Limit QC Batch = Quality Control Batch N/A = Not Applicable (1) Extracted internal standard analyte recovery was below the defined lower control limit (LCL). Laboratory spiked water resulted in satisfactory recovery of the extracted internal standard analyte. When considered together, these QC data suggest that matrix interferences may be increasing the variability of the associated native analyte result (PFDoA). (2) Extracted internal standard analyte recovery was below the defined lower control limit (LCL). Laboratory spiked water resulted in satisfactory recovery of the extracted internal standard analyte. When considered together, these QC data suggest that matrix interferences may be increasing the variability of the associated native analyte results (PFTrDA, PFTeDA).								



Bureau Veritas Job #: C223630
Report Date: 2022/02/15

Barnstable County
Client Project #: BFTA
Site Location: BARNSTABLE, MA
Sampler Initials: MM

RESULTS OF ANALYSES OF WATER

Bureau Veritas ID		RSM962			RSM963			
Sampling Date		2022/01/25 14:45			2022/01/25 14:50			
COC Number		n/a			n/a			
	UNITS	INFLUENT (PRW-4)	RDL	MDL	SYSTEM#1 MIDPOINT	RDL	MDL	QC Batch
13C2-Perfluoroundecanoic acid	%	54	N/A	N/A	80	N/A	N/A	7820838
13C3-Perfluorobutanesulfonic acid	%	67	N/A	N/A	90	N/A	N/A	7820838
13C4-Perfluorobutanoic acid	%	63	N/A	N/A	84	N/A	N/A	7820838
13C4-Perfluoroheptanoic acid	%	64	N/A	N/A	81	N/A	N/A	7820838
13C4-Perfluorooctanesulfonic acid	%	62	N/A	N/A	78	N/A	N/A	7820838
13C4-Perfluorooctanoic acid	%	67	N/A	N/A	88	N/A	N/A	7820838
13C5-Perfluorononanoic acid	%	63	N/A	N/A	83	N/A	N/A	7820838
13C5-Perfluoropentanoic acid	%	62	N/A	N/A	88	N/A	N/A	7820838
13C8-Perfluorooctane Sulfonamide	%	55	N/A	N/A	77	N/A	N/A	7820838
18O2-Perfluorohexanesulfonic acid	%	67	N/A	N/A	86	N/A	N/A	7820838
RDL = Reportable Detection Limit QC Batch = Quality Control Batch N/A = Not Applicable								



Bureau Veritas Job #: C223630
Report Date: 2022/02/15

Barnstable County
Client Project #: BFTA
Site Location: BARNSTABLE, MA
Sampler Initials: MM

RESULTS OF ANALYSES OF WATER

Bureau Veritas ID		RSM964			RSM965	RSM966			
Sampling Date		2022/01/25 14:55			2022/01/25 14:40	2022/01/25 14:30			
COC Number		n/a			n/a	n/a			
	UNITS	SYSTEM#1 EFFLUENT	RDL	MDL	SYSTEM#2 MIDPOINT	SYSTEM#2 EFFLUENT	RDL	MDL	QC Batch
Perfluorinated Compounds									
Perfluorobutanoic acid (PFBA)	ng/L	<2.0	2.0	0.67	18	19	2.0	0.67	7820838
Perfluoropentanoic acid (PFPeA)	ng/L	<2.0	2.0	0.52	64	61	2.0	0.52	7820838
Perfluorohexanoic acid (PFHxA)	ng/L	<2.0	2.0	0.70	61	69	2.0	0.70	7820838
Perfluoroheptanoic acid (PFHpA)	ng/L	<2.0	2.0	0.51	34	36	2.0	0.51	7820838
Perfluorooctanoic acid (PFOA)	ng/L	<2.0	2.0	0.49	21	22	2.0	0.49	7820838
Perfluorononanoic acid (PFNA)	ng/L	<2.0	2.0	0.80	19	18	2.0	0.80	7820838
Perfluorodecanoic acid (PFDA)	ng/L	<2.0	2.0	0.64	4.6	4.8	2.0	0.64	7820838
Perfluoroundecanoic acid (PFUnA)	ng/L	<2.0	2.0	0.77	46	43	2.0	0.77	7820838
Perfluorododecanoic acid (PFDoA)	ng/L	<2.0	2.0	0.59	<2.0	<2.0	2.0	0.59	7820838
Perfluorotridecanoic acid (PFTRDA)	ng/L	<2.0	2.0	0.48	<2.0	<2.0	2.0	0.48	7820838
Perfluorotetradecanoic acid (PFTEDA)	ng/L	<2.0	2.0	0.37	<2.0	<2.0	2.0	0.37	7820838
Perfluorobutanesulfonic acid (PFBS)	ng/L	<2.0	2.0	0.47	7.9	7.8	2.0	0.47	7820838
Perfluoropentanesulfonic acid PFPes	ng/L	<2.0	2.0	0.73	13	12	2.0	0.73	7820838
Perfluorohexanesulfonic acid (PFHxS)	ng/L	<2.0	2.0	0.53	110	110	20	5.3	7820838
Perfluoroheptanesulfonic acid PFHpS	ng/L	<2.0	2.0	0.57	2.9	2.7	2.0	0.57	7820838
Perfluorooctanesulfonic acid (PFOS)	ng/L	<2.0	2.0	0.43	530	550	20	4.3	7820838
Perfluorooctane Sulfonamide (PFOSA)	ng/L	<4.0	4.0	0.81	<4.0	<4.0	4.0	0.81	7820838
6:2 Fluorotelomer sulfonic acid	ng/L	<4.0	4.0	0.59	49	45	4.0	0.59	7820838
8:2 Fluorotelomer sulfonic acid	ng/L	<4.0	4.0	0.75	55	52	4.0	0.75	7820838
Surrogate Recovery (%)									
13C2-6:2-Fluorotelomersulfonic Acid	%	78	N/A	N/A	84	67	N/A	N/A	7820838
13C2-8:2-Fluorotelomersulfonic Acid	%	73	N/A	N/A	72	58	N/A	N/A	7820838
13C2-Perfluorodecanoic acid	%	73	N/A	N/A	72	56	N/A	N/A	7820838
13C2-Perfluorododecanoic acid	%	62	N/A	N/A	65	53	N/A	N/A	7820838
13C2-Perfluorohexanoic acid	%	88	N/A	N/A	87	73	N/A	N/A	7820838
13C2-perfluorotetradecanoic acid	%	35 (1)	N/A	N/A	50	43 (1)	N/A	N/A	7820838
13C2-Perfluoroundecanoic acid	%	67	N/A	N/A	66	52	N/A	N/A	7820838
13C3-Perfluorobutanesulfonic acid	%	85	N/A	N/A	89	69	N/A	N/A	7820838
13C4-Perfluorobutanoic acid	%	86	N/A	N/A	77	61	N/A	N/A	7820838
13C4-Perfluoroheptanoic acid	%	81	N/A	N/A	80	66	N/A	N/A	7820838
RDL = Reportable Detection Limit QC Batch = Quality Control Batch N/A = Not Applicable (1) Extracted internal standard analyte recovery was below the defined lower control limit (LCL). Laboratory spiked water resulted in satisfactory recovery of the extracted internal standard analyte. When considered together, these QC data suggest that matrix interferences may be increasing the variability of the associated native analyte results (PFTrDA, PFTeDA).									



BUREAU
VERITAS

Bureau Veritas Job #: C223630

Report Date: 2022/02/15

Barnstable County

Client Project #: BFTA

Site Location: BARNSTABLE, MA

Sampler Initials: MM

RESULTS OF ANALYSES OF WATER

Bureau Veritas ID		RSM964			RSM965	RSM966			
Sampling Date		2022/01/25 14:55			2022/01/25 14:40	2022/01/25 14:30			
COC Number		n/a			n/a	n/a			
	UNITS	SYSTEM#1 EFFLUENT	RDL	MDL	SYSTEM#2 MIDPOINT	SYSTEM#2 EFFLUENT	RDL	MDL	QC Batch
13C4-Perfluorooctanesulfonic acid	%	70	N/A	N/A	74	59	N/A	N/A	7820838
13C4-Perfluorooctanoic acid	%	81	N/A	N/A	78	62	N/A	N/A	7820838
13C5-Perfluorononanoic acid	%	74	N/A	N/A	72	59	N/A	N/A	7820838
13C5-Perfluoropentanoic acid	%	85	N/A	N/A	76	65	N/A	N/A	7820838
13C8-Perfluorooctane Sulfonamide	%	69	N/A	N/A	69	55	N/A	N/A	7820838
18O2-Perfluorohexanesulfonic acid	%	79	N/A	N/A	72	58	N/A	N/A	7820838

RDL = Reportable Detection Limit

QC Batch = Quality Control Batch

N/A = Not Applicable



Bureau Veritas Job #: C223630
Report Date: 2022/02/15

Barnstable County
Client Project #: BFTA
Site Location: BARNSTABLE, MA
Sampler Initials: MM

TEST SUMMARY

Bureau Veritas ID: RSM962
Sample ID: INFLUENT (PRW-4)
Matrix: Water

Collected: 2022/01/25
Shipped:
Received: 2022/01/28

Test Description	Instrumentation	Batch	Extracted	Date Analyzed	Analyst
Low level PFOS and PFOA by SPE/LCMS	LCMS	7820838	2022/02/07	2022/02/09	Aby Thong

Bureau Veritas ID: RSM963
Sample ID: SYSTEM#1 MIDPOINT
Matrix: Water

Collected: 2022/01/25
Shipped:
Received: 2022/01/28

Test Description	Instrumentation	Batch	Extracted	Date Analyzed	Analyst
Low level PFOS and PFOA by SPE/LCMS	LCMS	7820838	2022/02/07	2022/02/09	Aby Thong

Bureau Veritas ID: RSM964
Sample ID: SYSTEM#1 EFFLUENT
Matrix: Water

Collected: 2022/01/25
Shipped:
Received: 2022/01/28

Test Description	Instrumentation	Batch	Extracted	Date Analyzed	Analyst
Low level PFOS and PFOA by SPE/LCMS	LCMS	7820838	2022/02/07	2022/02/09	Aby Thong

Bureau Veritas ID: RSM965
Sample ID: SYSTEM#2 MIDPOINT
Matrix: Water

Collected: 2022/01/25
Shipped:
Received: 2022/01/28

Test Description	Instrumentation	Batch	Extracted	Date Analyzed	Analyst
Low level PFOS and PFOA by SPE/LCMS	LCMS	7820838	2022/02/07	2022/02/09	Aby Thong

Bureau Veritas ID: RSM966
Sample ID: SYSTEM#2 EFFLUENT
Matrix: Water

Collected: 2022/01/25
Shipped:
Received: 2022/01/28

Test Description	Instrumentation	Batch	Extracted	Date Analyzed	Analyst
Low level PFOS and PFOA by SPE/LCMS	LCMS	7820838	2022/02/07	2022/02/10	Aby Thong



Bureau Veritas Job #: C223630
Report Date: 2022/02/15

Barnstable County
Client Project #: BFTA
Site Location: BARNSTABLE, MA
Sampler Initials: MM

GENERAL COMMENTS

Sample RSM962 [INFLUENT (PRW-4)] : Per- and polyfluoroalkyl substances (PFAS): Due to high concentrations of the target analytes, sample required dilution. Detection limits were adjusted accordingly.

Sample RSM963 [SYSTEM#1 MIDPOINT] : Per- and polyfluoroalkyl substances (PFAS): Due to high concentrations of the target analytes, sample required dilution. Detection limits were adjusted accordingly.

Sample RSM965 [SYSTEM#2 MIDPOINT] : Per- and polyfluoroalkyl substances (PFAS): Due to high concentrations of the target analytes, sample required dilution. Detection limits were adjusted accordingly.

Sample RSM966 [SYSTEM#2 EFFLUENT] : Per- and polyfluoroalkyl substances (PFAS): Due to high concentrations of the target analytes, sample required dilution. Detection limits were adjusted accordingly.

Results relate only to the items tested.



Bureau Veritas Job #: C223630
Report Date: 2022/02/15

Barnstable County
Client Project #: BFTA
Site Location: BARNSTABLE, MA
Sampler Initials: MM

QUALITY ASSURANCE REPORT

QA/QC	Batch	Init	QC Type	Parameter	Date Analyzed	Value	% Recovery	UNITS	QC Limits
7820838	ATN	Spiked Blank		13C2-6:2-Fluorotelomersulfonic Acid	2022/02/09		105	%	50 - 150
				13C2-8:2-Fluorotelomersulfonic Acid	2022/02/09		106	%	50 - 150
				13C2-Perfluorodecanoic acid	2022/02/09		104	%	50 - 150
				13C2-Perfluorododecanoic acid	2022/02/09		94	%	50 - 150
				13C2-Perfluorohexanoic acid	2022/02/09		116	%	50 - 150
				13C2-perfluorotetradecanoic acid	2022/02/09		93	%	50 - 150
				13C2-Perfluoroundecanoic acid	2022/02/09		94	%	50 - 150
				13C3-Perfluorobutanesulfonic acid	2022/02/09		104	%	50 - 150
				13C4-Perfluorobutanoic acid	2022/02/09		103	%	50 - 150
				13C4-Perfluoroheptanoic acid	2022/02/09		90	%	50 - 150
				13C4-Perfluorooctanesulfonic acid	2022/02/09		97	%	50 - 150
				13C4-Perfluorooctanoic acid	2022/02/09		102	%	50 - 150
				13C5-Perfluorononanoic acid	2022/02/09		106	%	50 - 150
				13C5-Perfluoropentanoic acid	2022/02/09		103	%	50 - 150
				13C8-Perfluorooctane Sulfonamide	2022/02/09		88	%	20 - 130
				18O2-Perfluorohexanesulfonic acid	2022/02/09		96	%	50 - 150
				Perfluorobutanoic acid (PFBA)	2022/02/09		99	%	70 - 130
				Perfluoropentanoic acid (PFPeA)	2022/02/09		102	%	70 - 130
				Perfluorohexanoic acid (PFHxA)	2022/02/09		91	%	70 - 130
				Perfluoroheptanoic acid (PFHpA)	2022/02/09		110	%	70 - 130
				Perfluorooctanoic acid (PFOA)	2022/02/09		97	%	70 - 130
				Perfluorononanoic acid (PFNA)	2022/02/09		96	%	70 - 130
				Perfluorodecanoic acid (PFDA)	2022/02/09		96	%	70 - 130
				Perfluoroundecanoic acid (PFUnA)	2022/02/09		101	%	70 - 130
				Perfluorododecanoic acid (PFDoA)	2022/02/09		103	%	70 - 130
				Perfluorotridecanoic acid (PFTRDA)	2022/02/09		99	%	70 - 130
				Perfluorotetradecanoic acid (PFTEDA)	2022/02/09		100	%	70 - 130
				Perfluorobutanesulfonic acid (PFBS)	2022/02/09		103	%	70 - 130
				Perfluoropentanesulfonic acid (PFPeS)	2022/02/09		107	%	70 - 130
				Perfluorohexanesulfonic acid (PFHxS)	2022/02/09		104	%	70 - 130
				Perfluoroheptanesulfonic acid (PFHpS)	2022/02/09		114	%	70 - 130
				Perfluorooctanesulfonic acid (PFOS)	2022/02/09		105	%	70 - 130
				Perfluorooctane Sulfonamide (PFOSA)	2022/02/09		98	%	70 - 130
				6:2 Fluorotelomer sulfonic acid	2022/02/09		97	%	70 - 130
				8:2 Fluorotelomer sulfonic acid	2022/02/09		98	%	70 - 130
7820838	ATN	Spiked Blank DUP		13C2-6:2-Fluorotelomersulfonic Acid	2022/02/09		96	%	50 - 150
				13C2-8:2-Fluorotelomersulfonic Acid	2022/02/09		98	%	50 - 150
				13C2-Perfluorodecanoic acid	2022/02/09		96	%	50 - 150
				13C2-Perfluorododecanoic acid	2022/02/09		88	%	50 - 150
				13C2-Perfluorohexanoic acid	2022/02/09		104	%	50 - 150
				13C2-perfluorotetradecanoic acid	2022/02/09		90	%	50 - 150
				13C2-Perfluoroundecanoic acid	2022/02/09		89	%	50 - 150
				13C3-Perfluorobutanesulfonic acid	2022/02/09		100	%	50 - 150
				13C4-Perfluorobutanoic acid	2022/02/09		103	%	50 - 150
				13C4-Perfluoroheptanoic acid	2022/02/09		90	%	50 - 150
				13C4-Perfluorooctanesulfonic acid	2022/02/09		92	%	50 - 150
				13C4-Perfluorooctanoic acid	2022/02/09		97	%	50 - 150
				13C5-Perfluorononanoic acid	2022/02/09		96	%	50 - 150
				13C5-Perfluoropentanoic acid	2022/02/09		95	%	50 - 150
				13C8-Perfluorooctane Sulfonamide	2022/02/09		81	%	20 - 130
				18O2-Perfluorohexanesulfonic acid	2022/02/09		97	%	50 - 150



BUREAU
VERITAS

Bureau Veritas Job #: C223630

Report Date: 2022/02/15

Barnstable County

Client Project #: BFTA

Site Location: BARNSTABLE, MA

Sampler Initials: MM

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	% Recovery	UNITS	QC Limits
7820838	ATN	RPD	Perfluorobutanoic acid (PFBA)	2022/02/09		91	%	70 - 130
			Perfluoropentanoic acid (PFPeA)	2022/02/09		92	%	70 - 130
			Perfluorohexanoic acid (PFHxA)	2022/02/09		92	%	70 - 130
			Perfluoroheptanoic acid (PFHpA)	2022/02/09		94	%	70 - 130
			Perfluorooctanoic acid (PFOA)	2022/02/09		92	%	70 - 130
			Perfluorononanoic acid (PFNA)	2022/02/09		93	%	70 - 130
			Perfluorodecanoic acid (PFDA)	2022/02/09		91	%	70 - 130
			Perfluoroundecanoic acid (PFUnA)	2022/02/09		94	%	70 - 130
			Perfluorododecanoic acid (PFDoA)	2022/02/09		96	%	70 - 130
			Perfluorotridecanoic acid (PFTRDA)	2022/02/09		98	%	70 - 130
			Perfluorotetradecanoic acid (PFTEDA)	2022/02/09		91	%	70 - 130
			Perfluorobutanesulfonic acid (PFBS)	2022/02/09		95	%	70 - 130
			Perfluoropentanesulfonic acid (PFPeS)	2022/02/09		99	%	70 - 130
			Perfluorohexanesulfonic acid (PFHxS)	2022/02/09		91	%	70 - 130
			Perfluoroheptanesulfonic acid (PFHpS)	2022/02/09		102	%	70 - 130
			Perfluorooctanesulfonic acid (PFOS)	2022/02/09		97	%	70 - 130
			Perfluorooctane Sulfonamide (PFOSA)	2022/02/09		96	%	70 - 130
			6:2 Fluorotelomer sulfonic acid	2022/02/09		94	%	70 - 130
			8:2 Fluorotelomer sulfonic acid	2022/02/09		90	%	70 - 130
			Perfluorobutanoic acid (PFBA)	2022/02/09	8.3		%	30
			Perfluoropentanoic acid (PFPeA)	2022/02/09	11		%	30
			Perfluorohexanoic acid (PFHxA)	2022/02/09	1.4		%	30
			Perfluoroheptanoic acid (PFHpA)	2022/02/09	16		%	30
			Perfluorooctanoic acid (PFOA)	2022/02/09	5.8		%	30
			Perfluorononanoic acid (PFNA)	2022/02/09	2.7		%	30
			Perfluorodecanoic acid (PFDA)	2022/02/09	4.9		%	30
			Perfluoroundecanoic acid (PFUnA)	2022/02/09	7.7		%	30
			Perfluorododecanoic acid (PFDoA)	2022/02/09	6.2		%	30
			Perfluorotridecanoic acid (PFTRDA)	2022/02/09	1.5		%	30
			Perfluorotetradecanoic acid (PFTEDA)	2022/02/09	9.5		%	30
			Perfluorobutanesulfonic acid (PFBS)	2022/02/09	7.8		%	30
			Perfluoropentanesulfonic acid (PFPeS)	2022/02/09	8.3		%	30
			Perfluorohexanesulfonic acid (PFHxS)	2022/02/09	13		%	30
			Perfluoroheptanesulfonic acid (PFHpS)	2022/02/09	11		%	30
			Perfluorooctanesulfonic acid (PFOS)	2022/02/09	7.8		%	30
			Perfluorooctane Sulfonamide (PFOSA)	2022/02/09	1.9		%	30
			6:2 Fluorotelomer sulfonic acid	2022/02/09	3.5		%	30
			8:2 Fluorotelomer sulfonic acid	2022/02/09	8.2		%	30
7820838	ATN	Method Blank	13C2-6:2-Fluorotelomersulfonic Acid	2022/02/09		93	%	50 - 150
			13C2-8:2-Fluorotelomersulfonic Acid	2022/02/09		87	%	50 - 150
			13C2-Perfluorodecanoic acid	2022/02/09		84	%	50 - 150
			13C2-Perfluorododecanoic acid	2022/02/09		78	%	50 - 150
			13C2-Perfluorohexanoic acid	2022/02/09		89	%	50 - 150
			13C2-perfluorotetradecanoic acid	2022/02/09		93	%	50 - 150
			13C2-Perfluoroundecanoic acid	2022/02/09		83	%	50 - 150
			13C3-Perfluorobutanesulfonic acid	2022/02/09		94	%	50 - 150
			13C4-Perfluorobutanoic acid	2022/02/09		95	%	50 - 150
			13C4-Perfluoroheptanoic acid	2022/02/09		89	%	50 - 150
			13C4-Perfluorooctanesulfonic acid	2022/02/09		80	%	50 - 150
			13C4-Perfluorooctanoic acid	2022/02/09		88	%	50 - 150
			13C5-Perfluorononanoic acid	2022/02/09		89	%	50 - 150



Bureau Veritas Job #: C223630
Report Date: 2022/02/15

Barnstable County
Client Project #: BFTA
Site Location: BARNSTABLE, MA
Sampler Initials: MM

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	% Recovery	UNITS	QC Limits
			13C5-Perfluoropentanoic acid	2022/02/09		94	%	50 - 150
			13C8-Perfluorooctane Sulfonamide	2022/02/09		65	%	20 - 130
			18O2-Perfluorohexanesulfonic acid	2022/02/09		81	%	50 - 150
			Perfluorobutanoic acid (PFBA)	2022/02/09	<2.0		ng/L	
			Perfluoropentanoic acid (PFPeA)	2022/02/09	<2.0		ng/L	
			Perfluorohexanoic acid (PFHxA)	2022/02/09	<2.0		ng/L	
			Perfluoroheptanoic acid (PFHpA)	2022/02/09	<2.0		ng/L	
			Perfluorooctanoic acid (PFOA)	2022/02/09	<2.0		ng/L	
			Perfluorononanoic acid (PFNA)	2022/02/09	<2.0		ng/L	
			Perfluorodecanoic acid (PFDA)	2022/02/09	<2.0		ng/L	
			Perfluoroundecanoic acid (PFUnA)	2022/02/09	<2.0		ng/L	
			Perfluorododecanoic acid (PFDoA)	2022/02/09	<2.0		ng/L	
			Perfluorotridecanoic acid (PFTRDA)	2022/02/09	<2.0		ng/L	
			Perfluorotetradecanoic acid(PFTEDA)	2022/02/09	<2.0		ng/L	
			Perfluorobutanesulfonic acid (PFBS)	2022/02/09	<2.0		ng/L	
			Perfluoropentanesulfonic acid PFPes	2022/02/09	<2.0		ng/L	
			Perfluorohexanesulfonic acid(PFHxS)	2022/02/09	<2.0		ng/L	
			Perfluoroheptanesulfonic acid PFHpS	2022/02/09	<2.0		ng/L	
			Perfluorooctanesulfonic acid (PFOS)	2022/02/09	<2.0		ng/L	
			Perfluorooctane Sulfonamide (PFOSA)	2022/02/09	<4.0		ng/L	
			6:2 Fluorotelomer sulfonic acid	2022/02/09	<4.0		ng/L	
			8:2 Fluorotelomer sulfonic acid	2022/02/09	<4.0		ng/L	

Duplicate: Paired analysis of a separate portion of the same sample. Used to evaluate the variance in the measurement.

Spiked Blank: A blank matrix sample to which a known amount of the analyte, usually from a second source, has been added. Used to evaluate method accuracy.

Method Blank: A blank matrix containing all reagents used in the analytical procedure. Used to identify laboratory contamination.

Surrogate: A pure or isotopically labeled compound whose behavior mirrors the analytes of interest. Used to evaluate extraction efficiency.



Bureau Veritas Job #: C223630
Report Date: 2022/02/15

Barnstable County
Client Project #: BFTA
Site Location: BARNSTABLE, MA
Sampler Initials: MM

VALIDATION SIGNATURE PAGE

The analytical data and all QC contained in this report were reviewed and validated by:

A handwritten signature in black ink, appearing to read "Sin Chii Chia".

Sin Chii Chia, Scientific Specialist

Bureau Veritas has procedures in place to guard against improper use of the electronic signature and have the required "signatories", as per ISO/IEC 17025, signing the reports. For Service Group specific validation please refer to the Validation Signature Page.



www.BVNA.com

6740 Campobello Road, Mississauga, Ontario L5N 2L8
Phone: 905-817-5700 Fax: 905-817-5779 Toll Free: 800-563-6266


CHAIN OF CUSTODY RECORD

ENV COC - 00014v2

Page 1 of 1

28-Jan-22 12:49

Lori Dufour



C223630

RJM ENV-1458

Invoice Information			Report Information (if differs from invoice)			Project Information		
Company:	Barnstable County		Company:	BETA Group		Quotation #:		
Contact Name:	Pnscilla Ellis / Stere Tebo		Contact Name:	Roger Thibault		P.O. #/ AFER:		
Street Address:	PO Box 427 Main St.		Street Address:	901 George Wash. Hwy		Project #:	6206	
City:	Barnstable	Prov: MA	City:	Lincoln	Prov: RI	Site #:	Barnstable FTA	
Phone:			Phone:	401-333-2382		Site Location:	Barnstable, MA	
Email:	petilis@barnstablecounty.org		Email:	mmendes@beta-inc.com		Site Location Province:		
Copies:	steboc@barnstablecounty.org		Copies:	rthibault@beta-inc.com		Sampled By:	Mykel Mendes	

REG 153		Regulatory Criteria		1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22																		Regular Turnaround Time (TAT)								
<input type="checkbox"/> Table 1	<input type="checkbox"/> Res/Park	<input type="checkbox"/> Med/Fine	<input type="checkbox"/> CCME	<input type="checkbox"/> Reg 406, Table:																			5 to 7 Day							
<input type="checkbox"/> Table 2	<input type="checkbox"/> Ind/Comm	<input type="checkbox"/> Course	<input type="checkbox"/> Reg 558*	<input type="checkbox"/> Sanitary Sewer Bylaw																			Rush Turnaround Time (TAT)							
<input type="checkbox"/> Table 3	<input type="checkbox"/> Agri/other	<input type="checkbox"/> For RSC	<input type="checkbox"/> MISA	<input type="checkbox"/> Storm Sewer Bylaw																			Surcharges apply							
<input type="checkbox"/> Table			<input type="checkbox"/> PWQO	<input type="checkbox"/> Other:																			Same Day							
Include Criteria on Certificate of Analysis (check if yes):					<input checked="" type="checkbox"/> MASS DEP GW-1																		2 Day							
SAMPLES MUST BE KEPT COOL (<10°C) FROM TIME OF SAMPLING UNTIL DELIVERY TO BUREAU VERITAS																							3 Day							
Sample Identification				Date Sampled		Time (24hr)		Matrix																				4 Day		
				YY	MM	DD	HH	MM																					Date Required:	
																												YY MM DD		
																												Comments		
1	INFLUENT (PRW-4)			22	01	25	14	45	GW																			2	use lower	
2	SYSTEM #1 MIDPOINT			22	01	25	14	50																				2	RDL values	
3	SYSTEM #1 EFFLUENT			22	01	25	14	55																				2	for all samples	
4	SYSTEM #2 MIDPOINT			22	01	25	14	40																				2		
5	SYSTEM #2 EFFLUENT			22	01	25	14	30	GW																			2		
6																														
7																														
8																														
9																														
10																														
11																														
12																														

*UNLESS OTHERWISE AGREED TO IN WRITING, WORK SUBMITTED ON THIS CHAIN OF CUSTODY IS SUBJECT TO BUREAU VERITAS STANDARD TERMS AND CONDITIONS. SIGNING OF THIS CHAIN OF CUSTODY DOCUMENT IS ACKNOWLEDGMENT AND ACCEPTANCE OF OUR TERMS AND CONDITIONS WHICH ARE AVAILABLE FOR VIEWING AT WWW.BVNA.COM/TERMS-AND-CONDITIONS OR BY CALLING THE LABORATORY LISTED ABOVE TO OBTAIN A COPY

LAB USE ONLY		Yes	No	2.1		2.1		2.7		LAB USE ONLY		Yes	No	2.1		2.1		2.7		LAB USE ONLY		Yes	No	2.1		2.1		2.7		Temperature reading by:	
Seal present										Seal present										Seal present											
Seal intact										Seal intact										Seal intact											
Cooling media present										Cooling media present										Cooling media present											
Relinquished by: (Signature/Print)				Date		Time		Received by: (Signature/Print)				Date		Time		Special Instructions															
Mykel Mendes				YY	MM	DD	HH	MM	2022				01	27	10	00															
Mykel Mendes				22	01	27	10	00	Roy Masari				2022	01	28	12	49														

APPENDIX C
PUBLIC NOTIFICATIONS



February 2022

Mark S. Ells, Town Manager
Town of Barnstable
200 Main Street
Hyannis, MA 02601

RE: Immediate Response Action Status and Remedial Monitoring Report #62
The Former Barnstable County Fire and Rescue Training Academy
155 South Flint Rock Road
Barnstable, Massachusetts
DEP Release Tracking No. 4-26179
Project File #6206

Dear Mr. Ells,

As required by the Massachusetts Contingency Plan (MCP) 310 CMR 40.1403(3)(e) and 40.1403(6), BETA Group, Inc. (BETA) is notifying you on behalf of our client, Barnstable County, that an Immediate Response Action (IRA) Status and Remedial Monitoring Report (RMR) No. 62 is being submitted to the Massachusetts Department of Environmental Protection – Bureau of Waste Site Cleanup (MassDEP – BWSC) for the release site referenced as the former Barnstable County Fire and Rescue Training Academy (BCFRTA) located at 155 South Flint Rock Road in Barnstable, Massachusetts (the site). This Report summarizes the IRA activities that occurred during the January 2022 monthly reporting period.

Pursuant to the Massachusetts Contingency Plan (310 CMR 40.0480), an Initial Site Investigation has been performed at the site. A release of oils and/or hazardous materials has occurred at the site. In August 2016, MassDEP Southeast Regional Office issued a Notice of Responsibility (NOR) to Barnstable County, as current owner and operator of the Barnstable County Fire and Rescue Training Academy (BCFRTA), that the detection of elevated concentrations of poly- and perfluoroalkyl substances (PFAS) in groundwater at the site constituted a release under the MCP. MassDEP issued Release Tracking Number (RTN) 4-26179 to this release. As summarized in the NOR, based on the detected PFAS concentrations in soil and groundwater at the BCFRTA and the inferred groundwater flow, MassDEP determined that the releases of PFAS from the use of aqueous film-forming foam (AFFF) at the BCFRTA is a source of PFAS detected in the Mary Dunn public water supply wells.

During the January 2022 reporting period, the treatment systems, GWTS #1 and GWTS#2 were in operation for all, or portions of approximately 29 days.

The overall (average) system flow rate and gallons of groundwater treated are based on the available Effluent flow totalizer readings reported by the O&M contractor. For the January 2022 reporting period GWTS#1 and GWTS#2 treated an approximate combined 0.78 million gallons of groundwater from the downgradient recovery well PRW-4 at an average, total combined effluent flow rate of 18.73 gpm. The average combined influent flow rate was measured to be 49.2 gpm.

Based on the total of 0.78 million gallons treated, approximately 0.002 kilograms of PFAS were estimated to have been removed from the plume area.

The IRA Status and RMR document is available electronically via the searchable sites database of the MassGOV / MassDEP website via the following link:

<https://eeonline.eea.state.ma.us/portal#!/wastesite/4-0026179>

At this time, IRA activities are ongoing. Continuing IRA activities will include operation and monitoring of the on-Site Groundwater Pump and Treatment Systems (GWPTS), including performance sampling of GWPTS, review and evaluation of the on-Site GWPTS operation and maintenance activities as they affect groundwater treatment, periodic groundwater monitoring. Additional details regarding the continuing IRA activities are included in the IRA Status and RMR No. 62 report document.


Change in Procedure for Filing Status Reports

In December 2021, MassDEP communicated to the County and BETA that based on the current project status, monthly submissions of IRA status and remedial monitoring reports (RMR) would no longer be required. Upon further discussion with MassDEP in January 2022, it was established that a six-month submittal schedule for IRA Status and RMR reports will be acceptable. The first report submission within this new schedule is this IRA Status and RMR No. 62 document.

However, quarterly updates regarding clean up and remediation activities of the PFAS release at the Site will be provided to the public, more specifically those listed on the Public Involvement mailing list. These updates will be in the form of written notices and/or public meetings.

If you have any questions or comments, please do not hesitate to contact our office.

Sincerely,
BETA Group, Inc.



Roger P. Thibault, P.E., LSP
Associate/Project Manager

Copies: Mass Department of Environmental Protection
Southeast Regional Office
20 Riverside Drive
Lakeville, MA 02347

Thomas Mckean, Director
Town of Barnstable Health Division
200 Main Street
Hyannis, MA 02601

Hans Keijser, Supervisor
Town of Barnstable Water Supply Division
47 Old Yarmouth Road
Hyannis, MA 02601